Potlatch

Potlatch Forest Products Corporation
Idaho Pulp & Paperboard Division
P.O. Box 1126
Lewiston, Idaho 83501

Feb 9 , 2007

Shawnee Chen
Air Quality Division
Department of Environmental Quality
Via e-mail

Dear Ms. Chen

This correspondence is in response to your Application Incompleteness Determination dated Feb. 5, 2007.

1. Potlatch proposed to obtain the PTC using procedure specified in IDAPA 58.01.01.209.05 (c). Under IDAPA 58.01.01.209.05 (c), the applicant is required to "Submit all information required ……by Sections 300 through 381 for a Tier I operating permit, or Tier I operating permit modification…" For this permit action, specifically, Potlatch is required to submit Compliance Certification and Compliance Plans for LVHC system and LVHC collect system in accordance with IDAPA 58.01.01.314.09 and IDAPA 58.01.01.314.10.

See attached semiannual report dated January 30, 2007.

2. Based on the discussion between the applicant and DEQ on January 10, 2007, DEQ will not remove the short term SO2 limit from the permit for this permit action. DEQ does not have enough information from the application to address the request. DEQ seeks applicant's concurrence to remove this request from the application.

I understand that removal of the short term limit would make it difficult to assess the appropriateness of SO2 scrubber operating parameters, therefore it is acceptable to leave this limit in the permit at this time. However, the statement of basis should indicate that this is not a NAAQS based limit.

3. While developing the draft permit, it is found that it is not practical to only include SO2 emissions from No.3 and No.4 lime kilns in this permit. While lime kilns are considered control devices for the LVHC system, they also function as emissions units. The lime kilns are used to produce calcium oxide. They emit particulate matter and other air pollutants due to combustion. It makes sense to evaluate all the emissions from the lime kilns all together. DEQ seeks applicant's concurrence to remove the request for including SO2 emissions from No.3 and No.4 lime kilns in the permit revision at this permit action.

Agreed.

4. Please provide information on 1) How the operations of LVHC system affect the sulfur loading in the gas stream entering the packed bed scrubber; and 2) What parameters of the LVHC system monitored at Potlatch may help predicting the sulfur loading in the gas stream.

Sulfur is a byproduct of the combustion of LVHC gases in either a kiln or incinerator. LVHC gases are generated during "blows" of the batch digesters and continuously from the continuous digesters. Pulp production rates are generally stable during normal operations. Parameter monitoring of the LVHC system for the purposes of predicting sulfur loading is not performed. Parameter monitoring of the pH and flow rate of the SO2 scrubber will demonstrate SO2 emission control.

5. Please provide information and explanation on which requirements apply to Potlatch – requirements under 40 CF 63.450(b), or 40 CF 63.450(c), or requirements under both.

Both apply

6. 40 CFR 63.455 requires the facility to submit the initial notification report specified under 40 CFR 63.9(b)(2) by April 15, 1999. Has Potlatch fulfilled the requirement?

Yes, see letter to Sue Richards, Chief, Air Quality Permitting Bureau, dated April 14, 1999.

7. Are LVHC gases routed to a recovery furnace at Potlatch? This information is for determining which requirement under 40 CFR 60.283 applies to Potlatch.

LVHC gases are not routed to a recovery furnace. 40 CFR 60.283(a)(1)(iii) applys because the gases are combusted with other waste gases in an incinerator, or in a lime not subject to Subpart BB,

8. Has Potlatch fulfilled the requirement for conducting the performance test required in 40 CFR 60.8 (see also 40 CFR 60.285)? If yes, would you provide a performance test summary report with information that you deem important?

A performance test under 60.8 is not required for LVHC.

If you have any questions do not hesitate to contact me at 208-799-4104 or 208-413-2703.

Sincerely

Susan Somers
Environmental Engineering Manager

Potlatch

Pulp and Paperboard Division
Environmental Department

Jan 8, 2007

Shawnee Chen
Air quality Division
Department of Environmental Quality
Via e-mail

Dear Ms. Chen

This correspondence is in response to your Application Incompleteness Determination dated January 4, 2007.

A diagram of the non-condensable gas system is included for your reference. Note, the condensate stripper included in the 1997 permit was never constructed. The mill pipes condensates to the Aerated Stabilization Basin for treatment

The remainder of your questions are addressed below.

1. In Table 2.1 of the proposed permit of the application, the turpentine system and foul condensate collection tank are listed as emissions units which were not mentioned in the technical memorandum dated March 14, 1995, for the PTC issued March 15, 1995. How are these two emissions units related to the condensate stripper that was proposed and permitted in the March 15, 1995, PTC? Do these emissions units have a PTC?

The turpentine system and associated condensate collection tank have always been part of the digester gas collection system. The condensate stripper system was not installed. The turpentine system was included in Chemetics February 1993 memo (attached) that provided information for the initial permit.

2. 1.1 SO2 emissions limits
What is the regulatory base to include "When LVHC gases are combusted in No. 3 or No.4 Lime Kiln the SO2 emissions will not exceed 36 tons per year combined." in Permit Condition 2.6 of the application? How were 36 tons per year determined?

The 36 tons is the limit in the current Tier 1 permit (page 31), derived from the March 2001 PTC (page 5-5) for the lime kilns. The limit was set to avoid major NSR for SO2, and was estimated based on combustion of NCG in 4 Kiln 100% of the operating time and combustion of LVHC (NCG) in No. 3 kiln for 720 hours per year. I have set this as combine limit for this project to allow for operational flexibility.

3. TRS emission limits
How is the retention time of NCGs in the incinerator determined? Please provide the calculations/supporting document(s) to demonstrate that the NCGs are combusted within the incinerator at a minimum temperature of 650 OC (1200 OF) for at least 0.5 second (40 CFR 60.283(a)(iii)).

The current retention time was calculated by proportioning up the results of the calculation on Page 2 of Chemtics 2/17/1993 correspondence as follows;

Potlatch Forest Products Corporation
A WHOLLY OWNED SUBSIDIARY OF POTLATCH CORPORATION

803 Mill Road / P.O. Box 1126 / Lewiston, ID 83501-1126
F (208)799-1788 / ***www.potlatchcorp.com***

Current retention chamber volume: 6.5 ft. /2 x 3.14 x 16 ft. = 530 cubic feet. (see Kvaerner Chemetics drawing attached)
Previous retention chamber volume; 150 cubic feet.
Previous worse case retention chamber retention time; 0.33 seconds
Current retention chamber retention time = 0.33 seconds x (530 ft / 150 ft) = 1.17 seconds.

4. 2.2 Packed Bed Absorber Operation
The packed bed absorber was permitted to control the SO2 emissions from the incinerator only. Per the proposed Permit Condition 2.11in the application, Potlatch wants to use the packed bed absorber to control the SO2 emitted from the No. 4 lime kiln. Is this a modification to the No.4 lime kiln and the process (batch digesters, continuous digesters, multiple-effect evaporator, turpentine system, and foul condensate collection tank)? How or does that affect the emissions and operations of the process, the lime kilns, and the packed bed absorber? Please provide the manufacturer's recommendations, the O&M manual, and recent DEQ approved source test data of the packed bed scrubber to support proposed Permit Condition 2.15 of the application.

There are 2 existing SO2 scrubbers. Section 2.15 of the proposed permit has been modified to clarify this. One is after the incinerator. An additional SO2 scrubber is located after No. 4 lime kiln. At this time, SO2 emissions from both of these scrubbers are continually monitored by SO2 CERMS. These CERMS are RATA'd annually and the RATA reports are submitted and approved by DEQ. One of the objectives of this permit request is to replace the CERMS with parameter monitoring.

5. 3.2 SO2 CERMS
Please provide the maximum SO2 CEM data in lb/hr, three-hour average at normal worse case scenario, and the maximum SO2 emissions in tons per year and its corresponding months since the permit was issued in March 1995.

Historical data will not provide the maximum SO2 emission data at normal worse case because scrubber parameters are not normally adjusted. In order to determine worse case SO2 emissions, controlled testing will be conducted on both scrubbers while adjusting pH and flow parameter, to establish the minimum operating range as require by part 64. Note that the permit does not need to include parameter ranges, simply the process by which parameter ranges are to be set. See page 17 of the attached EPA CAM supplement.

Current CERMs records are paper based. I have manually entered daily SO2 for 2006 in the attached spreadsheet. Note that SO2 is essentially 0. Artifact readings from the daily calibrations are included in the daily totals, biasing the results high. We are unable to correct this as the software is no longer supported by the manufacturer. CAM monitoring would be a better indicator of scrubber performance. I have also attached 3 months of daily reports CEM for your information. It is estimated that 25 lbs of SO2 is emitted per month from calibration gases used to maintain the instrument. I do not understand your request for records back to 1995. If you still need more information after reviewing the attached data, let me know.

If you require additional information, do not hesitate to contact me at 208-799-4104.

Sincerely

Susan Somers
Environmental Engineering Manager

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 1 , 2006
Report Printed on 10-02-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.98	0.04	10.43	0.38	156.68	0.05	0.00	0.50	0.14	6488
7:00 to 8:00	13.04	0.30	0.12	0.31	158.30	0.41	0.01	0.01	0.14	5845
8:00 to 9:00	13.01	0.23	0.00	0.26	157.91	0.32	0.00	0.00	0.14	5373
9:00 to 10:00	12.86	1.07	0.00	0.33	158.45	1.44	0.03	0.00	0.00	6040
10:00 to 11:00	12.95	0.87	0.00	0.29	158.16	1.19	0.02	0.00	0.00	5645
11:00 to 12:00	12.95	0.91	0.00	0.30	157.74	1.25	0.02	0.00	0.00	5780
12:00 to 13:00	13.07	0.29	0.00	0.20	157.59	0.41	0.01	0.00	0.00	4617
13:00 to 14:00	13.09	0.04	0.00	0.20	158.16	0.05	0.00	0.00	0.00	4585
14:00 to 15:00	13.04	0.41	0.00	0.28	157.53	0.57	0.01	0.00	0.00	5601
15:00 to 16:00	13.18	0.48	0.00	0.27	157.31	0.68	0.01	0.00	0.00	5477
16:00 to 17:00	13.19	0.48	0.00	0.26	158.01	0.67	0.01	0.00	0.00	5397
17:00 to 18:00	13.13	0.05	0.00	0.25	156.98	0.07	0.00	0.00	0.00	5249
18:00 to 19:00	13.11	0.77	0.00	0.25	157.64	1.07	0.02	0.00	0.00	5327
19:00 to 20:00	13.11	0.17	0.00	0.26	157.99	0.24	0.00	0.00	0.00	5371
20:00 to 21:00	13.11	0.21	0.00	0.26	157.56	0.29	0.00	0.00	0.00	5409
21:00 to 22:00	13.21	0.34	0.00	0.27	157.50	0.47	0.01	0.00	0.00	5526
22:00 to 23:00	13.13	0.17	0.00	0.23	157.49	0.24	0.00	0.00	0.00	5118
23:00 to 24:00	13.13	1.05	0.00	0.31	157.88	1.47	0.02	0.00	0.00	5893
0:00 to 1:00	13.03	0.68	0.00	0.39	157.43	0.93	0.02	0.00	0.00	6581
1:00 to 2:00	13.05	0.58	0.00	0.36	158.06	0.80	0.01	0.00	0.00	6300
2 3:00	13.00	0.08	0.00	0.39	157.22	0.11	0.00	0.00	0.00	6618
3:00 to 4:00	12.95	0.24	0.00	0.39	157.26	0.33	0.01	0.00	0.00	6607
4:00 to 5:00	12.96	0.46	0.00	0.31	157.87	0.63	0.01	0.00	0.00	5886
5:00 to 6:00	13.13	0.12	0.00	0.27	157.21	0.17	0.00	0.00	0.00	5448
Averages										
6:00 to 18:00	13.04	0.43	0.88	0.28	157.74	0.60	0.01	0.04	0.03	5508
18:00 to 6:00	13.08	0.41	0.00	0.31	157.59	0.56	0.01	0.00	0.00	5840
6:00 to 6:00	13.06	0.42	0.44	0.29	157.66	0.58	0.01	0.02	0.02	5674

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 2 , 2006
Report Printed on 10-03-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.87	0.60	9.84	0.28	158.10	0.81	0.01	0.43	0.12	5577
7:00 to 8:00	13.04	0.66	0.04	0.31	158.66	0.91	0.02	0.00	0.12	5814
8:00 to 9:00	12.97	0.38	0.00	0.31	158.36	0.51	0.01	0.00	0.12	5892
9:00 to 10:00	12.86	0.43	0.00	0.41	158.55	0.58	0.01	0.00	0.00	6746
10:00 to 11:00	12.85	0.25	0.00	0.36	159.04	0.34	0.01	0.00	0.00	6299
11:00 to 12:00	12.91	0.36	0.00	0.32	159.14	0.49	0.01	0.00	0.00	5986
12:00 to 13:00	12.95	0.80	0.00	0.20	159.09	1.09	0.01	0.00	0.00	4583
13:00 to 14:00	13.09	0.86	0.00	0.31	159.94	1.20	0.02	0.00	0.00	5926
14:00 to 15:00	12.95	0.60	0.00	0.25	159.38	0.82	0.01	0.00	0.00	5114
15:00 to 16:00	13.20	0.62	0.00	0.25	158.42	0.87	0.01	0.00	0.00	5248
16:00 to 17:00	13.04	0.34	0.00	0.18	159.07	0.47	0.00	0.00	0.00	4421
17:00 to 18:00	13.02	0.18	0.00	0.25	158.38	0.25	0.00	0.00	0.00	5259
18:00 to 19:00	13.01	0.33	0.00	0.26	158.19	0.46	0.01	0.00	0.00	5402
19:00 to 20:00	13.02	0.86	0.00	0.26	159.24	1.18	0.02	0.00	0.00	5339
20:00 to 21:00	12.96	0.55	0.00	0.27	158.93	0.76	0.01	0.00	0.00	5534
21:00 to 22:00	12.95	1.06	0.00	0.34	158.62	1.45	0.03	0.00	0.00	6164
22:00 to 23:00	13.12	0.43	0.00	0.27	159.00	0.60	0.01	0.00	0.00	5570
23:00 to 24:00	13.11	0.50	0.00	0.31	158.52	0.69	0.01	0.00	0.00	5831
0:00 to 1:00	13.15	0.76	0.00	0.38	158.33	1.07	0.02	0.00	0.00	6519
1:00 to 2:00	13.17	0.25	0.00	0.40	158.26	0.35	0.01	0.00	0.00	6527
2:00 to 3:00	13.19	0.13	0.00	0.26	157.86	0.19	0.00	0.00	0.00	5360
3:00 to 4:00	13.07	0.37	0.00	0.35	158.15	0.52	0.01	0.00	0.00	6213
4:00 to 5:00	13.05	0.37	0.00	0.30	158.65	0.51	0.01	0.00	0.00	5770
5:00 to 6:00	13.03	0.34	0.00	0.26	157.89	0.47	0.01	0.00	0.00	5408
Averages										
6:00 to 18:00	12.98	0.51	0.82	0.29	158.84	0.69	0.01	0.04	0.03	5572
18:00 to 6:00	13.07	0.50	0.00	0.31	158.47	0.69	0.01	0.00	0.00	5803
6:00 to 6:00	13.02	0.50	0.41	0.30	158.66	0.69	0.01	0.02	0.01	5688

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 3 , 2006
Report Printed on 10-04-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.99	0.73	10.01	0.36	155.08	1.00	0.02	0.52	0.14	6343
7:00 to 8:00	12.92	0.47	0.01	0.31	145.76	0.63	0.01	0.00	0.14	5844
8:00 to 9:00	12.95	0.35	0.00	0.27	145.70	0.48	0.01	0.00	0.14	5449
9:00 to 10:00	12.99	0.77	0.00	0.27	145.44	1.06	0.02	0.00	0.00	5439
10:00 to 11:00	12.86	0.26	0.00	0.28	145.79	0.35	0.01	0.00	0.00	5579
11:00 to 12:00	12.91	0.55	0.00	0.25	145.61	0.75	0.01	0.00	0.00	5319
12:00 to 13:00	12.92	0.75	0.00	0.22	145.30	1.02	0.02	0.00	0.00	4876
13:00 to 14:00	12.91	0.59	0.00	0.23	146.23	0.80	0.01	0.00	0.00	5027
14:00 to 15:00	12.88	0.28	0.00	0.27	145.40	0.38	0.01	0.00	0.00	5465
15:00 to 16:00	12.92	0.73	0.00	0.28	145.72	1.00	0.02	0.00	0.00	5518
16:00 to 17:00	12.98	0.55	0.00	0.19	145.89	0.75	0.01	0.00	0.00	4465
17:00 to 18:00	12.96	0.39	0.00	0.25	145.47	0.53	0.01	0.00	0.00	5298
18:00 to 19:00	13.02	0.97	0.00	0.29	145.72	1.33	0.02	0.00	0.00	5732
19:00 to 20:00	12.86	0.42	0.00	0.33	146.07	0.57	0.01	0.00	0.00	6052
20:00 to 21:00	12.96	0.40	0.00	0.29	145.80	0.55	0.01	0.00	0.00	5651
21:00 to 22:00	13.01	0.45	0.00	0.33	145.40	0.63	0.01	0.00	0.00	6001
22:00 to 23:00	13.05	0.45	0.00	0.29	146.22	0.62	0.01	0.00	0.00	5644
23:00 to 24:00	13.02	0.79	0.00	0.35	145.62	1.09	0.02	0.00	0.00	6220
0:00 to 1:00	12.92	0.98	0.00	0.37	145.70	1.34	0.03	0.00	0.00	6397
1:00 to 2:00	13.02	0.67	0.00	0.34	146.18	0.92	0.02	0.00	0.00	6109
[illegible] 3:00	12.94	0.47	0.00	0.26	145.47	0.65	0.01	0.00	0.00	5408
3:00 to 4:00	12.94	0.60	0.00	0.36	145.28	0.82	0.02	0.00	0.00	6342
4:00 to 5:00	12.92	0.76	0.00	0.30	145.82	1.04	0.02	0.00	0.00	5760
5:00 to 6:00	13.06	0.42	0.00	0.32	145.43	0.59	0.01	0.00	0.00	5994
Averages										
6:00 to 18:00	12.93	0.54	0.83	0.26	146.45	0.73	0.01	0.04	0.04	5385
18:00 to 6:00	12.98	0.62	0.00	0.32	145.73	0.85	0.02	0.00	0.00	5942
6:00 to 6:00	12.95	0.58	0.42	0.29	146.09	0.79	0.01	0.02	0.02	5664

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 4 , 2006
Report Printed on 10-05-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.98	0.19	10.99	0.33	148.42	0.26	0.00	0.56	0.15	5995
7:00 to 8:00	12.98	0.66	0.01	0.30	158.83	0.90	0.02	0.00	0.15	5805
8:00 to 9:00	13.13	0.42	0.00	0.24	157.86	0.58	0.01	0.00	0.15	5182
9:00 to 10:00	13.14	0.73	0.00	0.14	157.68	1.03	0.01	0.00	0.00	3888
10:00 to 11:00	13.00	1.22	0.00	0.33	158.89	1.68	0.03	0.00	0.00	6060
11:00 to 12:00	13.15	0.96	0.00	0.13	158.19	1.35	0.02	0.00	0.00	3776
12:00 to 13:00	13.18	0.76	0.00	0.12	158.28	1.07	0.01	0.00	0.00	3594
13:00 to 14:00	13.02	1.01	0.00	0.20	158.93	1.39	0.02	0.00	0.00	4728
14:00 to 15:00	13.08	0.74	0.00	0.27	158.12	1.02	0.02	0.00	0.00	5445
15:00 to 16:00	13.21	1.45	0.00	0.27	157.99	2.05	0.03	0.00	0.00	5502
16:00 to 17:00	13.12	0.55	0.00	0.31	158.31	0.77	0.01	0.00	0.00	5868
17:00 to 18:00	13.19	0.49	0.00	0.32	157.91	0.69	0.01	0.00	0.00	5942
18:00 to 19:00	13.18	0.65	0.00	0.31	157.88	0.91	0.02	0.00	0.00	5908
19:00 to 20:00	13.22	1.03	0.00	0.29	159.07	1.46	0.02	0.00	0.00	5758
20:00 to 21:00	13.24	0.80	0.00	0.35	158.25	1.13	0.02	0.00	0.00	6231
21:00 to 22:00	13.38	0.76	0.00	0.32	158.05	1.10	0.02	0.00	0.00	5913
22:00 to 23:00	13.24	0.59	0.00	0.35	158.39	0.84	0.01	0.00	0.00	6235
23:00 to 24:00	13.30	0.83	0.00	0.38	158.15	1.18	0.02	0.00	0.00	6528
0:00 to 1:00	13.21	0.72	0.00	0.42	158.19	1.01	0.02	0.00	0.00	6835
1:00 to 2:00	13.22	0.83	0.00	0.34	158.64	1.17	0.02	0.00	0.00	6074
2:00 to 3:00	13.14	0.43	0.00	0.28	158.35	0.60	0.01	0.00	0.00	5621
3:00 to 4:00	13.11	0.56	0.00	0.34	158.06	0.78	0.01	0.00	0.00	6185
4:00 to 5:00	13.05	0.60	0.00	0.36	158.46	0.83	0.01	0.00	0.00	6299
5:00 to 6:00	13.22	0.83	0.00	0.24	158.18	1.18	0.01	0.00	0.00	5017
Averages										
6:00 to 18:00	13.10	0.76	0.92	0.25	157.45	1.06	0.02	0.05	0.04	5149
18:00 to 6:00	13.21	0.72	0.00	0.33	158.31	1.01	0.02	0.00	0.00	6050
6:00 to 6:00	13.15	0.74	0.46	0.29	157.88	1.04	0.02	0.02	0.02	5600

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 5 , 2006
Report Printed on 10-06-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.16	0.50	10.15	0.31	158.06	0.70	0.01	0.53	0.15	5517
7:00 to 8:00	13.13	0.34	0.05	0.18	157.65	0.47	0.00	0.00	0.15	4275
8:00 to 9:00	12.96	0.84	0.00	0.32	157.18	1.15	0.02	0.00	0.15	6004
9:00 to 10:00	13.03	0.37	0.00	0.30	157.29	0.51	0.01	0.00	0.00	5724
10:00 to 11:00	13.03	0.74	0.00	0.21	157.50	1.02	0.01	0.00	0.00	4624
11:00 to 12:00	13.05	0.70	0.00	0.30	157.65	0.97	0.02	0.00	0.00	5764
12:00 to 13:00	13.12	1.34	0.00	0.30	157.19	1.87	0.03	0.00	0.00	5767
13:00 to 14:00	13.22	0.31	0.00	0.28	157.47	0.44	0.01	0.00	0.00	5588
14:00 to 15:00	13.24	0.86	0.00	0.29	157.23	1.22	0.02	0.00	0.00	5657
15:00 to 16:00	13.20	0.53	0.00	0.27	156.97	0.75	0.01	0.00	0.00	5455
16:00 to 17:00	13.21	0.53	0.00	0.27	157.80	0.75	0.01	0.00	0.00	5502
17:00 to 18:00	13.29	0.72	0.00	0.25	156.84	1.02	0.02	0.00	0.00	5312
18:00 to 19:00	13.31	0.42	0.00	0.25	156.61	0.60	0.01	0.00	0.00	5291
19:00 to 20:00	13.24	0.53	0.00	0.26	157.63	0.75	0.01	0.00	0.00	5414
20:00 to 21:00	13.08	0.55	0.00	0.26	157.37	0.76	0.01	0.00	0.00	5422
21:00 to 22:00	13.21	0.30	0.00	0.26	157.37	0.43	0.01	0.00	0.00	5358
22:00 to 23:00	13.14	0.59	0.00	0.26	157.70	0.82	0.01	0.00	0.00	5404
23:00 to 24:00	13.14	0.45	0.00	0.27	157.42	0.63	0.01	0.00	0.00	5519
0:00 to 1:00	13.23	0.90	0.00	0.27	157.25	1.27	0.02	0.00	0.00	5508
1:00 to 2:00	13.06	0.27	0.00	0.25	157.45	0.37	0.01	0.00	0.00	5321
2 3:00	13.14	0.54	0.00	0.36	157.25	0.76	0.01	0.00	0.00	6369
3:00 to 4:00	13.22	0.43	0.00	0.31	156.84	0.61	0.01	0.00	0.00	5887
4:00 to 5:00	13.09	0.47	0.00	0.34	157.65	0.65	0.01	0.00	0.00	6118
5:00 to 6:00	13.18	0.78	0.00	0.27	157.18	1.10	0.02	0.00	0.00	5502
Averages										
6:00 to 18:00	13.14	0.65	0.85	0.27	157.40	0.91	0.01	0.04	0.04	5432
18:00 to 6:00	13.17	0.52	0.00	0.28	157.31	0.73	0.01	0.00	0.00	5593
6:00 to 6:00	13.15	0.58	0.42	0.28	157.36	0.82	0.01	0.02	0.02	5513

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 6 , 2006
Report Printed on 10-07-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.03	0.43	10.56	0.34	157.78	0.59	0.01	0.53	0.14	6159
7:00 to 8:00	13.14	0.77	0.07	0.33	158.12	1.08	0.02	0.00	0.15	6010
8:00 to 9:00	13.04	0.40	0.00	0.29	157.31	0.55	0.01	0.00	0.15	5650
9:00 to 10:00	13.02	0.40	0.00	0.28	157.09	0.56	0.01	0.00	0.00	5617
10:00 to 11:00	13.05	0.15	0.00	0.28	157.33	0.21	0.00	0.00	0.00	5626
11:00 to 12:00	13.02	0.91	0.00	0.29	157.30	1.25	0.02	0.00	0.00	5740
12:00 to 13:00	12.98	0.46	0.00	0.30	157.33	0.63	0.01	0.00	0.00	5790
13:00 to 14:00	13.21	0.55	5.67	0.30	157.82	0.78	0.01	0.24	0.07	5774
14:00 to 15:00	13.24	0.95	0.00	0.30	157.58	1.35	0.02	0.00	0.07	5764
15:00 to 16:00	13.25	0.49	0.00	0.27	156.68	0.70	0.01	0.00	0.07	5453
16:00 to 17:00	13.16	0.41	0.00	0.26	157.16	0.58	0.01	0.00	0.00	5390
17:00 to 18:00	13.27	0.41	0.00	0.26	156.54	0.58	0.01	0.00	0.00	5371
18:00 to 19:00	13.22	0.49	0.00	0.25	156.76	0.69	0.01	0.00	0.00	5331
19:00 to 20:00	13.36	0.77	0.00	0.26	157.38	1.12	0.02	0.00	0.00	5355
20:00 to 21:00	13.24	0.10	0.00	0.26	156.69	0.14	0.00	0.00	0.00	5388
21:00 to 22:00	13.26	0.58	0.00	0.26	156.60	0.83	0.01	0.00	0.00	5359
22:00 to 23:00	13.27	0.78	0.00	0.27	157.48	1.11	0.02	0.00	0.00	5454
23:00 to 24:00	13.11	0.34	0.00	0.26	156.86	0.47	0.01	0.00	0.00	5366
0:00 to 1:00	13.19	0.24	0.00	0.27	156.75	0.34	0.01	0.00	0.00	5488
1:^^ to 2:00	13.26	0.58	0.00	0.27	157.41	0.82	0.01	0.00	0.00	5506
[illegible] 3:00	13.20	0.12	0.00	0.27	156.81	0.16	0.00	0.00	0.00	5509
3:00 to 4:00	13.21	0.31	0.00	0.27	156.99	0.44	0.01	0.00	0.00	5516
4:00 to 5:00	13.25	0.07	0.00	0.24	156.91	0.10	0.00	0.00	0.00	5171
5:00 to 6:00	13.20	0.09	0.00	0.26	156.57	0.13	0.00	0.00	0.00	5365
Averages										
6:00 to 18:00	13.12	0.53	1.36	0.29	157.34	0.74	0.01	0.06	0.05	5695
18:00 to 6:00	13.23	0.37	0.00	0.26	156.93	0.53	0.01	0.00	0.00	5401
6:00 to 6:00	13.17	0.45	0.68	0.28	157.14	0.63	0.01	0.03	0.03	5548

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 7 , 2006
Report Printed on 10-08-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.95	0.68	10.58	0.28	152.88	0.93	0.02	0.44	0.12	5617
7:00 to 8:00	13.22	0.76	0.02	0.27	147.39	1.08	0.02	0.00	0.12	5480
8:00 to 9:00	13.21	0.72	0.00	0.26	146.92	1.02	0.02	0.00	0.12	5421
9:00 to 10:00	13.22	0.63	0.00	0.28	147.10	0.89	0.01	0.00	0.00	5567
10:00 to 11:00	13.16	0.44	0.00	0.28	147.96	0.62	0.01	0.00	0.00	5581
11:00 to 12:00	13.27	0.57	0.00	0.29	147.20	0.82	0.01	0.00	0.00	5654
12:00 to 13:00	13.35	0.70	0.00	0.28	146.82	1.01	0.02	0.00	0.00	5559
13:00 to 14:00	13.34	0.90	0.00	0.30	147.62	1.29	0.02	0.00	0.00	5743
14:00 to 15:00	13.44	0.83	0.00	0.16	147.03	1.20	0.01	0.00	0.00	4017
15:00 to 16:00	13.25	0.45	0.00	0.34	146.92	0.63	0.01	0.00	0.00	6060
16:00 to 17:00	13.28	0.91	0.00	0.33	147.64	1.30	0.02	0.00	0.00	6038
17:00 to 18:00	13.35	0.56	0.00	0.27	146.84	0.81	0.01	0.00	0.00	5442
18:00 to 19:00	13.21	0.43	0.00	0.37	147.06	0.60	0.01	0.00	0.00	6393
19:00 to 20:00	13.33	0.14	0.00	0.31	147.40	0.21	0.00	0.00	0.00	5838
20:00 to 21:00	13.41	0.42	0.00	0.27	146.98	0.60	0.01	0.00	0.00	5491
21:00 to 22:00	13.33	0.44	0.00	0.28	147.04	0.63	0.01	0.00	0.00	5592
22:00 to 23:00	13.21	0.59	0.00	0.31	147.54	0.84	0.02	0.00	0.00	5887
23:00 to 24:00	13.21	0.72	0.00	0.30	146.97	1.01	0.02	0.00	0.00	5732
0:00 to 1:00	13.27	0.20	0.00	0.37	146.84	0.29	0.01	0.00	0.00	6400
1:00 to 2:00	13.13	0.30	0.00	0.31	147.32	0.42	0.01	0.00	0.00	5841
2:00 to 3:00	13.22	0.26	0.00	0.27	146.66	0.37	0.01	0.00	0.00	5450
3:00 to 4:00	13.04	0.74	0.00	0.32	147.13	1.03	0.02	0.00	0.00	5990
4:00 to 5:00	13.11	0.51	0.00	0.32	147.26	0.71	0.01	0.00	0.00	5937
5:00 to 6:00	13.14	0.56	0.00	0.28	146.91	0.78	0.01	0.00	0.00	5597
Averages										
6:00 to 18:00	13.25	0.68	0.88	0.28	147.69	0.96	0.02	0.04	0.03	5515
18:00 to 6:00	13.22	0.44	0.00	0.31	147.09	0.63	0.01	0.00	0.00	5846
6:00 to 6:00	13.24	0.56	0.44	0.29	147.39	0.80	0.01	0.02	0.02	5680

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 8 , 2006
Report Printed on 10-09-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.89	0.10	9.55	0.29	147.34	0.14	0.00	0.42	0.11	5670
7:00 to 8:00	13.10	0.18	0.08	0.18	158.07	0.25	0.00	0.00	0.12	4236
8:00 to 9:00	12.92	0.43	0.00	0.29	157.00	0.58	0.01	0.00	0.12	5670
9:00 to 10:00	12.90	0.71	0.00	0.29	157.13	0.96	0.02	0.00	0.00	5736
10:00 to 11:00	12.81	0.69	0.00	0.29	157.85	0.93	0.02	0.00	0.00	5727
11:00 to 12:00	12.88	0.84	0.00	0.29	157.22	1.14	0.02	0.00	0.00	5646
12:00 to 13:00	12.92	1.00	0.00	0.28	157.00	1.36	0.02	0.00	0.00	5580
13:00 to 14:00	12.95	0.67	0.00	0.29	157.57	0.92	0.02	0.00	0.00	5645
14:00 to 15:00	12.97	0.59	0.00	0.29	157.19	0.81	0.01	0.00	0.00	5684
15:00 to 16:00	13.07	0.89	0.00	0.13	157.04	1.23	0.01	0.00	0.00	3833
16:00 to 17:00	13.05	0.22	0.00	0.19	157.43	0.30	0.00	0.00	0.00	4579
17:00 to 18:00	12.93	0.44	0.00	0.27	157.57	0.60	0.01	0.00	0.00	5501
18:00 to 19:00	13.00	0.72	0.00	0.32	156.98	0.99	0.02	0.00	0.00	5962
19:00 to 20:00	12.99	0.78	0.00	0.36	158.15	1.07	0.02	0.00	0.00	6281
20:00 to 21:00	12.96	0.77	0.00	0.35	157.67	1.06	0.02	0.00	0.00	6202
21:00 to 22:00	13.02	0.99	0.00	0.38	157.07	1.36	0.03	0.00	0.00	6496
22:00 to 23:00	13.11	0.53	0.00	0.34	157.93	0.74	0.01	0.00	0.00	6132
23:00 to 24:00	13.11	0.58	0.00	0.28	157.23	0.81	0.01	0.00	0.00	5581
0:00 to 1:00	12.92	0.98	0.00	0.34	157.47	1.34	0.02	0.00	0.00	6169
1:00 to 2:00	12.98	0.41	0.00	0.36	158.04	0.56	0.01	0.00	0.00	6338
[illegible] 3:00	12.96	0.46	0.00	0.40	157.15	0.63	0.01	0.00	0.00	6712
3:00 to 4:00	12.91	0.95	0.00	0.40	157.14	1.29	0.03	0.00	0.00	6695
4:00 to 5:00	12.76	0.81	0.00	0.37	157.72	1.08	0.02	0.00	0.00	6390
5:00 to 6:00	12.94	0.10	0.00	0.27	156.84	0.14	0.00	0.00	0.00	5473
Averages										
6:00 to 18:00	12.95	0.56	0.80	0.26	156.53	0.77	0.01	0.04	0.03	5292
18:00 to 6:00	12.97	0.67	0.00	0.35	157.45	0.92	0.02	0.00	0.00	6203
6:00 to 6:00	12.96	0.62	0.40	0.30	156.99	0.85	0.01	0.02	0.01	5747

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 9 , 2006
Report Printed on 10-10-2006 at 06:00:02

eriod	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.95	0.30	9.25	0.28	157.53	0.41	0.01	0.41	0.11	5433
7:00 to 8:00	12.88	0.57	0.10	0.37	157.91	0.77	0.01	0.00	0.11	6382
8:00 to 9:00	12.84	0.69	0.00	0.28	155.83	0.93	0.02	0.00	0.11	5630
9:00 to 10:00	12.90	1.23	0.00	0.36	155.94	1.67	0.03	0.00	0.00	6330
.0:00 to 11:00	12.96	0.94	0.00	0.21	155.95	1.29	0.02	0.00	0.00	4786
.1:00 to 12:00	12.97	1.04	0.00	0.29	155.65	1.42	0.02	0.00	0.00	5731
.2:00 to 13:00	13.03	0.59	0.00	0.29	155.53	0.81	0.01	0.00	0.00	5725
13:00 to 14:00	13.11	0.14	0.00	0.28	155.82	0.19	0.00	0.00	0.00	5626
14:00 to 15:00	13.18	0.46	0.00	0.29	155.94	0.65	0.01	0.00	0.00	5685
15:00 to 16:00	13.33	1.07	0.00	0.29	155.51	1.54	0.02	0.00	0.00	5717
16:00 to 17:00	13.30	0.61	0.00	0.28	156.16	0.87	0.01	0.00	0.00	5618
17:00 to 18:00	13.25	0.72	0.00	0.28	155.74	1.02	0.02	0.00	0.00	5635
18:00 to 19:00	13.26	0.65	0.00	0.38	155.51	0.92	0.02	0.00	0.00	6513
19:00 to 20:00	13.23	1.42	0.00	0.34	156.33	2.01	0.03	0.00	0.00	6174
20:00 to 21:00	13.22	0.44	0.00	0.38	155.75	0.62	0.01	0.00	0.00	6472
21:00 to 22:00	13.16	0.55	0.00	0.33	155.51	0.77	0.01	0.00	0.00	6107
22:00 to 23:00	13.29	0.43	0.00	0.35	156.01	0.62	0.01	0.00	0.00	6248
23:00 to 24:00	13.27	0.66	0.00	0.28	155.52	0.95	0.02	0.00	0.00	5644
0:00 to 1:00	13.30	0.69	0.00	0.28	154.98	0.98	0.02	0.00	0.00	5568
1:00 to 2:00	13.24	0.52	0.00	0.31	155.29	0.74	0.01	0.00	0.00	5857
[illegible] 3:00	13.20	0.82	0.00	0.30	155.44	1.16	0.02	0.00	0.00	5820
3:00 to 4:00	13.10	1.19	0.00	0.45	155.19	1.65	0.03	0.00	0.00	7090
4:00 to 5:00	13.15	0.59	0.00	0.31	155.53	0.82	0.01	0.00	0.00	5919
5:00 to 6:00	13.14	0.23	0.00	0.31	155.31	0.32	0.01	0.00	0.00	5852
Averages										
6:00 to 18:00	13.06	0.70	0.78	0.29	156.13	0.96	0.02	0.03	0.03	5691
18:00 to 6:00	13.21	0.68	0.00	0.34	155.53	0.96	0.02	0.00	0.00	6105
6:00 to 6:00	13.14	0.69	0.39	0.31	155.83	0.96	0.02	0.02	0.01	5898

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 10 , 2006
Report Printed on 10-11-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.08	0.63	8.83	0.26	156.56	0.88	0.01	0.39	0.11	5068
7:00 to 8:00	13.10	0.27	0.09	0.28	157.80	0.37	0.01	0.00	0.11	5619
8:00 to 9:00	13.14	0.49	0.00	0.36	157.44	0.68	0.01	0.00	0.11	6299
9:00 to 10:00	13.08	0.70	0.00	0.38	157.79	0.97	0.02	0.00	0.00	6505
10:00 to 11:00	13.05	1.00	0.00	0.30	157.94	1.39	0.02	0.00	0.00	5776
11:00 to 12:00	13.09	0.41	0.00	0.29	157.72	0.57	0.01	0.00	0.00	5712
12:00 to 13:00	13.13	0.65	0.00	0.30	157.82	0.90	0.01	0.00	0.00	5761
13:00 to 14:00	13.16	0.37	0.00	0.20	157.95	0.52	0.01	0.00	0.00	4620
14:00 to 15:00	13.14	0.72	0.00	0.30	157.75	1.01	0.02	0.00	0.00	5743
15:00 to 16:00	13.28	0.43	0.00	0.28	157.10	0.62	0.01	0.00	0.00	5561
16:00 to 17:00	13.35	0.51	0.00	0.27	157.63	0.73	0.01	0.00	0.00	5516
17:00 to 18:00	13.37	0.62	0.00	0.27	156.91	0.90	0.01	0.00	0.00	5540
18:00 to 19:00	13.25	0.54	0.00	0.33	156.98	0.77	0.01	0.00	0.00	6026
19:00 to 20:00	13.35	0.11	0.00	0.34	157.33	0.16	0.00	0.00	0.00	6105
20:00 to 21:00	13.33	0.59	0.00	0.27	156.89	0.84	0.01	0.00	0.00	5450
21:00 to 22:00	13.38	0.79	0.00	0.30	157.29	1.14	0.02	0.00	0.00	5800
22:00 to 23:00	13.33	0.50	0.00	0.34	157.37	0.72	0.01	0.00	0.00	6096
23:00 to 24:00	13.27	0.37	0.00	0.27	156.97	0.52	0.01	0.00	0.00	5532
0:00 to 1:00	13.32	0.25	0.00	0.37	157.12	0.36	0.01	0.00	0.00	6396
1:[illegible] to 2:00	13.16	0.54	0.00	0.32	157.71	0.76	0.01	0.00	0.00	5954
2[illegible] 3:00	13.20	0.75	0.00	0.37	157.14	1.06	0.02	0.00	0.00	6468
3:00 to 4:00	13.19	0.22	0.00	0.35	156.71	0.31	0.01	0.00	0.00	6266
4:00 to 5:00	13.24	0.45	0.00	0.31	157.50	0.64	0.01	0.00	0.00	5915
5:00 to 6:00	13.24	0.33	0.00	0.26	156.64	0.47	0.01	0.00	0.00	5436
Averages										
6:00 to 18:00	13.17	0.57	0.74	0.29	157.53	0.80	0.01	0.03	0.03	5643
18:00 to 6:00	13.27	0.45	0.00	0.32	157.14	0.65	0.01	0.00	0.00	5954
6:00 to 6:00	13.22	0.51	0.37	0.31	157.34	0.72	0.01	0.02	0.01	5798

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 11 , 2006
Report Printed on 10-12-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.04	0.41	9.21	0.27	157.58	0.56	0.01	0.40	0.11	5512
7:00 to 8:00	13.15	0.53	0.07	0.35	157.47	0.74	0.01	0.00	0.11	6242
8:00 to 9:00	13.07	1.29	0.00	0.30	155.52	1.78	0.03	0.00	0.11	5773
9:00 to 10:00	12.92	0.81	0.00	0.38	155.02	1.11	0.02	0.00	0.00	6510
10:00 to 11:00	13.11	0.51	0.00	0.26	155.39	0.71	0.01	0.00	0.00	5348
11:00 to 12:00	13.05	0.31	0.00	0.29	155.18	0.43	0.01	0.00	0.00	5714
12:00 to 13:00	13.09	0.99	0.00	0.29	154.81	1.38	0.02	0.00	0.00	5662
13:00 to 14:00	13.05	0.48	0.00	0.30	155.92	0.67	0.01	0.00	0.00	5772
14:00 to 15:00	13.17	0.53	0.00	0.29	155.01	0.74	0.01	0.00	0.00	5681
15:00 to 16:00	12.93	1.14	0.03	0.35	155.09	1.56	0.02	0.00	0.00	6262
16:00 to 17:00	21.53 D	8.19 D	0.01 D	0.19	105.21	900.78 D	0.00	0.00	0.00	4594
17:00 to 18:00	19.87 D	0.15 D	0.14 D	0.11	81.53	1.41 D	0.00	0.00	0.00	3559
18:00 to 19:00	14.91 D	2.87 D	0.12 D	0.18	136.03	5.18 D	0.00	0.00	0.00	4482
19:00 to 20:00	14.96 D	0.31 D	0.00 D	0.20	143.23	0.57 D	0.00	0.00	0.00	4705
20:00 to 21:00	14.99 D	0.10 D	0.00 D	0.21	144.40	0.18 D	0.00	0.00	0.00	4809
21:00 to 22:00	14.47	0.04	0.00	0.21	145.68	0.07	0.00	0.00	0.00	4890
22:00 to 23:00	14.45	0.13	0.00	0.27	152.22	0.21	0.00	0.00	0.00	5470
23:00 to 24:00	13.80	0.11	0.00	0.28	155.16	0.17	0.00	0.00	0.00	5635
0:00 to 1:00	14.02	0.11	0.00	0.29	154.91	0.17	0.00	0.00	0.00	5710
1:00 to 2:00	14.12	0.10	0.00	0.30	154.74	0.17	0.00	0.00	0.00	5778
2 3:00	14.37	0.14	0.00	0.30	153.72	0.23	0.00	0.00	0.00	5814
3:00 to 4:00	14.40	0.15	0.00	0.30	153.29	0.25	0.00	0.00	0.00	5858
4:00 to 5:00	14.01	0.08	0.00	0.29	154.25	0.12	0.00	0.00	0.00	5720
5:00 to 6:00	13.26	0.52	0.00	0.31	157.08	0.74	0.01	0.00	0.00	5863
Averages										
6:00 to 18:00	13.06	0.70	0.93	0.28	145.31	0.81	0.01	0.03	0.03	5552
18:00 to 6:00	14.10	0.15	0.00	0.26	150.39	0.18	0.00	0.00	0.00	5394
6:00 to 6:00	13.55	0.44	0.49	0.27	147.85	0.52	0.01	0.02	0.01	5473

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 12 , 2006
Report Printed on 10-13-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.68	0.12	9.56	0.31	156.28	0.18	0.00	0.42	0.11	5844
7:00 to 8:00	14.02	0.07	0.07	0.29	156.11	0.11	0.00	0.00	0.11	5730
8:00 to 9:00	13.80	0.07	0.00	0.31	156.51	0.11	0.00	0.00	0.11	5891
9:00 to 10:00	13.93	0.08	0.00	0.30	155.78	0.12	0.00	0.00	0.00	5774
10:00 to 11:00	14.10	0.08	0.00	0.29	155.77	0.13	0.00	0.00	0.00	5737
11:00 to 12:00	14.22	0.13	0.00	0.30	154.46	0.20	0.00	0.00	0.00	5801
12:00 to 13:00	13.94	0.12	0.00	0.30	154.86	0.19	0.00	0.00	0.00	5808
13:00 to 14:00	13.69	0.35	0.01	0.30	156.71	0.53	0.01	0.00	0.00	5804
14:00 to 15:00	13.38	0.11	0.02	0.30	158.00	0.15	0.00	0.00	0.00	5835
15:00 to 16:00	13.44	0.25	0.06	0.30	157.29	0.36	0.01	0.00	0.00	5812
16:00 to 17:00	13.35	0.37	0.12	0.29	158.82	0.54	0.01	0.01	0.00	5771
17:00 to 18:00	13.25	0.19	0.16	0.28	158.77	0.26	0.00	0.01	0.00	5634
18:00 to 19:00	13.08	0.53	0.13	0.29	158.43	0.74	0.01	0.01	0.01	5690
19:00 to 20:00	13.12	1.16	0.11	0.30	158.86	1.61	0.03	0.00	0.01	5756
20:00 to 21:00	13.16	0.48	0.11	0.29	158.30	0.67	0.01	0.00	0.00	5660
21:00 to 22:00	13.25	0.29	0.08	0.29	158.03	0.41	0.01	0.00	0.00	5682
22:00 to 23:00	13.20	0.41	0.07	0.29	158.80	0.58	0.01	0.00	0.00	5752
23:00 to 24:00	13.31	0.42	0.08	0.29	158.01	0.60	0.01	0.00	0.00	5653
0:00 to 1:00	13.24	0.72	0.10	0.29	158.01	1.02	0.02	0.00	0.00	5717
1:00 to 2:00	13.21	0.12	0.12	0.28	158.25	0.17	0.00	0.00	0.00	5625
2 3:00	13.20	0.09	0.09	0.29	157.95	0.13	0.00	0.00	0.00	5694
3:00 to 4:00	13.31	0.11	0.07	0.28	158.09	0.15	0.00	0.00	0.00	5596
4:00 to 5:00	13.52	0.20	0.05	0.29	158.09	0.30	0.00	0.00	0.00	5662
5:00 to 6:00	13.57	0.10	0.05	0.29	157.33	0.15	0.00	0.00	0.00	5649
Averages										
6:00 to 18:00	13.73	0.16	0.83	0.30	156.61	0.24	0.00	0.04	0.03	5787
18:00 to 6:00	13.26	0.39	0.09	0.29	158.18	0.55	0.01	0.00	0.00	5678
6:00 to 6:00	13.50	0.27	0.46	0.29	157.40	0.40	0.01	0.02	0.02	5732

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 13 , 2006
Report Printed on 10-14-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.63	0.20	10.20	0.28	157.32	0.30	0.00	0.43	0.12	5600
7:00 to 8:00	13.41	0.35	0.04	0.28	157.97	0.51	0.01	0.00	0.12	5617
8:00 to 9:00	13.38	0.11	0.00	0.28	157.15	0.16	0.00	0.00	0.12	5579
9:00 to 10:00	13.36	0.07	0.00	0.27	156.91	0.10	0.00	0.00	0.00	5541
10:00 to 11:00	13.28	0.09	0.00	0.28	157.56	0.13	0.00	0.00	0.00	5588
11:00 to 12:00	13.14	0.19	0.00	0.29	157.70	0.26	0.00	0.00	0.00	5738
12:00 to 13:00	13.08	0.45	0.00	0.29	158.19	0.63	0.01	0.00	0.00	5717
13:00 to 14:00	13.14	0.41	0.00	0.30	158.65	0.57	0.01	0.00	0.00	5825
14:00 to 15:00	13.22	0.39	0.00	0.30	158.19	0.56	0.01	0.00	0.00	5829
15:00 to 16:00	13.14	0.67	0.00	0.30	158.41	0.93	0.02	0.00	0.00	5740
16:00 to 17:00	13.08	0.27	0.00	0.27	158.29	0.37	0.01	0.00	0.00	5485
17:00 to 18:00	12.89	0.88	0.00	0.29	158.74	1.20	0.02	0.00	0.00	5674
18:00 to 19:00	13.10	0.50	0.00	0.35	158.44	0.69	0.01	0.00	0.00	6196
19:00 to 20:00	13.02	0.78	0.00	0.33	159.24	1.07	0.02	0.00	0.00	6047
20:00 to 21:00	12.94	0.50	0.00	0.28	158.56	0.68	0.01	0.00	0.00	5581
21:00 to 22:00	13.05	0.24	0.00	0.38	158.25	0.33	0.01	0.00	0.00	6543
22:00 to 23:00	13.09	0.13	0.00	0.34	158.64	0.18	0.00	0.00	0.00	6152
23:00 to 24:00	13.04	0.32	0.00	0.29	158.40	0.44	0.01	0.00	0.00	5691
0:00 to 1:00	13.06	0.38	0.00	0.40	158.39	0.53	0.01	0.00	0.00	6655
1:[illegible] to 2:00	13.03	0.22	0.00	0.34	158.65	0.30	0.01	0.00	0.00	6133
2:[illegible] to 3:00	12.94	0.75	0.00	0.38	158.74	1.02	0.02	0.00	0.00	6444
3:00 to 4:00	13.04	0.24	0.00	0.37	158.31	0.33	0.01	0.00	0.00	6368
4:00 to 5:00	12.80	0.78	0.00	0.39	159.14	1.05	0.02	0.00	0.00	6591
5:00 to 6:00	12.82	0.20	0.00	0.38	158.74	0.28	0.01	0.00	0.00	6476
Averages										
6:00 to 18:00	13.23	0.34	0.85	0.29	157.92	0.48	0.01	0.04	0.03	5661
18:00 to 6:00	13.00	0.42	0.00	0.35	158.62	0.58	0.01	0.00	0.00	6240
6:00 to 6:00	13.11	0.38	0.43	0.32	158.27	0.53	0.01	0.02	0.01	5950

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 14 , 2006
Report Printed on 10-25-2006 at 09:47:08

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.10	0.21	10.18	0.26	158.95	0.29	0.00	0.46	0.13	5315
7:00 to 8:00	12.83	0.75	0.05	0.32	159.73	1.01	0.02	0.00	0.13	6086
8:00 to 9:00	12.83	0.58	0.00	0.39	159.31	0.78	0.02	0.00	0.13	6583
9:00 to 10:00	12.88	0.83	0.00	0.34	159.28	1.13	0.02	0.00	0.00	6082
10:00 to 11:00	12.71	0.92	0.00	0.19	160.21	1.22	0.01	0.00	0.00	4339
11:00 to 12:00	12.82	0.82	0.00	0.30	159.13	1.10	0.02	0.00	0.00	5749
12:00 to 13:00	12.79	0.67	0.00	0.31	159.48	0.90	0.02	0.00	0.00	5853
13:00 to 14:00	12.82	0.27	0.00	0.29	159.65	0.36	0.01	0.00	0.00	5758
14:00 to 15:00	12.81	0.20	0.00	0.30	159.32	0.27	0.00	0.00	0.00	5738
15:00 to 16:00	12.99	0.37	0.00	0.20	158.74	0.51	0.01	0.00	0.00	4571
16:00 to 17:00	12.86	0.67	0.00	0.23	159.38	0.91	0.01	0.00	0.00	5139
17:00 to 18:00	12.78	0.67	0.00	0.29	159.21	0.90	0.02	0.00	0.00	5719
18:00 to 19:00	13.10	1.03	0.00	0.25	158.81	1.44	0.02	0.00	0.00	5256
19:00 to 20:00	13.00	0.82	0.00	0.28	159.13	1.13	0.02	0.00	0.00	5603
20:00 to 21:00	13.18	0.80	0.00	0.28	158.33	1.13	0.02	0.00	0.00	5632
21:00 to 22:00	12.96	0.73	0.00	0.37	158.55	0.99	0.02	0.00	0.00	6409
22:00 to 23:00	13.03	1.04	0.00	0.40	159.09	1.44	0.03	0.00	0.00	6611
23:00 to 24:00	13.06	0.63	0.00	0.38	158.39	0.87	0.02	0.00	0.00	6538
0:00 to 1:00	13.08	0.37	0.00	0.31	158.24	0.51	0.01	0.00	0.00	5845
1:00 to 2:00	13.08	0.05	0.00	0.30	158.59	0.06	0.00	0.00	0.00	5756
[illegible] 3:00	12.88	1.19	0.00	0.41	158.45	1.62	0.03	0.00	0.00	6716
3:00 to 4:00	13.02	0.19	0.00	0.44	157.78	0.26	0.01	0.00	0.00	6992
4:00 to 5:00	13.06	0.40	0.00	0.39	159.11	0.55	0.01	0.00	0.00	6595
5:00 to 6:00	12.99	0.53	0.00	0.38	158.55	0.73	0.01	0.00	0.00	6474
Averages										
6:00 to 18:00	12.85	0.58	0.85	0.29	159.37	0.78	0.01	0.04	0.03	5578
18:00 to 6:00	13.04	0.65	0.00	0.35	158.59	0.90	0.02	0.00	0.00	6202
6:00 to 6:00	12.94	0.61	0.43	0.32	158.98	0.84	0.01	0.02	0.02	5890

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 16 , 2006
Report Printed on 10-17-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.99	1.33	10.11	0.20	158.70	1.83	0.02	0.42	0.12	4293
7:00 to 8:00	12.96	0.73	0.00	0.21	159.34	1.00	0.01	0.00	0.12	4744
8:00 to 9:00	12.90	0.95	0.00	0.44	158.44	1.29	0.03	0.00	0.12	6983
9:00 to 10:00	12.98	1.48	0.00	0.33	158.51	2.03	0.04	0.00	0.00	6047
10:00 to 11:00	8.15 C	3.98 C	0.50 C	0.20	158.88	3.41 C	0.05 C	0.01 C	0.00 I	4527
11:00 to 12:00	12.97	1.08	3.43	0.33	158.64	1.47	0.03	0.15	0.10 I	6084
12:00 to 13:00	13.07	0.74	0.02	0.36	158.19	1.03	0.02	0.00	0.07 I	6332
13:00 to 14:00	13.10	0.19	0.00	0.40	158.95	0.26	0.00	0.00	0.05	6651
14:00 to 15:00	13.20	0.52	0.00	0.29	158.10	0.73	0.01	0.00	0.00	5671
15:00 to 16:00	13.20	0.43	0.00	0.35	158.08	0.61	0.01	0.00	0.00	6241
16:00 to 17:00	13.09	0.94	0.00	0.37	159.03	1.31	0.03	0.00	0.00	6377
17:00 to 18:00	13.22	0.49	0.00	0.34	158.15	0.70	0.01	0.00	0.00	6123
18:00 to 19:00	13.08	0.21	0.00	0.40	158.33	0.29	0.01	0.00	0.00	6630
19:00 to 20:00	13.18	0.42	0.00	0.37	158.98	0.60	0.01	0.00	0.00	6403
20:00 to 21:00	13.20	0.45	0.00	0.29	158.32	0.63	0.01	0.00	0.00	5713
21:00 to 22:00	13.06	1.23	0.00	0.41	158.52	1.70	0.03	0.00	0.00	6770
22:00 to 23:00	13.27	0.71	0.00	0.34	158.89	1.01	0.02	0.00	0.00	6125
23:00 to 24:00	13.40	0.32	0.00	0.28	158.14	0.46	0.01	0.00	0.00	5630
0:00 to 1:00	13.21	0.19	0.00	0.30	158.19	0.27	0.00	0.00	0.00	5775
1:00 to 2:00	13.19	0.36	0.00	0.33	158.67	0.51	0.01	0.00	0.00	6023
2:00 to 3:00	13.16	0.68	0.00	0.30	158.43	0.95	0.02	0.00	0.00	5795
3:00 to 4:00	13.11	0.23	0.00	0.41	158.52	0.33	0.01	0.00	0.00	6769
4:00 to 5:00	13.14	0.71	0.00	0.36	159.30	0.99	0.02	0.00	0.00	6315
5:00 to 6:00	13.11	0.76	0.00	0.38	158.80	1.06	0.02	0.00	0.00	6508
Averages										
6:00 to 18:00	13.06	0.81	1.23	0.32	158.58	1.12	0.02	0.05	0.05	5839
18:00 to 6:00	13.18	0.52	0.00	0.35	158.59	0.73	0.01	0.00	0.00	6205
6:00 to 6:00	13.12	0.66	0.59	0.33	158.59	0.92	0.02	0.02	0.02	6022

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 16 , 2006
Report Printed on 10-17-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.99	1.33	10.11	0.20	158.70	1.83	0.02	0.42	0.12	4293
7:00 to 8:00	12.96	0.73	0.00	0.21	159.34	1.00	0.01	0.00	0.12	4744
8:00 to 9:00	12.90	0.95	0.00	0.44	158.44	1.29	0.03	0.00	0.12	6983
9:00 to 10:00	12.98	1.48	0.00	0.33	158.51	2.03	0.04	0.00	0.00	6047
10:00 to 11:00	8.15 C	3.98 C	0.50 C	0.20	158.88	3.41 C	0.05 C	0.01 C	0.00 I	4527
11:00 to 12:00	12.97	1.08	3.43	0.33	158.64	1.47	0.03	0.15	0.10 I	6084
12:00 to 13:00	13.07	0.74	0.02	0.36	158.19	1.03	0.02	0.00	0.07 I	6332
13:00 to 14:00	13.10	0.19	0.00	0.40	158.95	0.26	0.00	0.00	0.05	6651
14:00 to 15:00	13.20	0.52	0.00	0.29	158.10	0.73	0.01	0.00	0.00	5671
15:00 to 16:00	13.20	0.43	0.00	0.35	158.08	0.61	0.01	0.00	0.00	6241
16:00 to 17:00	13.09	0.94	0.00	0.37	159.03	1.31	0.03	0.00	0.00	6377
17:00 to 18:00	13.22	0.49	0.00	0.34	158.15	0.70	0.01	0.00	0.00	6123
18:00 to 19:00	13.08	0.21	0.00	0.40	158.33	0.29	0.01	0.00	0.00	6630
19:00 to 20:00	13.18	0.42	0.00	0.37	158.98	0.60	0.01	0.00	0.00	6403
20:00 to 21:00	13.20	0.45	0.00	0.29	158.32	0.63	0.01	0.00	0.00	5713
21:00 to 22:00	13.06	1.23	0.00	0.41	158.52	1.70	0.03	0.00	0.00	6770
22:00 to 23:00	13.27	0.71	0.00	0.34	158.89	1.01	0.02	0.00	0.00	6125
23:00 to 24:00	13.40	0.32	0.00	0.28	158.14	0.46	0.01	0.00	0.00	5630
0:00 to 1:00	13.21	0.19	0.00	0.30	158.19	0.27	0.00	0.00	0.00	5775
1[illegible] to 2:00	13.19	0.36	0.00	0.33	158.67	0.51	0.01	0.00	0.00	6023
2[illegible] 3:00	13.16	0.68	0.00	0.30	158.43	0.95	0.02	0.00	0.00	5795
3:00 to 4:00	13.11	0.23	0.00	0.41	158.52	0.33	0.01	0.00	0.00	6769
4:00 to 5:00	13.14	0.71	0.00	0.36	159.30	0.99	0.02	0.00	0.00	6315
5:00 to 6:00	13.11	0.76	0.00	0.38	158.80	1.06	0.02	0.00	0.00	6508
Averages										
6:00 to 18:00	13.06	0.81	1.23	0.32	158.58	1.12	0.02	0.05	0.05	5839
18:00 to 6:00	13.18	0.52	0.00	0.35	158.59	0.73	0.01	0.00	0.00	6205
6:00 to 6:00	13.12	0.66	0.59	0.33	158.59	0.92	0.02	0.02	0.02	6022

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 17 , 2006
Report Printed on 10-18-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.01	1.95	5.65	0.30	159.42	2.69	0.05	0.26	0.07	5660
7:00 to 8:00	13.05	0.69	0.00	0.29	159.63	0.95	0.02	0.00	0.07	5675
8:00 to 9:00	12.97	0.94	0.00	0.43	159.09	1.28	0.03	0.00	0.07	6883
9:00 to 10:00	12.92	0.79	0.00	0.43	159.03	1.08	0.02	0.00	0.00	6882
10:00 to 11:00	13.07	0.14	0.00	0.37	159.38	0.20	0.00	0.00	0.00	6438
11:00 to 12:00	13.18	0.20	0.00	0.27	158.78	0.28	0.00	0.00	0.00	5402
12:00 to 13:00	13.18	0.14	0.00	0.14	158.69	0.19	0.00	0.00	0.00	3758
13:00 to 14:00	13.10	0.76	0.00	0.28	159.60	1.06	0.02	0.00	0.00	5658
14:00 to 15:00	13.18	0.04	0.00	0.30	158.82	0.06	0.00	0.00	0.00	5726
15:00 to 16:00	13.18	1.04	0.00	0.29	158.79	1.46	0.02	0.00	0.00	5617
16:00 to 17:00	13.15	0.77	0.00	0.36	159.32	1.08	0.02	0.00	0.00	6311
17:00 to 18:00	13.14	0.78	0.00	0.34	158.88	1.09	0.02	0.00	0.00	6152
18:00 to 19:00	13.03	0.47	0.00	0.42	159.26	0.64	0.01	0.00	0.00	6841
19:00 to 20:00	13.24	0.90	0.00	0.33	159.31	1.27	0.02	0.00	0.00	6102
20:00 to 21:00	13.13	0.36	0.00	0.42	159.24	0.50	0.01	0.00	0.00	6846
21:00 to 22:00	13.17	0.81	0.00	0.44	159.06	1.14	0.02	0.00	0.00	6971
22:00 to 23:00	13.18	0.46	0.00	0.39	159.70	0.65	0.01	0.00	0.00	6557
23:00 to 24:00	13.20	1.11	0.00	0.44	159.16	1.56	0.03	0.00	0.00	6968
0:00 to 1:00	13.09	0.42	0.00	0.42	158.85	0.59	0.01	0.00	0.00	6849
1:00 to 2:00	13.13	0.60	0.00	0.35	159.55	0.84	0.02	0.00	0.00	6261
[illegible] to 3:00	13.23	0.20	0.00	0.27	158.68	0.29	0.00	0.00	0.00	5496
3:00 to 4:00	13.11	1.21	0.00	0.28	158.70	1.68	0.03	0.00	0.00	5549
4:00 to 5:00	13.10	1.49	0.00	0.28	159.62	2.08	0.03	0.00	0.00	5654
5:00 to 6:00	13.12	0.72	0.00	0.40	159.01	1.00	0.02	0.00	0.00	6709
Averages										
6:00 to 18:00	13.09	0.69	0.47	0.31	159.12	0.95	0.02	0.02	0.02	5847
18:00 to 6:00	13.15	0.73	0.00	0.37	159.18	1.02	0.02	0.00	0.00	6400
6:00 to 6:00	13.12	0.71	0.24	0.34	159.15	0.99	0.02	0.01	0.01	6124

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 18 , 2006
Report Printed on 10-19-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.14	0.68	6.13	0.35	159.22	0.95	0.01	0.29	0.08	6185
7:00 to 8:00	13.19	0.57	0.00	0.32	159.32	0.80	0.01	0.00	0.08	5971
8:00 to 9:00	13.03	1.17	0.00	0.32	159.40	1.61	0.03	0.00	0.08	5973
9:00 to 10:00	13.09	1.06	0.00	0.33	159.08	1.47	0.03	0.00	0.00	6049
10:00 to 11:00	13.25	0.23	0.00	0.25	158.99	0.33	0.01	0.00	0.00	5293
11:00 to 12:00	12.98	1.06	0.00	0.30	159.23	1.45	0.02	0.00	0.00	5790
12:00 to 13:00	13.11	1.15	0.00	0.19	159.10	1.61	0.02	0.00	0.00	4449
13:00 to 14:00	13.25	0.43	0.00	0.22	159.43	0.61	0.01	0.00	0.00	4861
14:00 to 15:00	13.15	0.28	0.00	0.30	159.13	0.39	0.01	0.00	0.00	5777
15:00 to 16:00	13.05	0.79	0.00	0.30	158.78	1.09	0.02	0.00	0.00	5746
16:00 to 17:00	13.13	0.88	0.00	0.35	159.49	1.23	0.02	0.00	0.00	6255
17:00 to 18:00	13.12	1.29	0.00	0.39	158.44	1.80	0.03	0.00	0.00	6551
18:00 to 19:00	13.06	0.60	0.00	0.47	158.87	0.84	0.02	0.00	0.00	7275
19:00 to 20:00	13.14	0.52	0.00	0.38	159.36	0.72	0.01	0.00	0.00	6480
20:00 to 21:00	13.21	0.51	0.00	0.28	158.92	0.72	0.01	0.00	0.00	5634
21:00 to 22:00	13.16	0.42	0.00	0.43	158.83	0.59	0.01	0.00	0.00	6879
22:00 to 23:00	13.24	0.42	0.00	0.29	158.74	0.60	0.01	0.00	0.00	5726
23:00 to 24:00	13.14	0.27	0.00	0.27	158.76	0.37	0.01	0.00	0.00	5444
0:00 to 1:00	13.15	0.43	0.00	0.26	158.28	0.61	0.01	0.00	0.00	5367
1[illegible] 2:00	13.16	0.33	0.00	0.26	158.82	0.46	0.01	0.00	0.00	5355
2[illegible] 3:00	13.13	0.46	0.00	0.28	158.57	0.65	0.01	0.00	0.00	5556
3:00 to 4:00	13.15	0.50	0.00	0.31	158.72	0.70	0.01	0.00	0.00	5828
4:00 to 5:00	13.13	0.39	0.00	0.33	159.31	0.54	0.01	0.00	0.00	6104
5:00 to 6:00	13.18	0.31	0.00	0.28	158.62	0.44	0.01	0.00	0.00	5596
verages										
6:00 to 18:00	13.12	0.80	0.51	0.30	159.13	1.11	0.02	0.02	0.02	5742
8:00 to 6:00	13.15	0.43	0.00	0.32	158.82	0.60	0.01	0.00	0.00	5937
6:00 to 6:00	13.14	0.61	0.26	0.31	158.97	0.86	0.01	0.01	0.01	5839

OTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 19 , 2006
Report Printed on 10-20-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.04	0.48	5.62	0.30	159.27	0.66	0.01	0.28	0.08	5580
7:00 to 8:00	13.23	0.48	0.00	0.22	158.63	0.68	0.01	0.00	0.08	4943
8:00 to 9:00	13.16	0.76	0.00	0.28	158.20	1.07	0.02	0.00	0.08	5577
9:00 to 10:00	13.08	0.39	0.00	0.30	158.20	0.54	0.01	0.00	0.00	5742
10:00 to 11:00	13.06	0.21	0.00	0.30	158.26	0.29	0.00	0.00	0.00	5740
11:00 to 12:00	13.21	0.16	0.00	0.26	157.62	0.23	0.00	0.00	0.00	5402
12:00 to 13:00	13.15	0.81	0.00	0.27	157.63	1.13	0.02	0.00	0.00	5489
13:00 to 14:00	13.14	0.62	0.00	0.26	158.78	0.86	0.01	0.00	0.00	5330
14:00 to 15:00	13.07	0.50	0.00	0.23	158.51	0.69	0.01	0.00	0.00	4912
15:00 to 16:00	13.03	0.92	0.00	0.16	158.71	1.27	0.01	0.00	0.00	4029
16:00 to 17:00	13.06	0.74	0.00	0.20	158.94	1.03	0.01	0.00	0.00	4466
17:00 to 18:00	13.10	0.48	0.00	0.30	158.38	0.67	0.01	0.00	0.00	5776
18:00 to 19:00	13.05	0.67	0.00	0.32	158.21	0.92	0.02	0.00	0.00	5911
19:00 to 20:00	13.03	0.94	0.00	0.36	158.74	1.30	0.02	0.00	0.00	6338
20:00 to 21:00	13.05	0.73	0.00	0.42	158.34	1.01	0.02	0.00	0.00	6830
21:00 to 22:00	12.96	0.52	0.00	0.45	158.13	0.72	0.02	0.00	0.00	7064
22:00 to 23:00	13.02	0.48	0.00	0.44	158.78	0.66	0.01	0.00	0.00	6883
23:00 to 24:00	13.22	0.76	0.00	0.35	157.75	1.07	0.02	0.00	0.00	6260
0:00 to 1:00	13.16	1.17	0.00	0.42	157.64	1.64	0.03	0.00	0.00	6845
1:00 to 2:00	13.22	0.98	0.00	0.36	158.28	1.39	0.02	0.00	0.00	6274
2:00 to 3:00	13.34	0.16	0.00	0.27	157.81	0.23	0.00	0.00	0.00	5464
3:00 to 4:00	13.40	0.03	0.00	0.27	157.71	0.04	0.00	0.00	0.00	5474
4:00 to 5:00	13.42	0.02	0.00	0.27	158.08	0.03	0.00	0.00	0.00	5493
5:00 to 6:00	13.45	0.02	0.00	0.28	157.47	0.02	0.00	0.00	0.00	5546
Averages										
6:00 to 18:00	13.11	0.55	0.47	0.26	158.43	0.76	0.01	0.02	0.02	5249
18:00 to 6:00	13.19	0.54	0.00	0.35	158.08	0.76	0.01	0.00	0.00	6199
6:00 to 6:00	13.15	0.54	0.23	0.30	158.25	0.76	0.01	0.01	0.01	5724

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 20 , 2006
Report Printed on 10-21-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.30	0.04	6.14	0.28	158.02	0.06	0.00	0.26	0.07	5580
7:00 to 8:00	12.97	0.78	0.00	0.35	159.61	1.07	0.02	0.00	0.07	6314
8:00 to 9:00	12.91	1.08	0.00	0.45	158.80	1.46	0.03	0.00	0.07	7108
9:00 to 10:00	12.82	1.01	0.00	0.64	158.45	1.36	0.03	0.00	0.00	8434
10:00 to 11:00	12.86	1.08	0.00	0.52	159.26	1.46	0.03	0.00	0.00	7453
11:00 to 12:00	13.03	0.58	0.00	0.27	158.47	0.80	0.01	0.00	0.00	5428
12:00 to 13:00	13.10	0.71	0.00	0.14	158.50	0.99	0.01	0.00	0.00	3818
13:00 to 14:00	13.07	0.34	0.00	0.20	159.09	0.47	0.01	0.00	0.00	4447
14:00 to 15:00	12.98	0.70	0.00	0.31	158.79	0.96	0.02	0.00	0.00	5890
15:00 to 16:00	13.00	1.00	0.00	0.38	158.74	1.38	0.03	0.00	0.00	6470
16:00 to 17:00	12.81	0.76	0.00	0.35	158.78	1.02	0.02	0.00	0.00	6235
17:00 to 18:00	12.94	1.02	0.00	0.38	158.79	1.40	0.03	0.00	0.00	6507
18:00 to 19:00	12.96	0.46	0.00	0.40	158.54	0.63	0.01	0.00	0.00	6697
19:00 to 20:00	12.93	0.47	0.00	0.45	159.40	0.64	0.01	0.00	0.00	7022
20:00 to 21:00	13.13	0.24	0.00	0.27	158.59	0.33	0.01	0.00	0.00	5488
21:00 to 22:00	13.03	0.48	0.00	0.28	158.67	0.66	0.01	0.00	0.00	5547
22:00 to 23:00	13.10	1.27	0.00	0.34	159.12	1.77	0.03	0.00	0.00	6211
23:00 to 24:00	13.03	0.20	0.00	0.34	158.51	0.27	0.00	0.00	0.00	6151
0:00 to 1:00	12.85	0.23	0.00	0.41	158.70	0.32	0.01	0.00	0.00	6752
1:00 to 2:00	13.03	0.39	0.00	0.30	158.82	0.54	0.01	0.00	0.00	5781
2:00 to 3:00	13.04	0.63	0.00	0.34	158.72	0.86	0.02	0.00	0.00	6105
3:00 to 4:00	12.93	0.55	0.00	0.36	158.39	0.75	0.01	0.00	0.00	6317
4:00 to 5:00	12.83	0.55	0.00	0.38	158.92	0.74	0.01	0.00	0.00	6446
5:00 to 6:00	12.95	0.04	0.00	0.28	158.63	0.05	0.00	0.00	0.00	5547
Averages										
6:00 to 18:00	12.98	0.76	0.51	0.36	158.78	1.04	0.02	0.02	0.02	6140
18:00 to 6:00	12.98	0.46	0.00	0.35	158.75	0.63	0.01	0.00	0.00	6172
6:00 to 6:00	12.98	0.61	0.26	0.35	158.76	0.84	0.02	0.01	0.01	6156

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 21 , 2006
Report Printed on 10-22-2006 at 06:00:02

eriod	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.91	1.07	6.93	0.25	158.78	1.45	0.02	0.29	0.08	5305
7:00 to 8:00	12.78	0.70	0.01	0.36	158.51	0.94	0.02	0.00	0.08	6281
8:00 to 9:00	12.90	0.84	0.00	0.35	157.70	1.14	0.02	0.00	0.08	6228
9:00 to 10:00	12.79	0.34	0.00	0.42	157.90	0.45	0.01	0.00	0.00	6875
0:00 to 11:00	12.85	0.76	0.00	0.28	158.55	1.03	0.02	0.00	0.00	5555
1:00 to 12:00	12.79	0.48	0.00	0.32	158.25	0.64	0.01	0.00	0.00	5990
2:00 to 13:00	12.87	0.17	0.00	0.32	158.14	0.24	0.00	0.00	0.00	5938
3:00 to 14:00	12.99	0.72	0.00	0.33	159.06	0.99	0.02	0.00	0.00	6054
4:00 to 15:00	12.94	0.68	0.00	0.28	158.17	0.93	0.02	0.00	0.00	5474
5:00 to 16:00	12.87	1.07	0.00	0.29	158.00	1.45	0.02	0.00	0.00	5600
6:00 to 17:00	12.89	0.73	0.00	0.35	158.59	0.99	0.02	0.00	0.00	6230
7:00 to 18:00	12.92	0.62	0.00	0.28	157.79	0.84	0.01	0.00	0.00	5611
8:00 to 19:00	12.92	0.77	0.00	0.32	157.99	1.05	0.02	0.00	0.00	5947
9:00 to 20:00	13.00	0.91	0.00	0.36	158.30	1.26	0.02	0.00	0.00	6280
0:00 to 21:00	12.97	0.68	0.00	0.29	157.90	0.93	0.02	0.00	0.00	5668
1:00 to 22:00	12.93	0.46	0.00	0.36	157.81	0.63	0.01	0.00	0.00	6297
2:00 to 23:00	12.94	0.66	0.00	0.35	158.13	0.90	0.02	0.00	0.00	6238
3:00 to 24:00	12.94	0.70	0.00	0.38	157.84	0.95	0.02	0.00	0.00	6463
0:00 to 1:00	12.96	0.17	0.00	0.39	157.78	0.23	0.00	0.00	0.00	6553
1[illegible] 2:00	12.93	0.86	0.00	0.42	158.40	1.17	0.02	0.00	0.00	6753
2[illegible] 3:00	13.00	0.84	0.00	0.29	157.58	1.16	0.02	0.00	0.00	5735
3:00 to 4:00	12.89	0.77	0.00	0.42	157.67	1.05	0.02	0.00	0.00	6845
4:00 to 5:00	12.94	0.75	0.00	0.36	158.21	1.02	0.02	0.00	0.00	6308
5:00 to 6:00	12.91	0.50	0.00	0.35	157.52	0.68	0.01	0.00	0.00	6245
verages										
6:00 to 18:00	12.88	0.68	0.58	0.32	158.29	0.92	0.02	0.02	0.02	5928
18:00 to 6:00	12.94	0.67	0.00	0.36	157.93	0.92	0.02	0.00	0.00	6278
6:00 to 6:00	12.91	0.68	0.29	0.34	158.11	0.92	0.02	0.01	0.01	6103

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 22 , 2006
Report Printed on 10-23-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.98	1.77	6.04	0.36	158.80	2.42	0.05	0.30	0.08	6282
7:00 to 8:00	13.02	0.15	0.01	0.26	159.48	0.21	0.00	0.00	0.08	5360
8:00 to 9:00	12.98	0.57	0.00	0.31	159.23	0.79	0.01	0.00	0.08	5894
9:00 to 10:00	13.06	0.55	0.00	0.18	158.78	0.76	0.01	0.00	0.00	4425
10:00 to 11:00	13.04	0.46	0.00	0.22	159.82	0.64	0.01	0.00	0.00	4884
11:00 to 12:00	13.01	0.79	0.00	0.33	159.56	1.09	0.02	0.00	0.00	6070
12:00 to 13:00	12.81	0.95	0.00	0.31	159.47	1.27	0.02	0.00	0.00	5871
13:00 to 14:00	13.05	0.95	0.00	0.27	160.27	1.32	0.02	0.00	0.00	5608
14:00 to 15:00	13.07	0.27	0.00	0.32	159.52	0.38	0.01	0.00	0.00	5961
15:00 to 16:00	13.04	0.89	0.00	0.32	159.42	1.23	0.02	0.00	0.00	5958
16:00 to 17:00	13.06	0.17	0.00	0.26	159.52	0.23	0.00	0.00	0.00	5398
17:00 to 18:00	12.97	0.56	0.00	0.27	158.80	0.77	0.01	0.00	0.00	5510
18:00 to 19:00	13.15	0.65	0.00	0.29	159.03	0.91	0.01	0.00	0.00	5707
19:00 to 20:00	13.22	0.86	0.00	0.27	159.02	1.22	0.02	0.00	0.00	5508
20:00 to 21:00	13.15	1.35	0.00	0.32	159.03	1.89	0.03	0.00	0.00	5995
21:00 to 22:00	13.22	0.36	0.00	0.39	158.60	0.51	0.01	0.00	0.00	6627
22:00 to 23:00	13.22	1.03	0.00	0.34	159.44	1.46	0.03	0.00	0.00	6137
23:00 to 24:00	13.21	0.27	0.00	0.28	158.76	0.38	0.01	0.00	0.00	5595
0:00 to 1:00	13.19	0.46	0.00	0.37	158.99	0.65	0.01	0.00	0.00	6396
1:00 to 2:00	13.16	0.27	0.00	0.36	159.16	0.39	0.01	0.00	0.00	6358
2:00 to 3:00	13.19	0.40	0.00	0.29	158.72	0.57	0.01	0.00	0.00	5702
3:00 to 4:00	13.15	0.69	0.00	0.36	158.64	0.97	0.02	0.00	0.00	6312
4:00 to 5:00	13.17	0.33	0.00	0.32	159.14	0.46	0.01	0.00	0.00	6033
5:00 to 6:00	13.12	0.57	0.00	0.30	158.95	0.80	0.01	0.00	0.00	5813
Averages										
6:00 to 18:00	13.01	0.68	0.50	0.28	159.39	0.93	0.02	0.03	0.02	5602
18:00 to 6:00	13.18	0.60	0.00	0.33	158.96	0.85	0.01	0.00	0.00	6015
6:00 to 6:00	13.09	0.64	0.25	0.31	159.17	0.89	0.01	0.01	0.01	5809

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 23 , 2006
Report Printed on 10-24-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.99	1.35	5.76	0.29	159.21	1.85	0.03	0.25	0.07	5680
7:00 to 8:00	12.92	0.29	0.03	0.29	159.97	0.40	0.01	0.00	0.07	5775
8:00 to 9:00	12.97	0.17	0.00	0.29	159.27	0.23	0.00	0.00	0.07	5684
9:00 to 10:00	12.89	0.42	0.00	0.30	159.00	0.57	0.01	0.00	0.00	5740
10:00 to 11:00	12.93	0.50	0.00	0.28	159.68	0.69	0.01	0.00	0.00	5695
11:00 to 12:00	12.81	0.61	0.00	0.29	159.45	0.82	0.01	0.00	0.00	5718
12:00 to 13:00	12.83	0.49	0.00	0.31	159.14	0.66	0.01	0.00	0.00	5865
13:00 to 14:00	12.87	0.24	0.00	0.30	159.59	0.32	0.01	0.00	0.00	5794
14:00 to 15:00	12.79	0.42	0.00	0.30	159.49	0.57	0.01	0.00	0.00	5798
15:00 to 16:00	12.79	0.47	0.00	0.30	159.44	0.63	0.01	0.00	0.00	5742
16:00 to 17:00	12.76	0.19	0.00	0.29	160.04	0.25	0.00	0.00	0.00	5747
17:00 to 18:00	12.97	0.64	0.00	0.28	159.64	0.87	0.01	0.00	0.00	5650
18:00 to 19:00	12.85	0.42	0.00	0.29	159.66	0.56	0.01	0.00	0.00	5685
19:00 to 20:00	12.91	0.45	0.00	0.28	160.05	0.62	0.01	0.00	0.00	5650
20:00 to 21:00	12.92	0.60	0.00	0.36	159.98	0.82	0.01	0.00	0.00	6382
21:00 to 22:00	12.93	0.33	0.00	0.33	159.27	0.45	0.01	0.00	0.00	6007
22:00 to 23:00	12.95	0.29	0.00	0.34	159.93	0.39	0.01	0.00	0.00	6210
23:00 to 24:00	12.97	0.99	0.00	0.30	159.43	1.36	0.02	0.00	0.00	5778
0:00 to 1:00	12.85	0.45	0.00	0.32	159.51	0.61	0.01	0.00	0.00	5972
1:[illegible] to 2:00	12.92	0.45	0.00	0.30	159.90	0.61	0.01	0.00	0.00	5898
2[illegible] 3:00	12.95	0.93	0.00	0.28	158.82	1.27	0.02	0.00	0.00	5607
3:00 to 4:00	12.88	0.22	0.00	0.29	158.94	0.30	0.00	0.00	0.00	5675
4:00 to 5:00	12.96	0.05	0.00	0.28	159.17	0.07	0.00	0.00	0.00	5563
5:00 to 6:00	13.00	0.37	0.00	0.29	158.91	0.51	0.01	0.00	0.00	5723
Averages										
6:00 to 18:00	12.88	0.48	0.48	0.29	159.49	0.65	0.01	0.02	0.02	5741
18:00 to 6:00	12.92	0.46	0.00	0.31	159.46	0.63	0.01	0.00	0.00	5846
6:00 to 6:00	12.90	0.47	0.24	0.30	159.48	0.64	0.01	0.01	0.01	5793

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 24 , 2006
Report Printed on 10-25-2006 at 06:00:02

eriod	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.33	0.03	9.86	0.29	158.90	0.05	0.00	0.41	0.11	5643
7:00 to 8:00	13.22	0.38	0.00	0.30	159.33	0.53	0.01	0.00	0.11	5790
8:00 to 9:00	13.28	0.01	0.00	0.29	157.78	0.01	0.00	0.00	0.11	5733
9:00 to 10:00	13.17	0.01	0.00	0.29	157.58	0.01	0.00	0.00	0.00	5673
0:00 to 11:00	13.18	0.26	0.00	0.30	158.21	0.36	0.01	0.00	0.00	5757
1:00 to 12:00	12.95	0.31	0.00	0.33	158.12	0.42	0.01	0.00	0.00	6031
2:00 to 13:00	12.98	0.91	0.00	0.25	158.25	1.25	0.01	0.00	0.00	5062
3:00 to 14:00	13.22	0.62	0.00	0.21	158.02	0.87	0.01	0.00	0.00	4766
4:00 to 15:00	13.14	0.01	0.00	0.29	157.82	0.02	0.00	0.00	0.00	5733
5:00 to 16:00	13.18	0.05	0.00	0.28	157.42	0.07	0.00	0.00	0.00	5598
6:00 to 17:00	13.17	0.25	0.00	0.28	157.54	0.35	0.01	0.00	0.00	5625
7:00 to 18:00	13.03	0.28	0.00	0.32	157.59	0.39	0.01	0.00	0.00	5976
8:00 to 19:00	12.92	0.56	0.00	0.36	157.71	0.77	0.02	0.00	0.00	6333
9:00 to 20:00	12.99	0.55	0.00	0.31	158.50	0.75	0.01	0.00	0.00	5829
0:00 to 21:00	13.12	0.41	0.00	0.28	157.73	0.58	0.01	0.00	0.00	5581
1:00 to 22:00	13.02	0.24	0.00	0.29	158.09	0.33	0.01	0.00	0.00	5682
2:00 to 23:00	13.02	0.59	0.00	0.31	158.13	0.81	0.01	0.00	0.00	5875
3:00 to 24:00	12.93	0.39	0.00	0.27	157.81	0.53	0.01	0.00	0.00	5498
0:00 to 1:00	13.00	1.28	0.00	0.30	157.96	1.77	0.03	0.00	0.00	5796
1:00 to 2:00	12.98	0.88	0.00	0.35	158.39	1.21	0.02	0.00	0.00	6212
[illegible] 3:00	13.10	0.46	0.00	0.28	157.79	0.65	0.01	0.00	0.00	5633
3:00 to 4:00	13.04	0.58	0.00	0.40	157.63	0.80	0.02	0.00	0.00	6680
4:00 to 5:00	13.00	0.51	0.00	0.37	158.26	0.70	0.01	0.00	0.00	6365
5:00 to 6:00	13.05	0.75	0.00	0.31	157.56	1.04	0.02	0.00	0.00	5876
verages										
5:00 to 18:00	13.15	0.26	0.82	0.29	158.05	0.36	0.01	0.03	0.03	5616
3:00 to 6:00	13.02	0.60	0.00	0.32	157.96	0.83	0.01	0.00	0.00	5947
5:00 to 6:00	13.08	0.43	0.41	0.30	158.00	0.60	0.01	0.02	0.01	5781

OTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 25 , 2006
Report Printed on 10-26-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.00	0.43	9.46	0.35	158.34	0.59	0.01	0.44	0.12	6221
7:00 to 8:00	13.00	1.13	0.00	0.31	159.10	1.56	0.03	0.00	0.12	5847
8:00 to 9:00	12.97	0.19	0.00	0.31	158.32	0.26	0.00	0.00	0.12	5881
9:00 to 10:00	12.80	0.94	0.00	0.41	158.69	1.25	0.02	0.00	0.00	6752
10:00 to 11:00	12.97	0.47	0.00	0.28	159.04	0.64	0.01	0.00	0.00	5561
11:00 to 12:00	12.85	1.31	0.00	0.30	158.90	1.77	0.03	0.00	0.00	5825
12:00 to 13:00	12.96	0.58	0.00	0.23	158.61	0.79	0.01	0.00	0.00	4925
13:00 to 14:00	12.96	0.68	0.00	0.24	159.19	0.94	0.01	0.00	0.00	5089
14:00 to 15:00	12.88	0.43	0.00	0.31	159.13	0.58	0.01	0.00	0.00	5910
15:00 to 16:00	12.98	0.55	0.00	0.30	158.72	0.75	0.01	0.00	0.00	5758
16:00 to 17:00	12.93	1.17	0.00	0.29	159.00	1.59	0.03	0.00	0.00	5644
17:00 to 18:00	13.02	0.84	0.00	0.29	158.73	1.15	0.02	0.00	0.00	5687
18:00 to 19:00	12.89	0.96	0.00	0.34	159.03	1.30	0.02	0.00	0.00	6155
19:00 to 20:00	13.00	0.74	0.00	0.31	159.46	1.02	0.02	0.00	0.00	5901
20:00 to 21:00	12.96	0.52	0.00	0.27	158.64	0.71	0.01	0.00	0.00	5521
21:00 to 22:00	13.04	0.65	0.00	0.34	158.73	0.90	0.02	0.00	0.00	6182
22:00 to 23:00	13.13	0.37	0.00	0.30	158.55	0.52	0.01	0.00	0.00	5726
23:00 to 24:00	13.08	0.88	0.00	0.33	158.57	1.22	0.02	0.00	0.00	6044
0:00 to 1:00	13.14	0.81	0.00	0.38	158.14	1.14	0.02	0.00	0.00	6456
1:00 to 2:00	13.09	0.43	0.00	0.41	158.67	0.60	0.01	0.00	0.00	6687
2:00 to 3:00	13.00	1.09	0.00	0.32	158.40	1.50	0.03	0.00	0.00	6011
3:00 to 4:00	13.00	0.81	0.00	0.38	158.28	1.12	0.02	0.00	0.00	6494
4:00 to 5:00	13.04	0.92	0.00	0.36	158.89	1.28	0.02	0.00	0.00	6325
5:00 to 6:00	13.03	0.12	0.00	0.31	158.14	0.17	0.00	0.00	0.00	5836
Averages										
6:00 to 18:00	12.94	0.73	0.79	0.30	158.81	0.99	0.02	0.04	0.03	5758
18:00 to 6:00	13.03	0.69	0.00	0.34	158.63	0.96	0.02	0.00	0.00	6112
6:00 to 6:00	12.99	0.71	0.39	0.32	158.72	0.97	0.02	0.02	0.01	5935

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 26 , 2006
Report Printed on 10-27-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.05	0.86	9.84	0.36	158.61	1.18	0.02	0.44	0.12	6344
7:00 to 8:00	13.01	0.25	0.00	0.29	158.17	0.34	0.01	0.00	0.12	5689
8:00 to 9:00	13.01	1.05	0.00	0.33	157.73	1.44	0.03	0.00	0.12	6081
9:00 to 10:00	13.04	0.45	0.00	0.20	157.59	0.62	0.01	0.00	0.00	4584
10:00 to 11:00	12.97	1.25	0.00	0.25	158.02	1.72	0.03	0.00	0.00	4878
11:00 to 12:00	12.86	1.31	0.00	0.35	157.86	1.77	0.03	0.00	0.00	6211
12:00 to 13:00	12.97	0.57	0.00	0.17	157.36	0.79	0.01	0.00	0.00	4053
13:00 to 14:00	12.84	0.60	0.00	0.23	158.70	0.80	0.01	0.00	0.00	5047
14:00 to 15:00	12.87	0.62	0.00	0.23	157.93	0.84	0.01	0.00	0.00	5025
15:00 to 16:00	12.92	0.51	0.00	0.24	157.94	0.69	0.01	0.00	0.00	5122
16:00 to 17:00	12.96	0.80	0.00	0.25	158.25	1.09	0.02	0.00	0.00	5262
17:00 to 18:00	12.93	0.59	0.00	0.28	157.78	0.80	0.01	0.00	0.00	5567
18:00 to 19:00	13.03	0.58	0.00	0.32	158.25	0.79	0.01	0.00	0.00	5933
19:00 to 20:00	13.03	0.93	0.00	0.34	158.45	1.28	0.02	0.00	0.00	6160
20:00 to 21:00	12.97	1.04	0.00	0.30	158.27	1.43	0.02	0.00	0.00	5803
21:00 to 22:00	13.03	0.59	0.00	0.36	157.77	0.81	0.02	0.00	0.00	6283
22:00 to 23:00	13.00	0.82	0.00	0.34	158.43	1.13	0.02	0.00	0.00	6130
23:00 to 24:00	13.07	0.25	0.00	0.33	157.82	0.35	0.01	0.00	0.00	6103
0:00 to 1:00	13.08	0.63	0.00	0.26	157.84	0.87	0.01	0.00	0.00	5338
1:00 to 2:00	13.09	0.59	0.00	0.36	158.11	0.82	0.02	0.00	0.00	6346
[illegible] to 3:00	13.13	0.74	0.00	0.29	157.63	1.03	0.02	0.00	0.00	5653
3:00 to 4:00	13.09	0.82	0.00	0.31	157.77	1.14	0.02	0.00	0.00	5864
4:00 to 5:00	13.10	1.36	0.00	0.29	158.01	1.90	0.03	0.00	0.00	5659
5:00 to 6:00	13.15	1.11	0.00	0.31	157.92	1.55	0.03	0.00	0.00	5883
Averages										
6:00 to 18:00	12.95	0.74	0.82	0.26	158.00	1.01	0.02	0.04	0.03	5322
18:00 to 6:00	13.06	0.79	0.00	0.32	158.02	1.09	0.02	0.00	0.00	5930
6:00 to 6:00	13.01	0.76	0.41	0.29	158.01	1.05	0.02	0.02	0.01	5626

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 27 , 2006
Report Printed on 10-28-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.08	0.81	9.76	0.26	157.98	1.12	0.02	0.44	0.12	5212
7:00 to 8:00	13.04	0.52	0.00	0.26	158.23	0.71	0.01	0.00	0.12	5403
8:00 to 9:00	13.05	0.59	0.00	0.29	157.92	0.82	0.01	0.00	0.12	5695
9:00 to 10:00	13.02	0.26	0.00	0.28	157.80	0.37	0.01	0.00	0.00	5608
10:00 to 11:00	12.91	0.70	0.00	0.26	158.79	0.95	0.01	0.00	0.00	5413
11:00 to 12:00	12.83	0.59	0.00	0.29	157.93	0.79	0.01	0.00	0.00	5665
12:00 to 13:00	12.95	0.68	0.00	0.29	157.83	0.93	0.01	0.00	0.00	5625
13:00 to 14:00	13.06	1.05	0.00	0.21	158.24	1.46	0.02	0.00	0.00	4558
14:00 to 15:00	13.01	0.40	0.00	0.30	158.03	0.55	0.01	0.00	0.00	5749
15:00 to 16:00	13.02	1.12	0.00	0.30	157.93	1.54	0.03	0.00	0.00	5763
16:00 to 17:00	13.00	0.74	0.00	0.29	158.34	1.02	0.02	0.00	0.00	5670
17:00 to 18:00	13.14	0.93	0.00	0.29	157.95	1.30	0.02	0.00	0.00	5702
18:00 to 19:00	13.25	0.30	0.00	0.28	157.77	0.43	0.01	0.00	0.00	5590
19:00 to 20:00	13.23	0.22	0.00	0.34	158.77	0.32	0.01	0.00	0.00	6176
20:00 to 21:00	13.30	0.76	0.00	0.29	157.85	1.08	0.02	0.00	0.00	5662
21:00 to 22:00	13.23	0.39	0.00	0.29	157.82	0.54	0.01	0.00	0.00	5723
22:00 to 23:00	13.19	0.43	0.00	0.36	158.51	0.61	0.01	0.00	0.00	6301
23:00 to 24:00	13.35	0.76	0.00	0.29	157.61	1.10	0.02	0.00	0.00	5726
0:00 to 1:00	13.25	0.50	0.00	0.29	157.71	0.70	0.01	0.00	0.00	5667
1:00 to 2:00	13.34	0.14	0.00	0.28	157.76	0.21	0.00	0.00	0.00	5551
[illegible] 3:00	13.35	0.48	0.00	0.30	157.62	0.69	0.01	0.00	0.00	5768
3:00 to 4:00	13.28	0.91	0.00	0.29	157.34	1.29	0.02	0.00	0.00	5656
4:00 to 5:00	13.22	0.55	0.00	0.28	157.86	0.78	0.01	0.00	0.00	5641
5:00 to 6:00	13.25	0.88	0.00	0.29	157.44	1.25	0.02	0.00	0.00	5740
Averages										
6:00 to 18:00	13.01	0.70	0.81	0.28	158.08	0.96	0.02	0.04	0.03	5505
18:00 to 6:00	13.27	0.53	0.00	0.30	157.84	0.75	0.01	0.00	0.00	5767
6:00 to 6:00	13.14	0.61	0.41	0.29	157.96	0.86	0.01	0.02	0.02	5636

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 28 , 2006
Report Printed on 10-29-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.42	0.19	9.41	0.30	158.10	0.27	0.00	0.39	0.11	5784
7:00 to 8:00	13.26	0.05	0.00	0.30	158.80	0.06	0.00	0.00	0.11	5770
8:00 to 9:00	13.20	0.53	0.00	0.30	158.30	0.74	0.01	0.00	0.11	5778
9:00 to 10:00	13.12	1.25	0.00	0.32	158.67	1.75	0.03	0.00	0.00	5983
10:00 to 11:00	13.17	0.51	0.00	0.30	159.03	0.72	0.01	0.00	0.00	5794
11:00 to 12:00	13.05	0.46	0.00	0.31	158.54	0.64	0.01	0.00	0.00	5845
12:00 to 13:00	12.99	1.12	0.00	0.33	159.08	1.54	0.03	0.00	0.00	6020
13:00 to 14:00	12.95	0.10	0.00	0.31	159.36	0.14	0.00	0.00	0.00	5920
14:00 to 15:00	12.85	0.15	0.00	0.32	159.26	0.20	0.00	0.00	0.00	5934
15:00 to 16:00	12.84	0.81	0.00	0.30	158.90	1.10	0.02	0.00	0.00	5801
16:00 to 17:00	12.80	1.19	0.00	0.30	159.69	1.59	0.03	0.00	0.00	5860
17:00 to 18:00	12.96	0.75	0.00	0.30	159.26	1.03	0.02	0.00	0.00	5783
18:00 to 19:00	12.94	1.04	0.00	0.30	159.24	1.42	0.02	0.00	0.00	5785
19:00 to 20:00	13.05	0.95	0.00	0.34	159.79	1.31	0.02	0.00	0.00	6227
20:00 to 21:00	13.02	0.40	0.00	0.29	159.04	0.56	0.01	0.00	0.00	5732
21:00 to 22:00	12.95	0.66	0.00	0.28	159.08	0.91	0.01	0.00	0.00	5617
22:00 to 23:00	12.97	0.91	0.00	0.35	159.21	1.25	0.02	0.00	0.00	6237
23:00 to 24:00	13.02	0.82	0.00	0.31	158.77	1.13	0.02	0.00	0.00	5851
0:00 to 1:00	13.03	1.19	0.00	0.32	158.62	1.64	0.03	0.00	0.00	5983
1:00 to 2:00	12.97	0.74	0.00	0.31	159.22	1.02	0.02	0.00	0.00	5932
2 3:00	13.10	0.46	0.00	0.31	158.54	0.65	0.01	0.00	0.00	5866
3:00 to 4:00	12.94	0.56	0.00	0.41	158.56	0.76	0.01	0.00	0.00	6756
4:00 to 5:00	12.89	0.72	0.00	0.38	159.18	0.98	0.02	0.00	0.00	6531
5:00 to 6:00	12.92	0.51	0.00	0.39	158.66	0.69	0.01	0.00	0.00	6550
Averages										
6:00 to 18:00	13.05	0.59	0.78	0.31	158.91	0.82	0.01	0.03	0.03	5856
18:00 to 6:00	12.98	0.75	0.00	0.33	158.99	1.03	0.02	0.00	0.00	6089
6:00 to 6:00	13.02	0.67	0.39	0.32	158.95	0.92	0.02	0.02	0.01	5972

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 29 , 2006
Report Printed on 10-30-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.11	0.27	9.67	0.28	159.02	0.37	0.00	0.48	0.13	5251
7:00 to 8:00	13.03	0.51	0.00	0.25	159.20	0.70	0.01	0.00	0.13	5235
8:00 to 9:00	13.01	0.71	0.00	0.28	158.48	0.98	0.02	0.00	0.13	5586
9:00 to 10:00	13.01	0.47	0.00	0.13	158.09	0.64	0.01	0.00	0.00	3723
10:00 to 11:00	13.04	1.05	0.00	0.21	157.59	1.45	0.02	0.00	0.00	4692
11:00 to 12:00	13.10	0.33	0.00	0.30	156.82	0.45	0.01	0.00	0.00	5770
12:00 to 13:00	13.19	1.04	0.00	0.29	156.72	1.47	0.02	0.00	0.00	5733
13:00 to 14:00	13.10	0.23	0.00	0.30	157.49	0.33	0.01	0.00	0.00	5824
14:00 to 15:00	13.18	0.58	0.00	0.32	157.13	0.81	0.01	0.00	0.00	5954
15:00 to 16:00	13.13	0.23	0.00	0.27	155.57	0.33	0.01	0.00	0.00	5430
16:00 to 17:00	13.00	0.46	0.00	0.32	156.83	0.64	0.01	0.00	0.00	5985
17:00 to 18:00	13.18	0.64	0.00	0.31	156.37	0.90	0.02	0.00	0.00	5845
18:00 to 19:00	13.20	0.58	0.00	0.40	155.96	0.82	0.02	0.00	0.00	6611
19:00 to 20:00	13.02	0.88	0.00	0.53	157.33	1.22	0.03	0.00	0.00	7480
20:00 to 21:00	13.15	0.62	0.00	0.33	156.82	0.86	0.02	0.00	0.00	6049
21:00 to 22:00	13.09	0.78	0.00	0.32	156.83	1.09	0.02	0.00	0.00	6001
22:00 to 23:00	13.13	0.62	0.00	0.38	157.08	0.87	0.02	0.00	0.00	6404
23:00 to 24:00	13.23	0.81	0.00	0.28	156.54	1.14	0.02	0.00	0.00	5632
0:00 to 1:00	13.15	0.43	0.00	0.38	156.25	0.61	0.01	0.00	0.00	6496
1:00 to 2:00	13.24	0.54	0.00	0.28	156.72	0.76	0.01	0.00	0.00	5567
2:00 to 3:00	13.14	0.57	0.00	0.35	156.73	0.80	0.01	0.00	0.00	6237
3:00 to 4:00	13.12	0.54	0.00	0.42	156.34	0.76	0.01	0.00	0.00	6861
4:00 to 5:00	13.14	0.68	0.00	0.48	157.04	0.95	0.02	0.00	0.00	7171
5:00 to 6:00	13.21	0.57	0.00	0.36	156.60	0.81	0.02	0.00	0.00	6377
Averages										
6:00 to 18:00	13.09	0.54	0.81	0.27	157.44	0.75	0.01	0.04	0.03	5419
18:00 to 6:00	13.15	0.64	0.00	0.38	156.69	0.89	0.02	0.00	0.00	6407
6:00 to 6:00	13.12	0.59	0.40	0.32	157.06	0.82	0.01	0.02	0.02	5913

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 30 , 2006
Report Printed on 10-31-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.87	0.37	9.80	0.28	150.08	0.50	0.01	0.42	0.12	5566
7:00 to 8:00	12.88	0.23	0.00	0.37	146.57	0.31	0.01	0.00	0.13	6419
8:00 to 9:00	12.73	0.71	0.00	0.40	157.34	0.95	0.02	0.00	0.13	6669
9:00 to 10:00	12.87	0.36	0.00	0.38	156.81	0.49	0.01	0.00	0.00	6522
10:00 to 11:00	12.79	0.13	0.00	0.32	157.48	0.17	0.00	0.00	0.00	5997
11:00 to 12:00	12.90	0.14	0.00	0.31	156.86	0.19	0.00	0.00	0.00	5907
12:00 to 13:00	12.91	0.36	0.00	0.31	156.89	0.49	0.01	0.00	0.00	5925
13:00 to 14:00	12.89	0.63	0.00	0.29	157.76	0.86	0.01	0.00	0.00	5632
14:00 to 15:00	12.97	0.07	0.00	0.38	157.52	0.09	0.00	0.00	0.00	6511
15:00 to 16:00	12.81	0.31	0.00	0.38	157.24	0.42	0.01	0.00	0.00	6470
16:00 to 17:00	12.95	0.41	0.00	0.31	157.43	0.56	0.01	0.00	0.00	5865
17:00 to 18:00	12.95	0.20	0.00	0.33	157.00	0.27	0.00	0.00	0.00	6089
18:00 to 19:00	12.86	0.19	0.00	0.35	156.99	0.25	0.00	0.00	0.00	6281
19:00 to 20:00	12.88	0.44	0.00	0.39	157.71	0.60	0.01	0.00	0.00	6553
20:00 to 21:00	12.93	0.48	0.00	0.32	157.10	0.66	0.01	0.00	0.00	6012
21:00 to 22:00	12.93	0.08	0.00	0.36	156.98	0.10	0.00	0.00	0.00	6357
22:00 to 23:00	12.86	0.49	0.00	0.31	157.33	0.67	0.01	0.00	0.00	5919
23:00 to 24:00	12.90	0.34	0.00	0.29	156.89	0.46	0.01	0.00	0.00	5742
0:00 to 1:00	12.78	0.04	0.00	0.42	157.00	0.06	0.00	0.00	0.00	6852
1:00 to 2:00	12.88	0.32	0.00	0.34	157.23	0.44	0.01	0.00	0.00	6176
2:00 to 3:00	12.79	0.31	0.00	0.30	156.78	0.42	0.01	0.00	0.00	5836
3:00 to 4:00	12.70	0.37	0.00	0.31	157.19	0.49	0.01	0.00	0.00	5914
4:00 to 5:00	12.68	0.10	0.00	0.31	157.29	0.14	0.00	0.00	0.00	5887
5:00 to 6:00	12.86	0.64	0.00	0.31	157.07	0.86	0.02	0.00	0.00	5889
Averages										
6:00 to 18:00	12.88	0.33	0.82	0.34	155.75	0.44	0.01	0.04	0.03	6131
18:00 to 6:00	12.84	0.32	0.00	0.34	157.13	0.43	0.01	0.00	0.00	6118
6:00 to 6:00	12.86	0.32	0.41	0.34	156.44	0.43	0.01	0.02	0.02	6125

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD October 31 , 2006
Report Printed on 11-01-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.11	0.12	10.54	0.29	156.18	0.16	0.00	0.45	0.12	5735
7:00 to 8:00	13.11	0.47	0.00	0.30	157.48	0.66	0.01	0.00	0.12	5805
8:00 to 9:00	13.11	0.09	0.00	0.31	157.27	0.12	0.00	0.00	0.12	5906
9:00 to 10:00	13.08	0.11	0.00	0.33	157.14	0.15	0.00	0.00	0.00	6039
10:00 to 11:00	12.92	0.70	0.00	0.32	158.09	0.95	0.02	0.00	0.00	6017
11:00 to 12:00	13.20	0.08	0.00	0.32	157.66	0.11	0.00	0.00	0.00	5955
12:00 to 13:00	13.36	0.23	0.00	0.32	156.08	0.34	0.01	0.00	0.00	5965
13:00 to 14:00	12.93	0.12	0.00	0.32	158.27	0.17	0.00	0.00	0.00	5954
14:00 to 15:00	13.12	0.73	0.00	0.31	157.37	1.02	0.02	0.00	0.00	5849
15:00 to 16:00	12.98	0.59	0.00	0.29	157.43	0.80	0.01	0.00	0.00	5693
16:00 to 17:00	13.11	1.00	0.00	0.30	158.45	1.39	0.02	0.00	0.00	5776
17:00 to 18:00	13.14	1.04	0.00	0.31	157.88	1.46	0.02	0.00	0.00	5838
18:00 to 19:00	13.20	0.94	0.00	0.32	157.93	1.33	0.02	0.00	0.00	5992
19:00 to 20:00	13.21	0.46	0.00	0.35	158.35	0.65	0.01	0.00	0.00	6259
20:00 to 21:00	13.21	0.61	0.00	0.29	157.86	0.87	0.01	0.00	0.00	5725
21:00 to 22:00	13.22	0.61	0.00	0.30	157.98	0.86	0.01	0.00	0.00	5779
22:00 to 23:00	13.50	0.55	0.00	0.29	158.42	0.81	0.01	0.00	0.00	5730
23:00 to 24:00	13.40	0.29	0.00	0.31	157.78	0.42	0.01	0.00	0.00	5858
0:00 to 1:00	13.41	0.22	0.00	0.32	157.33	0.32	0.01	0.00	0.00	5943
1:00 to 2:00	13.12	0.27	0.00	0.37	158.92	0.38	0.01	0.00	0.00	6359
[illegible] 3:00	13.13	0.11	0.00	0.31	158.17	0.16	0.00	0.00	0.00	5872
3:00 to 4:00	13.25	0.51	0.00	0.29	157.66	0.72	0.01	0.00	0.00	5725
4:00 to 5:00	13.11	0.37	0.00	0.31	158.39	0.52	0.01	0.00	0.00	5924
5:00 to 6:00	13.18	0.30	0.00	0.30	158.18	0.43	0.01	0.00	0.00	5751
Averages										
6:00 to 18:00	13.10	0.44	0.88	0.31	157.44	0.61	0.01	0.04	0.03	5878
18:00 to 6:00	13.24	0.44	0.00	0.31	158.08	0.62	0.01	0.00	0.00	5910
6:00 to 6:00	13.17	0.44	0.44	0.31	157.76	0.62	0.01	0.02	0.02	5894

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 1 , 2006
Report Printed on 11-02-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.96	0.50	9.59	0.30	157.72	0.69	0.01	0.41	0.11	5779
7:00 to 8:00	12.96	0.40	0.00	0.31	159.42	0.55	0.01	0.00	0.11	5879
8:00 to 9:00	12.97	0.59	0.00	0.30	158.46	0.81	0.01	0.00	0.11	5824
9:00 to 10:00	12.76	1.04	0.00	0.32	158.85	1.38	0.02	0.00	0.00	5954
10:00 to 11:00	12.77	0.27	0.00	0.30	159.17	0.36	0.01	0.00	0.00	5809
11:00 to 12:00	13.11	0.34	0.00	0.31	158.88	0.48	0.01	0.00	0.00	5897
12:00 to 13:00	13.17	0.43	0.00	0.32	158.45	0.60	0.01	0.00	0.00	5963
13:00 to 14:00	12.70	0.32	0.00	0.32	160.15	0.42	0.01	0.00	0.00	6139
14:00 to 15:00	12.90	0.13	0.00	0.30	160.09	0.18	0.00	0.00	0.00	5902
15:00 to 16:00	12.83	0.82	0.00	0.30	158.74	1.10	0.02	0.00	0.00	5768
16:00 to 17:00	12.92	0.88	0.00	0.30	159.18	1.20	0.02	0.00	0.00	5735
17:00 to 18:00	12.96	1.06	0.00	0.28	158.75	1.45	0.02	0.00	0.00	5564
18:00 to 19:00	13.00	0.92	0.00	0.25	159.16	1.26	0.02	0.00	0.00	5165
19:00 to 20:00	13.14	0.72	0.00	0.27	159.31	1.00	0.02	0.00	0.00	5478
20:00 to 21:00	13.02	0.59	0.00	0.30	159.18	0.81	0.01	0.00	0.00	5777
21:00 to 22:00	13.22	0.73	0.00	0.29	158.67	1.04	0.02	0.00	0.00	5681
22:00 to 23:00	13.15	0.26	0.00	0.29	158.79	0.36	0.01	0.00	0.00	5655
23:00 to 24:00	13.15	0.65	0.00	0.30	158.56	0.91	0.02	0.00	0.00	5805
0:00 to 1:00	13.13	1.03	0.00	0.29	158.25	1.44	0.02	0.00	0.00	5648
1:00 to 2:00	13.03	0.51	0.00	0.31	159.09	0.70	0.01	0.00	0.00	5903
[illegible] 3:00	13.15	0.97	0.00	0.25	158.31	1.36	0.02	0.00	0.00	5253
3:00 to 4:00	13.17	0.64	0.00	0.25	157.86	0.90	0.01	0.00	0.00	5231
4:00 to 5:00	13.19	0.75	0.00	0.27	158.17	1.05	0.02	0.00	0.00	5506
5:00 to 6:00	13.12	0.28	0.00	0.29	141.51	0.39	0.01	0.00	0.00	5737
Averages										
6:00 to 18:00	12.92	0.57	0.80	0.31	158.99	0.77	0.01	0.03	0.03	5851
18:00 to 6:00	13.12	0.67	0.00	0.28	157.24	0.94	0.02	0.00	0.00	5570
6:00 to 6:00	13.02	0.62	0.40	0.29	158.11	0.85	0.01	0.02	0.01	5710

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 2 , 2006
Report Printed on 11-03-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.37	1.63	9.55	0.33	123.88	2.34	0.05	0.48	0.13	6030
7:00 to 8:00	13.31	0.80	0.00	0.28	124.27	1.15	0.02	0.00	0.13	5625
8:00 to 9:00	13.19	0.63	0.00	0.28	156.12	0.89	0.01	0.00	0.13	5644
9:00 to 10:00	13.26	0.59	0.00	0.30	154.71	0.83	0.01	0.00	0.00	5762
10:00 to 11:00	13.32	0.71	0.00	0.20	154.76	1.02	0.02	0.00	0.00	4690
11:00 to 12:00	13.24	0.64	0.00	0.28	154.71	0.91	0.01	0.00	0.00	5576
12:00 to 13:00	13.16	0.93	0.00	0.31	154.72	1.30	0.02	0.00	0.00	5904
13:00 to 14:00	13.24	0.55	0.00	0.29	155.53	0.78	0.01	0.00	0.00	5663
14:00 to 15:00	13.37	0.28	0.00	0.27	155.24	0.40	0.01	0.00	0.00	5479
15:00 to 16:00	13.26	0.59	0.00	0.28	155.37	0.84	0.01	0.00	0.00	5581
16:00 to 17:00	13.21	0.72	0.00	0.28	156.03	1.01	0.02	0.00	0.00	5598
17:00 to 18:00	13.36	0.19	0.00	0.29	155.41	0.28	0.00	0.00	0.00	5676
18:00 to 19:00	13.34	0.97	0.00	0.29	155.56	1.40	0.02	0.00	0.00	5720
19:00 to 20:00	13.18	1.18	0.00	0.28	155.86	1.65	0.03	0.00	0.00	5584
20:00 to 21:00	13.28	0.83	0.00	0.32	155.22	1.18	0.02	0.00	0.00	5977
21:00 to 22:00	13.34	1.01	0.00	0.40	155.20	1.44	0.03	0.00	0.00	6654
22:00 to 23:00	13.27	1.13	0.00	0.33	156.29	1.61	0.03	0.00	0.00	6098
23:00 to 24:00	13.33	1.24	0.00	0.35	155.93	1.78	0.03	0.00	0.00	6212
0:00 to 1:00	13.27	0.50	0.00	0.44	155.98	0.71	0.01	0.00	0.00	7019
1:00 to 2:00	13.32	0.89	0.00	0.34	156.32	1.27	0.02	0.00	0.00	6064
2:00 to 3:00	13.30	0.72	0.00	0.29	155.84	1.03	0.02	0.00	0.00	5720
3:00 to 4:00	13.20	0.88	0.00	0.44	156.16	1.25	0.02	0.00	0.00	6980
4:00 to 5:00	13.28	0.57	0.00	0.25	156.56	0.81	0.01	0.00	0.00	5293
5:00 to 6:00	13.30	1.29	0.00	0.30	158.19	1.84	0.03	0.00	0.00	5911
Averages										
6:00 to 18:00	13.27	0.69	0.80	0.28	150.06	0.98	0.02	0.04	0.03	5602
18:00 to 6:00	13.28	0.93	0.00	0.34	156.09	1.33	0.02	0.00	0.00	6103
6:00 to 6:00	13.28	0.81	0.40	0.31	153.08	1.16	0.02	0.02	0.02	5852

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 3 , 2006
Report Printed on 11-04-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.07	3.37	7.62	0.29	157.33	4.67	0.05	0.22	0.06	5691
7:00 to 8:00	14.71 D	0.06 D	0.00 D	0.23	150.16	0.10 D	0.00	0.00	0.06	5082
8:00 to 9:00	12.74	0.82	4.70	0.30	157.86	1.10	0.02	0.21	0.13	5795
9:00 to 10:00	12.99	0.53	0.00	0.29	158.76	0.73	0.01	0.00	0.06	5664
10:00 to 11:00	12.70	0.64	0.00	0.35	160.06	0.85	0.02	0.00	0.06	6283
11:00 to 12:00	12.77	0.40	0.00	0.30	159.33	0.53	0.01	0.00	0.00	5760
12:00 to 13:00	12.83	0.62	0.00	0.26	158.86	0.83	0.01	0.00	0.00	5412
13:00 to 14:00	12.89	0.54	0.00	0.23	159.44	0.73	0.01	0.00	0.00	5089
14:00 to 15:00	12.81	0.57	0.00	0.27	158.64	0.77	0.01	0.00	0.00	5449
15:00 to 16:00	12.83	1.04	0.00	0.35	159.09	1.40	0.03	0.00	0.00	6245
16:00 to 17:00	12.85	1.14	0.00	0.40	159.32	1.53	0.03	0.00	0.00	6615
17:00 to 18:00	12.85	0.37	0.00	0.27	159.16	0.50	0.01	0.00	0.00	5472
18:00 to 19:00	12.94	0.79	0.00	0.33	159.05	1.09	0.02	0.00	0.00	6039
19:00 to 20:00	21.41 D	0.12 D	0.00 D	0.03	108.79	13.21 D	0.00	0.00	0.00	1437
20:00 to 21:00	21.55 D	0.04 D	0.00 D	0.00	75.31	4.31 D	0.00	0.00	0.00	582
21:00 to 22:00	21.53 D	0.04 D	0.01 D	0.00	66.64	4.51 D	0.00	0.00	0.00	589
22:00 to 23:00	21.49 D	0.04 D	0.38 D	0.00	64.52	4.02 D	0.00	0.00	0.00	591
23:00 to 24:00	21.46 D	0.05 D	0.92 D	0.00	62.95	4.99 D	0.00	0.00	0.00	592
0:00 to 1:00	21.44 D	0.04 D	1.15 D	0.00	62.11	4.14 D	0.00	0.00	0.00	585
1:00 to 2:00	21.40 D	0.04 D	1.21 D	0.06	62.62	4.01 D	0.00	0.00	0.00	2461
2:00 to 3:00	20.42 D	0.04 D	1.06 D	0.12	69.76	0.84 D	0.00	0.00	0.00	3722
3:00 to 4:00	19.01 D	0.05 D	0.39 D	0.14	97.49	0.25 D	0.00	0.00	0.00	4094
4:00 to 5:00	17.18 D	0.03 D	0.03 D	0.15	121.15	0.08 D	0.00	0.00	0.00	4061
5:00 to 6:00	16.17 D	0.05 D	0.00 D	0.16	134.21	0.10 D	0.00	0.00	0.00	4266
Averages										
6:00 to 18:00	12.85	0.91	1.12	0.30	158.17	1.13	0.02	0.04	0.03	5713
18:00 to 6:00	12.94 I	0.79 I	0.00 I	0.08	90.38	0.09	0.00	0.00	0.00	2418
6:00 to 6:00	12.86 I	0.90 I	1.03 I	0.19	124.28	0.61	0.01	0.02	0.02	4066

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 4 , 2006
Report Printed on 11-05-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	9.45 D	0.15 D	6.59 D	0.19	140.94	0.14 D	0.00	0.00	0.00	4540
7:00 to 8:00	12.55	0.57	0.00	0.27	158.68	0.74	0.01	0.00	0.00	5591
8:00 to 9:00	12.48	0.77	0.00	0.27	159.78	0.99	0.02	0.00	0.00	5551
9:00 to 10:00	12.43	0.40	0.00	0.28	159.92	0.51	0.01	0.00	0.00	5619
10:00 to 11:00	12.59	0.83	0.00	0.28	160.61	1.08	0.02	0.00	0.00	5753
11:00 to 12:00	12.55	0.77	0.00	0.29	160.21	1.01	0.01	0.00	0.00	5757
12:00 to 13:00	12.63	0.75	0.00	0.29	159.97	0.98	0.02	0.00	0.00	5763
13:00 to 14:00	12.74	0.65	0.00	0.26	160.04	0.86	0.01	0.00	0.00	5467
14:00 to 15:00	12.56	0.53	0.00	0.28	160.29	0.69	0.01	0.00	0.00	5703
15:00 to 16:00	12.53	0.63	0.00	0.27	160.08	0.82	0.01	0.00	0.00	5604
16:00 to 17:00	12.60	1.27	0.00	0.27	160.35	1.67	0.03	0.00	0.00	5525
17:00 to 18:00	12.83	0.19	3.68	0.27	160.19	0.26	0.00	0.13	0.04	5566
18:00 to 19:00	12.64	0.50	0.21	0.26	159.81	0.66	0.01	0.01	0.04	5359
19:00 to 20:00	12.77	0.20	0.00	0.26	160.75	0.27	0.00	0.00	0.04	5527
20:00 to 21:00	12.78	0.33	0.00	0.25	159.77	0.44	0.01	0.00	0.00	5325
21:00 to 22:00	12.53	0.56	0.00	0.28	160.17	0.72	0.01	0.00	0.00	5686
22:00 to 23:00	12.79	0.71	0.00	0.28	160.85	0.95	0.01	0.00	0.00	5695
23:00 to 24:00	12.74	0.55	0.00	0.27	160.34	0.73	0.01	0.00	0.00	5663
0:00 to 1:00	12.65	0.37	0.00	0.30	160.73	0.48	0.01	0.00	0.00	5913
1:00 to 2:00	12.67	0.43	0.00	0.34	160.72	0.57	0.01	0.00	0.00	6250
2:00 to 3:00	12.58	0.17	0.00	0.28	161.18	0.22	0.00	0.00	0.00	5744
3:00 to 4:00	12.67	0.35	0.00	0.36	160.93	0.46	0.01	0.00	0.00	6500
4:00 to 5:00	12.68	0.40	0.00	0.31	161.13	0.53	0.01	0.00	0.00	6037
5:00 to 6:00	12.66	1.01	0.00	0.30	160.60	1.33	0.02	0.00	0.00	5891
Averages										
6:00 to 18:00	12.59	0.67	0.33	0.27	158.42	0.80	0.01	0.01	0.00	5537
18:00 to 6:00	12.68	0.46	0.02	0.29	160.58	0.61	0.01	0.00	0.01	5799
6:00 to 6:00	12.64	0.56	0.17	0.28	159.50	0.71	0.01	0.01	0.00	5668

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 5 , 2006
Report Printed on 11-06-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.51	0.58	8.65	0.33	158.69	0.76	0.01	0.37	0.10	6046
7:00 to 8:00	12.63	0.58	0.01	0.33	159.34	0.76	0.01	0.00	0.10	6074
8:00 to 9:00	12.71	0.52	0.00	0.27	158.58	0.69	0.01	0.00	0.10	5537
9:00 to 10:00	12.63	0.63	0.00	0.30	159.13	0.83	0.01	0.00	0.00	5809
10:00 to 11:00	12.59	1.21	0.00	0.27	159.42	1.59	0.03	0.00	0.00	5471
11:00 to 12:00	12.64	0.63	0.00	0.27	158.38	0.83	0.01	0.00	0.00	5482
12:00 to 13:00	12.59	0.90	0.00	0.29	158.66	1.18	0.02	0.00	0.00	5641
13:00 to 14:00	12.68	0.87	0.00	0.27	158.91	1.15	0.02	0.00	0.00	5536
14:00 to 15:00	12.59	0.44	0.00	0.29	158.71	0.58	0.01	0.00	0.00	5642
15:00 to 16:00	12.70	0.73	0.00	0.27	158.61	0.97	0.02	0.00	0.00	5489
16:00 to 17:00	12.66	0.63	0.00	0.28	159.35	0.82	0.01	0.00	0.00	5598
17:00 to 18:00	12.81	0.58	0.00	0.27	158.83	0.78	0.01	0.00	0.00	5477
18:00 to 19:00	12.69	0.41	0.00	0.28	159.13	0.54	0.01	0.00	0.00	5551
19:00 to 20:00	12.75	0.35	0.00	0.29	159.72	0.47	0.01	0.00	0.00	5707
20:00 to 21:00	12.80	0.49	0.00	0.27	158.88	0.66	0.01	0.00	0.00	5493
21:00 to 22:00	12.66	0.36	0.00	0.25	158.60	0.48	0.01	0.00	0.00	5294
22:00 to 23:00	12.75	0.44	0.00	0.27	159.08	0.58	0.01	0.00	0.00	5440
23:00 to 24:00	12.79	0.17	0.00	0.26	158.29	0.23	0.00	0.00	0.00	5350
0:00 to 1:00	12.69	0.82	0.00	0.28	158.64	1.08	0.02	0.00	0.00	5623
1:00 to 2:00	12.77	0.09	0.00	0.25	158.76	0.12	0.00	0.00	0.00	5329
[illegible] 3:00	12.67	0.53	0.00	0.27	158.62	0.69	0.01	0.00	0.00	5533
3:00 to 4:00	12.76	0.69	0.00	0.27	158.12	0.92	0.02	0.00	0.00	5479
4:00 to 5:00	12.66	0.49	0.00	0.29	159.08	0.64	0.01	0.00	0.00	5666
5:00 to 6:00	12.76	1.12	0.00	0.21	159.89	1.50	0.02	0.00	0.00	4690
Averages										
6:00 to 18:00	12.64	0.69	0.72	0.29	158.88	0.91	0.02	0.03	0.03	5650
18:00 to 6:00	12.73	0.50	0.00	0.27	158.90	0.66	0.01	0.00	0.00	5430
6:00 to 6:00	12.69	0.59	0.36	0.28	158.89	0.79	0.01	0.02	0.01	5540

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 6 , 2006
Report Printed on 11-07-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.65	0.67	8.96	0.11	160.48	0.88	0.01	0.20	0.06	3507
7:00 to 8:00	12.63	0.83	0.00	0.17	160.87	1.09	0.01	0.00	0.06	4221
8:00 to 9:00	12.63	0.21	0.00	0.25	160.20	0.28	0.00	0.00	0.06	5395
9:00 to 10:00	12.51	0.51	0.00	0.29	160.75	0.67	0.01	0.00	0.00	5850
10:00 to 11:00	12.56	1.01	0.00	0.26	161.22	1.32	0.02	0.00	0.00	5562
11:00 to 12:00	12.58	0.49	0.00	0.28	160.96	0.64	0.01	0.00	0.00	5693
12:00 to 13:00	12.51	0.71	0.00	0.28	161.23	0.92	0.01	0.00	0.00	5747
13:00 to 14:00	12.49	0.85	0.00	0.27	161.27	1.10	0.02	0.00	0.00	5613
14:00 to 15:00	12.55	0.94	0.01	0.30	161.18	1.23	0.02	0.00	0.00	5962
15:00 to 16:00	12.67	0.41	0.01	0.20	160.93	0.55	0.01	0.00	0.00	4773
16:00 to 17:00	12.79	0.62	0.00	0.18	161.70	0.84	0.01	0.00	0.00	4296
17:00 to 18:00	12.78	0.97	0.00	0.27	160.72	1.30	0.02	0.00	0.00	5676
18:00 to 19:00	12.81	0.62	0.00	0.23	160.74	0.84	0.01	0.00	0.00	5081
19:00 to 20:00	12.80	0.48	0.00	0.16	160.88	0.64	0.00	0.00	0.00	4088
20:00 to 21:00	12.68	0.82	0.00	0.28	160.57	1.08	0.02	0.00	0.00	5692
21:00 to 22:00	12.61	0.65	0.00	0.31	160.88	0.85	0.01	0.00	0.00	6036
22:00 to 23:00	12.66	0.88	0.00	0.24	160.98	1.16	0.02	0.00	0.00	5308
23:00 to 24:00	12.87	1.43	0.00	0.29	160.93	1.94	0.03	0.00	0.00	5814
0:00 to 1:00	12.81	0.75	0.01	0.28	160.93	1.01	0.01	0.00	0.00	5697
1:00 to 2:00	12.71	0.68	0.01	0.29	161.62	0.90	0.01	0.00	0.00	5820
2:00 to 3:00	12.69	0.68	0.01	0.28	161.25	0.90	0.01	0.00	0.00	5713
3:00 to 4:00	12.75	1.02	0.01	0.29	160.85	1.36	0.02	0.00	0.00	5801
4:00 to 5:00	12.70	0.80	0.01	0.28	161.71	1.06	0.02	0.00	0.00	5778
5:00 to 6:00	12.85	0.75	0.00	0.26	161.04	1.01	0.01	0.00	0.00	5528
Averages										
6:00 to 18:00	12.61	0.69	0.75	0.24	160.96	0.90	0.01	0.02	0.01	5191
18:00 to 6:00	12.75	0.80	0.00	0.27	161.03	1.06	0.01	0.00	0.00	5530
6:00 to 6:00	12.68	0.74	0.38	0.25	160.99	0.98	0.01	0.01	0.01	5360

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 7 , 2006
Report Printed on 11-08-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.83	0.77	7.81	0.26	160.65	1.03	0.01	0.27	0.07	5546
7:00 to 8:00	13.03	1.05	0.00	0.29	160.71	1.45	0.02	0.00	0.07	5789
8:00 to 9:00	12.83	1.28	0.00	0.28	160.17	1.72	0.02	0.00	0.07	5656
9:00 to 10:00	12.82	0.63	0.00	0.28	160.36	0.85	0.01	0.00	0.00	5727
10:00 to 11:00	12.72	0.73	0.00	0.24	160.96	0.97	0.01	0.00	0.00	5285
11:00 to 12:00	12.61	0.70	0.00	0.27	161.25	0.92	0.01	0.00	0.00	5670
12:00 to 13:00	12.55	0.69	0.00	0.28	161.51	0.90	0.01	0.00	0.00	5700
13:00 to 14:00	12.57	0.39	0.00	0.26	161.61	0.51	0.01	0.00	0.00	5557
14:00 to 15:00	12.83	1.28	0.00	0.27	159.89	1.72	0.03	0.00	0.00	5531
15:00 to 16:00	13.03	0.07	0.00	0.27	159.77	0.09	0.00	0.00	0.00	5490
16:00 to 17:00	12.72	0.47	0.00	0.29	161.74	0.62	0.01	0.00	0.00	5858
17:00 to 18:00	12.54	0.20	0.00	0.28	161.20	0.26	0.00	0.00	0.00	5706
18:00 to 19:00	12.71	0.30	0.00	0.27	160.22	0.40	0.01	0.00	0.00	5516
19:00 to 20:00	12.89	0.44	0.00	0.29	160.73	0.60	0.01	0.00	0.00	5842
20:00 to 21:00	12.75	0.59	0.00	0.32	159.50	0.79	0.01	0.00	0.00	6009
21:00 to 22:00	12.72	0.32	0.00	0.36	159.96	0.43	0.01	0.00	0.00	6390
22:00 to 23:00	12.68	0.58	0.00	0.35	160.91	0.77	0.01	0.00	0.00	6375
23:00 to 24:00	12.75	0.61	0.00	0.28	160.20	0.81	0.01	0.00	0.00	5744
0:00 to 1:00	12.81	0.59	0.00	0.28	159.82	0.79	0.01	0.00	0.00	5630
1:00 to 2:00	12.79	0.45	0.00	0.27	160.36	0.61	0.01	0.00	0.00	5575
2:00 to 3:00	12.71	0.63	0.00	0.28	160.06	0.84	0.01	0.00	0.00	5714
3:00 to 4:00	12.90	0.51	0.00	0.28	159.83	0.69	0.01	0.00	0.00	5602
4:00 to 5:00	13.10	0.83	0.00	0.28	159.77	1.16	0.02	0.00	0.00	5650
5:00 to 6:00	13.69	0.09	0.00	0.27	157.66	0.13	0.00	0.00	0.00	5523
Averages										
6:00 to 18:00	12.75	0.69	0.65	0.27	160.82	0.92	0.01	0.02	0.02	5626
18:00 to 6:00	12.87	0.50	0.00	0.29	159.92	0.67	0.01	0.00	0.00	5797
6:00 to 6:00	12.81	0.59	0.33	0.28	160.37	0.80	0.01	0.01	0.01	5712

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 8 , 2006
Report Printed on 11-09-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	14.00	0.14	8.49	0.30	157.31	0.23	0.00	0.36	0.10	5763
7:00 to 8:00	13.70	0.05	0.00	0.29	158.94	0.08	0.00	0.00	0.10	5773
8:00 to 9:00	13.44	0.01	0.00	0.30	160.01	0.02	0.00	0.00	0.10	5888
9:00 to 10:00	13.48	0.02	0.00	0.32	159.78	0.02	0.00	0.00	0.00	6033
10:00 to 11:00	13.45	0.01	0.00	0.31	160.32	0.02	0.00	0.00	0.00	5986
11:00 to 12:00	13.21	0.02	0.00	0.32	160.91	0.03	0.00	0.00	0.00	6176
12:00 to 13:00	12.87	0.04	0.00	0.33	162.02	0.05	0.00	0.00	0.00	6263
13:00 to 14:00	12.76	0.58	0.00	0.32	162.82	0.77	0.01	0.00	0.00	6108
14:00 to 15:00	12.57	0.18	0.00	0.32	162.39	0.23	0.00	0.00	0.00	6128
15:00 to 16:00	12.53	0.46	0.00	0.29	161.70	0.59	0.01	0.00	0.00	5875
16:00 to 17:00	12.66	0.34	0.00	0.30	162.26	0.45	0.01	0.00	0.00	5896
17:00 to 18:00	12.84	0.35	0.00	0.30	161.74	0.47	0.01	0.00	0.00	5919
18:00 to 19:00	12.74	0.43	0.00	0.29	161.57	0.57	0.01	0.00	0.00	5876
19:00 to 20:00	12.77	0.04	0.00	0.29	161.73	0.05	0.00	0.00	0.00	5787
20:00 to 21:00	12.72	0.53	0.00	0.30	161.70	0.70	0.01	0.00	0.00	5926
21:00 to 22:00	12.69	0.35	0.00	0.28	161.15	0.47	0.01	0.00	0.00	5702
22:00 to 23:00	12.70	0.55	0.00	0.29	161.36	0.72	0.01	0.00	0.00	5846
23:00 to 24:00	12.74	0.49	0.00	0.28	160.88	0.65	0.01	0.00	0.00	5759
0:00 to 1:00	12.61	0.90	0.00	0.29	160.64	1.18	0.02	0.00	0.00	5847
1:00 to 2:00	12.60	0.35	0.00	0.28	160.97	0.46	0.01	0.00	0.00	5782
2:00 to 3:00	12.62	0.24	0.00	0.29	160.31	0.31	0.00	0.00	0.00	5866
3:00 to 4:00	12.70	0.32	0.00	0.28	159.82	0.42	0.01	0.00	0.00	5627
4:00 to 5:00	12.69	0.28	0.00	0.29	160.58	0.37	0.01	0.00	0.00	5796
5:00 to 6:00	12.67	0.17	0.00	0.29	160.07	0.22	0.00	0.00	0.00	5817
Averages										
6:00 to 18:00	13.13	0.18	0.71	0.31	160.85	0.26	0.00	0.03	0.02	5984
18:00 to 6:00	12.69	0.39	0.00	0.29	160.90	0.51	0.01	0.00	0.00	5803
6:00 to 6:00	12.91	0.28	0.35	0.30	160.87	0.39	0.01	0.01	0.01	5893

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 9 , 2006
Report Printed on 11-10-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.66	0.63	9.83	0.29	160.33	0.83	0.01	0.36	0.10	5813
7:00 to 8:00	12.76	0.40	0.01	0.27	159.28	0.54	0.01	0.00	0.10	5483
8:00 to 9:00	12.81	0.53	0.00	0.29	159.25	0.71	0.01	0.00	0.10	5714
9:00 to 10:00	12.74	0.65	0.00	0.29	159.39	0.87	0.01	0.00	0.00	5666
10:00 to 11:00	12.66	0.23	0.00	0.27	159.59	0.30	0.00	0.00	0.00	5552
11:00 to 12:00	12.70	0.54	0.00	0.29	159.25	0.72	0.01	0.00	0.00	5666
12:00 to 13:00	12.73	0.45	0.00	0.29	159.22	0.60	0.01	0.00	0.00	5667
13:00 to 14:00	12.69	0.40	0.00	0.29	160.19	0.53	0.01	0.00	0.00	5796
14:00 to 15:00	12.73	0.78	0.00	0.29	159.52	1.03	0.02	0.00	0.00	5643
15:00 to 16:00	12.70	0.76	0.00	0.29	159.65	1.01	0.02	0.00	0.00	5686
16:00 to 17:00	12.79	0.61	0.00	0.28	160.17	0.82	0.01	0.00	0.00	5636
17:00 to 18:00	12.61	0.31	0.00	0.28	159.88	0.41	0.01	0.00	0.00	5649
18:00 to 19:00	12.69	0.41	0.00	0.29	159.97	0.54	0.01	0.00	0.00	5750
19:00 to 20:00	12.74	0.13	0.00	0.27	160.20	0.17	0.00	0.00	0.00	5561
20:00 to 21:00	12.68	0.40	0.00	0.28	159.92	0.53	0.01	0.00	0.00	5581
21:00 to 22:00	12.77	0.40	0.00	0.29	159.84	0.53	0.01	0.00	0.00	5721
22:00 to 23:00	12.72	0.43	0.00	0.27	160.23	0.57	0.01	0.00	0.00	5581
23:00 to 24:00	12.68	0.54	0.00	0.29	159.86	0.72	0.01	0.00	0.00	5695
0:00 to 1:00	12.66	0.27	0.00	0.28	159.75	0.35	0.01	0.00	0.00	5599
1:00 to 2:00	12.66	0.79	0.00	0.29	160.53	1.04	0.02	0.00	0.00	5797
2:00 to 3:00	12.79	0.35	0.00	0.28	159.66	0.47	0.01	0.00	0.00	5604
3:00 to 4:00	12.66	0.30	0.00	0.29	159.75	0.40	0.01	0.00	0.00	5688
4:00 to 5:00	12.77	0.77	0.00	0.29	160.39	1.02	0.02	0.00	0.00	5770
5:00 to 6:00	12.78	0.55	0.00	0.30	160.05	0.74	0.01	0.00	0.00	5879
Averages										
6:00 to 18:00	12.71	0.52	0.82	0.28	159.64	0.70	0.01	0.03	0.02	5664
18:00 to 6:00	12.72	0.44	0.00	0.29	160.01	0.59	0.01	0.00	0.00	5685
6:00 to 6:00	12.72	0.48	0.41	0.29	159.83	0.64	0.01	0.01	0.01	5675

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 10 , 2006
Report Printed on 11-11-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.73	0.34	10.41	0.29	160.44	0.46	0.01	0.44	0.12	5804
7:00 to 8:00	12.65	0.34	0.00	0.29	160.63	0.45	0.01	0.00	0.12	5830
8:00 to 9:00	12.64	0.36	0.00	0.30	160.44	0.48	0.01	0.00	0.12	5899
9:00 to 10:00	12.59	0.19	0.00	0.29	160.14	0.25	0.00	0.00	0.00	5762
10:00 to 11:00	12.59	0.40	0.00	0.30	161.06	0.53	0.01	0.00	0.00	5914
11:00 to 12:00	12.67	0.62	0.00	0.26	160.38	0.81	0.01	0.00	0.00	5411
12:00 to 13:00	12.58	0.61	0.00	0.22	160.35	0.79	0.01	0.00	0.00	5089
13:00 to 14:00	12.55	0.33	0.00	0.29	161.11	0.43	0.01	0.00	0.00	5815
14:00 to 15:00	12.49	0.69	0.00	0.29	160.62	0.89	0.01	0.00	0.00	5834
15:00 to 16:00	12.62	0.79	0.00	0.29	160.59	1.03	0.02	0.00	0.00	5875
16:00 to 17:00	12.65	0.65	0.00	0.28	160.66	0.85	0.01	0.00	0.00	5713
17:00 to 18:00	12.59	0.50	0.00	0.29	160.67	0.65	0.01	0.00	0.00	5832
18:00 to 19:00	12.72	0.10	0.00	0.29	160.09	0.14	0.00	0.00	0.00	5781
19:00 to 20:00	12.73	0.25	0.00	0.28	160.50	0.33	0.00	0.00	0.00	5612
20:00 to 21:00	12.73	0.45	0.00	0.31	160.36	0.60	0.01	0.00	0.00	5998
21:00 to 22:00	12.69	0.34	0.00	0.28	159.87	0.45	0.01	0.00	0.00	5700
22:00 to 23:00	12.68	0.48	0.00	0.29	160.49	0.64	0.01	0.00	0.00	5854
23:00 to 24:00	12.69	0.26	0.00	0.29	159.99	0.34	0.01	0.00	0.00	5734
0:00 to 1:00	12.56	0.29	0.00	0.28	159.95	0.37	0.01	0.00	0.00	5638
1:00 to 2:00	12.75	0.56	0.00	0.29	160.15	0.75	0.01	0.00	0.00	5727
2:00 to 3:00	12.87	0.49	0.00	0.30	159.87	0.67	0.01	0.00	0.00	5772
3:00 to 4:00	12.77	0.57	0.00	0.29	159.87	0.76	0.01	0.00	0.00	5759
4:00 to 5:00	12.74	0.29	0.00	0.27	160.04	0.39	0.01	0.00	0.00	5573
5:00 to 6:00	12.81	0.48	0.00	0.29	159.61	0.64	0.01	0.00	0.00	5654
Averages										
6:00 to 18:00	12.61	0.48	0.87	0.28	160.59	0.64	0.01	0.04	0.03	5731
18:00 to 6:00	12.73	0.38	0.00	0.29	160.07	0.51	0.01	0.00	0.00	5733
6:00 to 6:00	12.67	0.43	0.43	0.28	160.33	0.57	0.01	0.02	0.01	5732

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 11 , 2006
Report Printed on 11-12-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.54	0.30	9.25	0.28	145.86	0.39	0.01	0.40	0.11	5584
7:00 to 8:00	12.64	0.72	0.01	0.28	143.63	0.95	0.02	0.00	0.11	5672
8:00 to 9:00	12.66	0.57	0.00	0.29	159.03	0.75	0.01	0.00	0.11	5655
9:00 to 10:00	12.62	0.37	0.00	0.28	158.85	0.48	0.01	0.00	0.00	5635
10:00 to 11:00	12.62	0.58	0.00	0.29	159.51	0.76	0.01	0.00	0.00	5726
11:00 to 12:00	12.70	0.35	0.00	0.27	158.57	0.47	0.01	0.00	0.00	5503
12:00 to 13:00	12.71	0.40	0.00	0.30	158.95	0.54	0.01	0.00	0.00	5736
13:00 to 14:00	12.71	0.38	0.00	0.26	158.96	0.51	0.01	0.00	0.00	5417
14:00 to 15:00	12.74	0.41	0.00	0.28	158.70	0.55	0.01	0.00	0.00	5635
15:00 to 16:00	12.59	0.45	0.00	0.28	158.83	0.58	0.01	0.00	0.00	5538
16:00 to 17:00	12.63	0.21	0.00	0.26	159.19	0.28	0.00	0.00	0.00	5412
17:00 to 18:00	12.60	0.83	0.00	0.28	159.22	1.09	0.02	0.00	0.00	5629
18:00 to 19:00	12.77	0.23	0.00	0.27	158.84	0.31	0.01	0.00	0.00	5530
19:00 to 20:00	12.66	0.36	0.00	0.28	159.58	0.47	0.01	0.00	0.00	5593
20:00 to 21:00	12.67	0.63	0.00	0.28	159.04	0.83	0.01	0.00	0.00	5625
21:00 to 22:00	12.71	0.30	0.00	0.28	159.06	0.40	0.01	0.00	0.00	5594
22:00 to 23:00	12.65	0.87	0.00	0.29	159.75	1.14	0.02	0.00	0.00	5780
23:00 to 24:00	12.69	0.23	0.00	0.27	158.78	0.30	0.00	0.00	0.00	5448
0:00 to 1:00	12.59	0.47	0.00	0.29	159.32	0.61	0.01	0.00	0.00	5649
1:00 to 2:00	12.63	0.21	0.00	0.27	159.77	0.28	0.00	0.00	0.00	5531
2:00 to 3:00	12.56	0.40	0.00	0.28	159.42	0.52	0.01	0.00	0.00	5632
3:00 to 4:00	12.67	0.30	0.00	0.29	159.30	0.40	0.01	0.00	0.00	5649
4:00 to 5:00	12.53	0.31	0.00	0.28	159.98	0.40	0.01	0.00	0.00	5620
5:00 to 6:00	12.53	0.23	0.00	0.28	159.59	0.29	0.01	0.00	0.00	5555
Averages										
6:00 to 18:00	12.65	0.46	0.77	0.28	156.61	0.61	0.01	0.03	0.03	5595
18:00 to 6:00	12.64	0.38	0.00	0.28	159.37	0.50	0.01	0.00	0.00	5601
6:00 to 6:00	12.64	0.42	0.39	0.28	157.99	0.55	0.01	0.02	0.01	5598

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 12 , 2006
Report Printed on 11-13-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.76	0.27	8.77	0.28	160.44	0.36	0.01	0.36	0.10	5678
7:00 to 8:00	12.59	0.46	0.01	0.29	161.47	0.60	0.01	0.00	0.10	5788
8:00 to 9:00	12.79	0.61	0.00	0.27	160.46	0.82	0.01	0.00	0.10	5621
9:00 to 10:00	12.75	0.05	0.00	0.27	159.79	0.06	0.00	0.00	0.00	5567
10:00 to 11:00	12.80	0.83	0.00	0.28	160.32	1.12	0.02	0.00	0.00	5698
11:00 to 12:00	12.82	0.47	0.00	0.27	159.86	0.63	0.01	0.00	0.00	5605
12:00 to 13:00	12.71	0.27	0.00	0.27	159.80	0.36	0.01	0.00	0.00	5563
13:00 to 14:00	12.72	0.65	0.00	0.29	160.85	0.86	0.01	0.00	0.00	5820
14:00 to 15:00	12.83	0.39	0.00	0.27	160.08	0.53	0.01	0.00	0.00	5618
15:00 to 16:00	12.86	0.26	0.00	0.29	159.88	0.35	0.01	0.00	0.00	5777
16:00 to 17:00	12.88	0.05	0.00	0.28	160.45	0.07	0.00	0.00	0.00	5717
17:00 to 18:00	13.02	0.48	0.00	0.28	160.08	0.66	0.01	0.00	0.00	5736
18:00 to 19:00	13.04	0.32	0.00	0.29	160.12	0.45	0.01	0.00	0.00	5767
19:00 to 20:00	12.91	0.34	0.00	0.29	160.39	0.46	0.01	0.00	0.00	5780
20:00 to 21:00	12.93	0.67	0.00	0.29	159.78	0.91	0.01	0.00	0.00	5705
21:00 to 22:00	12.80	0.61	0.00	0.29	159.84	0.81	0.01	0.00	0.00	5672
22:00 to 23:00	12.69	0.64	0.00	0.30	160.52	0.85	0.01	0.00	0.00	5852
23:00 to 24:00	12.89	0.50	0.00	0.29	159.70	0.67	0.01	0.00	0.00	5712
0:00 to 1:00	12.80	0.60	0.00	0.29	159.65	0.81	0.01	0.00	0.00	5749
1:00 to 2:00	13.04	0.30	0.00	0.29	159.94	0.42	0.01	0.00	0.00	5756
2:00 to 3:00	12.97	0.10	0.00	0.29	159.40	0.14	0.00	0.00	0.00	5665
3:00 to 4:00	12.96	0.29	0.00	0.29	158.72	0.40	0.01	0.00	0.00	5725
4:00 to 5:00	12.97	0.93	0.00	0.32	159.35	1.27	0.02	0.00	0.00	5963
5:00 to 6:00	12.77	0.55	0.00	0.32	158.68	0.73	0.01	0.00	0.00	5985
Averages										
6:00 to 18:00	12.79	0.40	0.73	0.28	160.29	0.54	0.01	0.03	0.02	5682
18:00 to 6:00	12.90	0.49	0.00	0.30	159.67	0.66	0.01	0.00	0.00	5778
6:00 to 6:00	12.85	0.44	0.37	0.29	159.98	0.60	0.01	0.01	0.01	5730

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 13 , 2006
Report Printed on 11-14-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.65	1.92	10.19	0.23	159.23	2.52	0.04	0.43	0.12	4964
7:00 to 8:00	12.76	0.90	0.02	0.33	159.21	1.20	0.02	0.00	0.12	6015
8:00 to 9:00	13.12	0.11	0.00	0.30	158.62	0.15	0.00	0.00	0.12	5759
9:00 to 10:00	13.07	0.24	0.00	0.32	158.72	0.33	0.01	0.00	0.00	5961
10:00 to 11:00	12.97	0.38	0.00	0.32	159.94	0.52	0.01	0.00	0.00	6058
11:00 to 12:00	13.03	0.10	0.00	0.29	159.92	0.14	0.00	0.00	0.00	5745
12:00 to 13:00	12.95	0.26	0.00	0.29	159.94	0.35	0.01	0.00	0.00	5772
13:00 to 14:00	12.86	0.32	0.00	0.30	160.45	0.43	0.01	0.00	0.00	5833
14:00 to 15:00	12.77	0.25	0.00	0.28	159.72	0.33	0.01	0.00	0.00	5632
15:00 to 16:00	12.75	0.32	0.00	0.29	159.72	0.43	0.01	0.00	0.00	5651
16:00 to 17:00	12.77	0.72	0.00	0.29	159.63	0.96	0.02	0.00	0.00	5694
17:00 to 18:00	12.78	0.68	0.00	0.28	159.09	0.91	0.02	0.00	0.00	5609
18:00 to 19:00	12.71	0.81	0.00	0.31	159.20	1.07	0.02	0.00	0.00	5878
19:00 to 20:00	12.81	0.94	0.00	0.31	159.52	1.26	0.02	0.00	0.00	5891
20:00 to 21:00	12.80	0.78	0.00	0.34	159.43	1.05	0.02	0.00	0.00	6099
21:00 to 22:00	12.75	0.61	0.00	0.33	159.42	0.81	0.02	0.00	0.00	5996
22:00 to 23:00	12.82	0.14	0.00	0.30	159.70	0.19	0.00	0.00	0.00	5763
23:00 to 24:00	12.87	0.43	0.00	0.28	159.15	0.58	0.01	0.00	0.00	5577
0:00 to 1:00	12.75	0.83	0.00	0.28	159.38	1.11	0.02	0.00	0.00	5608
1:00 to 2:00	12.80	0.38	0.00	0.31	158.88	0.51	0.01	0.00	0.00	5853
[illegible] 3:00	12.92	0.77	0.00	0.41	158.38	1.05	0.02	0.00	0.00	6726
3:00 to 4:00	12.68	0.51	0.00	0.74	158.26	0.67	0.02	0.00	0.00	9073
4:00 to 5:00	12.80	1.18	0.00	0.74	159.13	1.58	0.03	0.00	0.00	8742
5:00 to 6:00	12.83	0.05	0.00	0.32	158.55	0.07	0.00	0.00	0.00	5980
Averages										
6:00 to 18:00	12.87	0.51	0.85	0.29	159.52	0.70	0.01	0.04	0.03	5725
18:00 to 6:00	12.80	0.62	0.00	0.39	159.08	0.83	0.02	0.00	0.00	6432
6:00 to 6:00	12.83	0.57	0.43	0.34	159.30	0.76	0.01	0.02	0.01	6078

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 14 , 2006
Report Printed on 11-15-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.81	0.56	9.57	0.35	158.65	0.75	0.01	0.47	0.13	6195
7:00 to 8:00	12.69	0.86	0.01	0.41	158.65	1.14	0.02	0.00	0.13	6669
8:00 to 9:00	12.73	0.30	0.00	0.29	158.42	0.40	0.01	0.00	0.13	5670
9:00 to 10:00	12.66	0.42	0.00	0.34	158.53	0.55	0.01	0.00	0.00	6150
10:00 to 11:00	8.45 C	1.19 C	7.23 C	0.25	158.66	1.04 C	0.03 C	0.29 C	0.00 I	5325
11:00 to 12:00	12.63	0.20	2.19	0.29	158.79	0.27	0.00	0.09	0.06 I	5638
12:00 to 13:00	12.62	0.40	0.00	0.26	158.99	0.52	0.01	0.00	0.05 I	5431
13:00 to 14:00	12.63	0.05	0.00	0.26	159.41	0.07	0.00	0.00	0.03	5379
14:00 to 15:00	12.75	0.03	0.00	0.25	158.99	0.04	0.00	0.00	0.00	5251
15:00 to 16:00	12.87	0.05	0.00	0.26	159.29	0.06	0.00	0.00	0.00	5403
16:00 to 17:00	12.79	0.03	0.00	0.25	159.95	0.04	0.00	0.00	0.00	5294
17:00 to 18:00	12.78	0.03	0.00	0.25	159.54	0.04	0.00	0.00	0.00	5312
18:00 to 19:00	12.83	0.14	0.00	0.27	159.30	0.19	0.00	0.00	0.00	5473
19:00 to 20:00	12.94	0.58	0.00	0.28	160.13	0.79	0.01	0.00	0.00	5705
20:00 to 21:00	12.98	0.30	0.00	0.29	159.23	0.42	0.01	0.00	0.00	5648
21:00 to 22:00	12.86	0.69	0.00	0.30	159.21	0.94	0.02	0.00	0.00	5803
22:00 to 23:00	12.92	0.62	0.00	0.24	159.43	0.85	0.01	0.00	0.00	5160
23:00 to 24:00	12.92	1.03	0.00	0.15	159.32	1.41	0.02	0.00	0.00	3764
0:00 to 1:00	12.73	0.63	0.00	0.21	158.61	0.84	0.01	0.00	0.00	4205
1:[illegible] to 2:00	12.85	0.54	0.00	0.21	159.20	0.73	0.01	0.00	0.00	4740
2[illegible] 3:00	12.86	0.83	0.00	0.25	158.63	1.12	0.02	0.00	0.00	5030
3:00 to 4:00	13.00	1.23	0.00	0.09	158.70	1.70	0.01	0.00	0.00	2989
4:00 to 5:00	12.86	0.86	0.00	0.22	158.93	1.17	0.01	0.00	0.00	4667
5:00 to 6:00	12.75	0.68	0.00	0.29	158.55	0.91	0.02	0.00	0.00	5704
Averages										
6:00 to 18:00	12.72	0.27	1.07	0.29	158.99	0.35	0.01	0.05	0.04	5643
18:00 to 6:00	12.87	0.68	0.00	0.23	159.10	0.92	0.01	0.00	0.00	4907
6:00 to 6:00	12.80	0.48	0.51	0.26	159.05	0.65	0.01	0.02	0.02	5275

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 15 , 2006
Report Printed on 11-16-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.11	1.93	9.20	0.21	155.51	2.70	0.02	0.19	0.05	4733
7:00 to 8:00	12.88	0.32	0.00	0.25	153.58	0.43	0.01	0.00	0.05	5249
8:00 to 9:00	12.83	1.01	0.00	0.28	158.42	1.35	0.02	0.00	0.05	5605
9:00 to 10:00	12.89	0.43	0.00	0.06	158.48	0.58	0.01	0.00	0.00	2156
10:00 to 11:00	12.68	0.19	0.00	0.31	158.55	0.25	0.00	0.00	0.00	5849
11:00 to 12:00	12.77	0.66	0.00	0.22	159.17	0.88	0.01	0.00	0.00	4864
12:00 to 13:00	12.62	0.77	0.00	0.18	159.11	1.01	0.01	0.00	0.00	4359
13:00 to 14:00	12.62	1.01	0.00	0.29	159.68	1.33	0.02	0.00	0.00	5636
14:00 to 15:00	12.65	0.64	0.00	0.25	158.98	0.84	0.01	0.00	0.00	5153
15:00 to 16:00	12.75	0.94	0.00	0.18	159.29	1.25	0.02	0.00	0.00	4240
16:00 to 17:00	12.81	0.88	0.00	0.29	159.59	1.19	0.02	0.00	0.00	5704
17:00 to 18:00	12.81	1.06	0.00	0.29	159.15	1.42	0.02	0.00	0.00	5660
18:00 to 19:00	12.77	0.89	0.00	0.28	158.82	1.19	0.02	0.00	0.00	5320
19:00 to 20:00	12.82	0.97	0.00	0.33	158.84	1.30	0.02	0.00	0.00	6057
20:00 to 21:00	12.85	1.01	0.00	0.26	158.52	1.36	0.02	0.00	0.00	5351
21:00 to 22:00	13.05	0.34	0.00	0.09	157.99	0.47	0.00	0.00	0.00	3044
22:00 to 23:00	12.91	0.60	0.00	0.25	158.99	0.82	0.01	0.00	0.00	5245
23:00 to 24:00	12.88	0.75	0.00	0.38	158.38	1.01	0.02	0.00	0.00	6484
0:00 to 1:00	12.85	1.15	0.00	0.46	158.38	1.55	0.03	0.00	0.00	7187
1:00 to 2:00	12.89	0.60	0.00	0.36	159.07	0.81	0.01	0.00	0.00	6343
[illegible] 3:00	12.98	0.48	0.00	0.34	158.46	0.66	0.01	0.00	0.00	6139
3:00 to 4:00	13.00	0.57	0.00	0.38	158.92	0.78	0.01	0.00	0.00	6473
4:00 to 5:00	12.98	0.56	0.00	0.33	159.47	0.77	0.01	0.00	0.00	6063
5:00 to 6:00	13.16	1.22	0.00	0.36	158.76	1.71	0.03	0.00	0.00	6302
Averages										
6:00 to 18:00	12.78	0.82	0.77	0.23	158.29	1.10	0.02	0.02	0.01	4934
18:00 to 6:00	12.93	0.76	0.00	0.32	158.72	1.04	0.02	0.00	0.00	5834
6:00 to 6:00	12.86	0.79	0.38	0.28	158.50	1.07	0.02	0.01	0.01	5384

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 16 , 2006
Report Printed on 11-17-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.21	0.36	9.36	0.51	159.63	0.50	0.01	0.60	0.16	7217
7:00 to 8:00	13.20	0.63	0.00	0.21	159.71	0.89	0.01	0.00	0.16	4535
8:00 to 9:00	13.04	1.35	0.00	0.37	159.68	1.87	0.03	0.00	0.16	6424
9:00 to 10:00	12.95	0.86	0.00	0.35	159.47	1.18	0.02	0.00	0.00	6183
10:00 to 11:00	12.93	0.61	0.00	0.39	160.21	0.83	0.02	0.00	0.00	6637
11:00 to 12:00	12.98	0.67	0.00	0.31	159.68	0.92	0.02	0.00	0.00	5918
12:00 to 13:00	13.05	0.36	0.00	0.31	159.52	0.49	0.01	0.00	0.00	5916
13:00 to 14:00	12.92	0.99	0.00	0.33	160.83	1.35	0.02	0.00	0.00	6208
14:00 to 15:00	13.00	1.59	0.00	0.32	160.48	2.19	0.03	0.00	0.00	6144
15:00 to 16:00	12.91	0.78	0.00	0.41	160.25	1.07	0.02	0.00	0.00	6855
16:00 to 17:00	13.15	1.08	0.00	0.33	160.76	1.52	0.02	0.00	0.00	6239
17:00 to 18:00	13.16	0.38	0.00	0.31	160.03	0.53	0.01	0.00	0.00	5998
18:00 to 19:00	13.21	1.14	0.00	0.39	160.01	1.61	0.03	0.00	0.00	6697
19:00 to 20:00	13.21	0.54	0.00	0.40	160.80	0.76	0.01	0.00	0.00	6778
20:00 to 21:00	13.24	0.35	0.00	0.34	160.22	0.50	0.01	0.00	0.00	6248
21:00 to 22:00	13.17	0.96	0.00	0.38	159.75	1.34	0.02	0.00	0.00	6527
22:00 to 23:00	13.24	0.09	0.00	0.35	160.23	0.13	0.00	0.00	0.00	6322
23:00 to 24:00	13.23	0.12	0.00	0.31	159.50	0.17	0.00	0.00	0.00	5918
0:00 to 1:00	13.36	0.03	0.00	0.31	159.55	0.04	0.00	0.00	0.00	5922
1:00 to 2:00	13.25	0.02	0.00	0.32	160.08	0.03	0.00	0.00	0.00	6014
2:00 to 3:00	13.28	0.02	0.00	0.32	159.67	0.03	0.00	0.00	0.00	5939
3:00 to 4:00	13.09	0.02	0.00	0.33	159.70	0.03	0.00	0.00	0.00	6025
4:00 to 5:00	13.23	0.02	0.00	0.32	159.79	0.02	0.00	0.00	0.00	6043
5:00 to 6:00	13.08	0.02	0.00	0.33	159.61	0.03	0.00	0.00	0.00	6080
Averages										
6:00 to 18:00	13.04	0.81	0.78	0.35	160.02	1.11	0.02	0.05	0.04	6189
18:00 to 6:00	13.22	0.28	0.00	0.34	159.91	0.39	0.01	0.00	0.00	6209
6:00 to 6:00	13.13	0.54	0.39	0.34	159.96	0.76	0.01	0.03	0.02	6199

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 17 , 2006
Report Printed on 11-18-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.23	0.04	9.47	0.32	159.16	0.06	0.00	0.43	0.12	5955
7:00 to 8:00	13.14	0.03	0.00	0.32	159.52	0.04	0.00	0.00	0.12	6043
8:00 to 9:00	13.23	0.02	0.00	0.32	158.94	0.03	0.00	0.00	0.12	5969
9:00 to 10:00	13.26	0.01	0.00	0.32	158.76	0.02	0.00	0.00	0.00	6017
10:00 to 11:00	13.12	0.02	0.00	0.32	159.51	0.02	0.00	0.00	0.00	6018
11:00 to 12:00	13.09	0.02	0.00	0.33	159.35	0.02	0.00	0.00	0.00	6030
12:00 to 13:00	13.23	0.02	0.00	0.33	158.78	0.03	0.00	0.00	0.00	6056
13:00 to 14:00	12.72	0.03	0.00	0.33	160.45	0.03	0.00	0.00	0.00	6180
14:00 to 15:00	12.80	0.32	0.00	0.27	160.69	0.44	0.01	0.00	0.00	5364
15:00 to 16:00	12.83	0.32	0.00	0.39	159.48	0.44	0.01	0.00	0.00	6559
16:00 to 17:00	12.78	0.86	0.00	0.38	160.38	1.15	0.02	0.00	0.00	6656
17:00 to 18:00	12.97	0.59	0.00	0.31	159.75	0.81	0.01	0.00	0.00	5934
18:00 to 19:00	12.92	0.58	0.00	0.32	159.43	0.79	0.01	0.00	0.00	5927
19:00 to 20:00	12.90	0.13	0.00	0.30	159.76	0.17	0.00	0.00	0.00	5807
20:00 to 21:00	12.87	0.62	0.00	0.31	159.18	0.84	0.01	0.00	0.00	5836
21:00 to 22:00	12.84	0.31	0.00	0.35	159.21	0.42	0.01	0.00	0.00	6214
22:00 to 23:00	12.78	0.21	0.00	0.30	159.53	0.29	0.01	0.00	0.00	5773
23:00 to 24:00	12.83	0.52	0.00	0.29	159.05	0.70	0.01	0.00	0.00	5629
0:00 to 1:00	12.75	0.44	0.00	0.38	158.77	0.58	0.01	0.00	0.00	6482
1:00 to 2:00	12.89	0.74	0.00	0.33	159.39	1.00	0.02	0.00	0.00	6095
2:00 to 3:00	12.89	0.70	0.00	0.31	158.62	0.95	0.02	0.00	0.00	5923
3:00 to 4:00	12.95	0.56	0.00	0.35	158.41	0.76	0.01	0.00	0.00	6237
4:00 to 5:00	12.78	0.69	0.00	0.35	158.92	0.92	0.02	0.00	0.00	6204
5:00 to 6:00	12.93	0.58	0.00	0.30	158.10	0.79	0.01	0.00	0.00	5754
Averages										
6:00 to 18:00	13.03	0.19	0.79	0.33	159.56	0.26	0.00	0.04	0.03	6065
18:00 to 6:00	12.86	0.51	0.00	0.32	159.03	0.68	0.01	0.00	0.00	5990
6:00 to 6:00	12.95	0.35	0.39	0.33	159.30	0.48	0.01	0.02	0.01	6028

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 18 , 2006
Report Printed on 11-19-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.79	0.20	9.48	0.31	158.70	0.26	0.00	0.43	0.12	5877
7:00 to 8:00	12.75	0.62	0.01	0.31	158.86	0.82	0.01	0.00	0.12	5895
8:00 to 9:00	12.73	1.01	0.00	0.40	158.76	1.34	0.03	0.00	0.12	6625
9:00 to 10:00	12.74	0.82	0.00	0.36	158.30	1.09	0.02	0.00	0.00	6330
10:00 to 11:00	12.79	0.47	0.00	0.27	158.82	0.63	0.01	0.00	0.00	5424
11:00 to 12:00	12.72	0.58	0.00	0.25	158.67	0.77	0.01	0.00	0.00	5239
12:00 to 13:00	12.78	0.51	0.00	0.21	158.71	0.68	0.01	0.00	0.00	4730
13:00 to 14:00	12.58	0.78	0.00	0.23	159.67	1.02	0.01	0.00	0.00	5015
14:00 to 15:00	12.62	0.76	0.00	0.31	159.25	1.00	0.02	0.00	0.00	5897
15:00 to 16:00	12.60	0.56	0.00	0.27	159.22	0.73	0.01	0.00	0.00	5422
16:00 to 17:00	12.76	0.34	0.00	0.27	159.45	0.45	0.01	0.00	0.00	5570
17:00 to 18:00	12.71	1.15	0.00	0.30	159.26	1.53	0.03	0.00	0.00	5788
18:00 to 19:00	12.82	0.27	0.00	0.29	159.05	0.36	0.01	0.00	0.00	5645
19:00 to 20:00	12.75	1.10	0.00	0.26	159.63	1.47	0.02	0.00	0.00	5408
20:00 to 21:00	12.81	1.27	0.00	0.24	159.49	1.71	0.03	0.00	0.00	5154
21:00 to 22:00	12.89	0.59	0.00	0.11	159.12	0.79	0.01	0.00	0.00	3444
22:00 to 23:00	12.74	0.97	0.00	0.21	159.88	1.29	0.02	0.00	0.00	4794
23:00 to 24:00	12.76	0.65	0.00	0.32	159.53	0.87	0.01	0.00	0.00	6011
0:00 to 1:00	12.80	0.95	0.00	0.32	159.43	1.27	0.02	0.00	0.00	5971
1:00 to 2:00	12.85	0.99	0.00	0.23	159.92	1.34	0.02	0.00	0.00	5102
[illegible] 3:00	12.87	0.47	0.00	0.30	159.00	0.64	0.01	0.00	0.00	5793
3:00 to 4:00	12.81	0.85	0.00	0.34	159.03	1.14	0.02	0.00	0.00	6132
4:00 to 5:00	12.79	0.41	0.00	0.24	159.21	0.55	0.01	0.00	0.00	5128
5:00 to 6:00	12.69	1.09	0.00	0.31	158.74	1.45	0.03	0.00	0.00	5860
Averages										
6:00 to 18:00	12.71	0.65	0.79	0.29	158.97	0.86	0.01	0.04	0.03	5651
18:00 to 6:00	12.80	0.80	0.00	0.26	159.34	1.07	0.02	0.00	0.00	5370
6:00 to 6:00	12.76	0.73	0.40	0.28	159.15	0.97	0.02	0.02	0.01	5511

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 19 , 2006
Report Printed on 11-20-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.83	0.34	9.34	0.25	158.99	0.46	0.01	0.40	0.11	5282
7:00 to 8:00	12.87	0.57	0.00	0.29	159.27	0.76	0.01	0.00	0.11	5652
8:00 to 9:00	12.88	0.72	0.00	0.30	158.76	0.97	0.02	0.00	0.11	5760
9:00 to 10:00	12.78	0.80	0.00	0.29	158.52	1.08	0.02	0.00	0.00	5610
10:00 to 11:00	12.84	1.26	0.00	0.23	159.29	1.70	0.02	0.00	0.00	5110
11:00 to 12:00	12.88	0.52	0.00	0.19	158.64	0.70	0.01	0.00	0.00	4474
12:00 to 13:00	12.80	0.75	0.00	0.21	158.77	1.00	0.01	0.00	0.00	4409
13:00 to 14:00	12.86	0.70	0.00	0.27	159.34	0.95	0.01	0.00	0.00	5491
14:00 to 15:00	12.91	0.32	0.00	0.31	159.04	0.43	0.01	0.00	0.00	5888
15:00 to 16:00	13.02	0.77	0.00	0.37	158.43	1.06	0.02	0.00	0.00	6370
16:00 to 17:00	13.03	0.24	0.00	0.32	158.99	0.33	0.01	0.00	0.00	5944
17:00 to 18:00	12.90	0.98	0.00	0.29	159.25	1.33	0.02	0.00	0.00	5666
18:00 to 19:00	12.92	0.20	0.00	0.39	158.47	0.28	0.00	0.00	0.00	6566
19:00 to 20:00	12.85	0.88	0.00	0.37	158.91	1.18	0.02	0.00	0.00	6353
20:00 to 21:00	13.07	0.45	0.00	0.23	158.50	0.62	0.01	0.00	0.00	4919
21:00 to 22:00	12.95	0.39	0.00	0.28	158.93	0.54	0.01	0.00	0.00	5444
22:00 to 23:00	12.79	0.62	0.00	0.35	159.68	0.83	0.01	0.00	0.00	6298
23:00 to 24:00	12.79	0.96	0.00	0.34	159.33	1.29	0.02	0.00	0.00	6117
0:00 to 1:00	12.72	0.76	0.00	0.33	159.28	1.00	0.02	0.00	0.00	6020
1:00 to 2:00	12.90	0.11	0.00	0.21	159.67	0.15	0.00	0.00	0.00	4634
2:00 to 3:00	12.80	0.72	0.00	0.33	159.25	0.97	0.02	0.00	0.00	6094
3:00 to 4:00	12.82	0.40	0.00	0.23	159.33	0.54	0.01	0.00	0.00	4964
4:00 to 5:00	12.76	0.46	0.00	0.27	160.13	0.62	0.01	0.00	0.00	5544
5:00 to 6:00	12.80	0.74	0.00	0.32	159.56	1.00	0.02	0.00	0.00	5986
Averages										
6:00 to 18:00	12.88	0.66	0.78	0.28	158.94	0.90	0.01	0.03	0.03	5471
18:00 to 6:00	12.85	0.56	0.00	0.30	159.25	0.75	0.01	0.00	0.00	5745
6:00 to 6:00	12.87	0.61	0.39	0.29	159.10	0.83	0.01	0.02	0.01	5608

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 20 , 2006
Report Printed on 11-21-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.83	0.61	9.24	0.30	159.51	0.82	0.01	0.38	0.10	5842
7:00 to 8:00	12.76	0.63	0.00	0.29	159.60	0.84	0.01	0.00	0.10	5768
8:00 to 9:00	12.89	0.22	0.00	0.29	158.78	0.30	0.00	0.00	0.10	5712
9:00 to 10:00	12.87	0.59	0.00	0.36	159.03	0.79	0.01	0.00	0.00	6318
10:00 to 11:00	12.83	1.11	0.00	0.30	159.75	1.49	0.03	0.00	0.00	5860
11:00 to 12:00	12.75	0.82	0.00	0.31	159.49	1.09	0.02	0.00	0.00	5846
12:00 to 13:00	12.77	1.12	0.00	0.30	159.38	1.49	0.03	0.00	0.00	5734
13:00 to 14:00	12.67	0.66	0.00	0.30	159.50	0.87	0.02	0.00	0.00	5734
14:00 to 15:00	12.61	0.81	0.00	0.33	159.34	1.06	0.02	0.00	0.00	6098
15:00 to 16:00	12.73	0.27	0.00	0.38	159.28	0.36	0.01	0.00	0.00	6492
16:00 to 17:00	12.82	0.33	0.00	0.29	159.44	0.44	0.01	0.00	0.00	5719
17:00 to 18:00	12.85	1.07	0.00	0.24	159.18	1.45	0.02	0.00	0.00	5117
18:00 to 19:00	12.79	0.20	0.00	0.28	158.94	0.27	0.00	0.00	0.00	5568
19:00 to 20:00	12.78	0.83	0.00	0.30	159.48	1.12	0.02	0.00	0.00	5842
20:00 to 21:00	12.85	0.92	0.00	0.31	158.92	1.24	0.02	0.00	0.00	5840
21:00 to 22:00	12.86	1.04	0.00	0.27	159.11	1.40	0.02	0.00	0.00	5388
22:00 to 23:00	12.84	0.82	0.00	0.27	159.37	1.11	0.02	0.00	0.00	5459
23:00 to 24:00	12.85	0.42	0.00	0.30	158.91	0.57	0.01	0.00	0.00	5826
0:00 to 1:00	12.85	1.02	0.00	0.22	159.07	1.37	0.02	0.00	0.00	4823
1:00 to 2:00	12.85	0.60	0.00	0.34	159.65	0.81	0.01	0.00	0.00	6182
2:00 to 3:00	12.86	0.74	0.00	0.34	159.22	1.00	0.02	0.00	0.00	6147
3:00 to 4:00	12.85	0.11	0.00	0.18	158.49	0.15	0.00	0.00	0.00	4392
4:00 to 5:00	12.74	0.53	0.00	0.23	159.29	0.70	0.01	0.00	0.00	4991
5:00 to 6:00	12.75	0.90	0.00	0.29	158.56	1.19	0.02	0.00	0.00	5683
Averages										
6:00 to 18:00	12.78	0.69	0.77	0.31	159.36	0.92	0.02	0.03	0.03	5853
18:00 to 6:00	12.82	0.68	0.00	0.28	159.08	0.91	0.01	0.00	0.00	5512
6:00 to 6:00	12.80	0.68	0.39	0.29	159.22	0.91	0.02	0.02	0.01	5683

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 21 , 2006
Report Printed on 11-22-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.11	0.24	9.05	0.18	158.75	0.33	0.00	0.29	0.08	4280
7:00 to 8:00	13.01	0.96	0.01	0.29	158.94	1.32	0.02	0.00	0.08	5687
8:00 to 9:00	13.13	0.01	0.00	0.29	158.59	0.02	0.00	0.00	0.08	5651
9:00 to 10:00	13.07	0.30	0.00	0.30	158.71	0.41	0.01	0.00	0.00	5803
10:00 to 11:00	13.10	0.05	0.00	0.29	159.30	0.07	0.00	0.00	0.00	5766
11:00 to 12:00	12.93	1.19	0.00	0.31	159.56	1.62	0.03	0.00	0.00	5934
12:00 to 13:00	12.91	0.32	0.00	0.34	159.16	0.44	0.01	0.00	0.00	6126
13:00 to 14:00	12.94	0.58	0.00	0.29	159.41	0.79	0.01	0.00	0.00	5697
14:00 to 15:00	13.04	0.93	0.00	0.31	158.74	1.29	0.02	0.00	0.00	5849
15:00 to 16:00	12.96	0.40	0.00	0.55	158.22	0.55	0.01	0.00	0.00	7796
16:00 to 17:00	12.84	0.81	0.00	0.59	159.65	1.09	0.02	0.00	0.00	7880
17:00 to 18:00	12.95	0.35	0.00	0.23	159.18	0.48	0.01	0.00	0.00	4998
18:00 to 19:00	12.86	0.37	0.00	0.32	158.97	0.50	0.01	0.00	0.00	5907
19:00 to 20:00	12.81	0.41	0.00	0.30	159.50	0.54	0.01	0.00	0.00	5837
20:00 to 21:00	12.89	0.92	0.00	0.30	158.81	1.25	0.02	0.00	0.00	5791
21:00 to 22:00	12.93	0.89	0.00	0.34	158.79	1.21	0.02	0.00	0.00	6151
22:00 to 23:00	12.93	0.79	0.00	0.36	159.25	1.08	0.02	0.00	0.00	6283
23:00 to 24:00	12.98	0.78	0.00	0.29	159.12	1.07	0.02	0.00	0.00	5614
0:00 to 1:00	12.91	0.84	0.00	0.37	158.83	1.14	0.02	0.00	0.00	6431
1:00 to 2:00	12.92	0.55	0.00	0.37	159.30	0.75	0.01	0.00	0.00	6465
2:00 to 3:00	12.94	0.28	0.00	0.28	158.56	0.38	0.01	0.00	0.00	5560
3:00 to 4:00	12.94	0.85	0.00	0.29	158.84	1.17	0.02	0.00	0.00	5705
4:00 to 5:00	12.98	0.83	0.00	0.22	158.85	1.14	0.02	0.00	0.00	4909
5:00 to 6:00	12.93	1.00	0.00	0.31	158.64	1.37	0.02	0.00	0.00	5846
Averages										
6:00 to 18:00	13.00	0.51	0.76	0.33	159.02	0.70	0.01	0.02	0.02	5956
18:00 to 6:00	12.92	0.71	0.00	0.31	158.95	0.96	0.02	0.00	0.00	5875
6:00 to 6:00	12.96	0.61	0.38	0.32	158.99	0.83	0.01	0.01	0.01	5915

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 22 , 2006
Report Printed on 11-23-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.72	0.80	9.83	0.30	157.52	1.06	0.02	0.43	0.12	5798
7:00 to 8:00	12.72	0.57	0.00	0.29	154.83	0.76	0.01	0.00	0.12	5683
8:00 to 9:00	12.70	0.94	0.00	0.28	154.69	1.24	0.02	0.00	0.12	5631
9:00 to 10:00	12.77	0.37	0.00	0.25	154.17	0.50	0.01	0.00	0.00	5235
10:00 to 11:00	12.84	0.98	0.00	0.25	154.87	1.32	0.02	0.00	0.00	5213
11:00 to 12:00	12.65	0.53	0.00	0.29	154.92	0.70	0.01	0.00	0.00	5724
12:00 to 13:00	12.57	0.31	0.00	0.24	154.99	0.40	0.01	0.00	0.00	5197
13:00 to 14:00	12.56	0.67	0.00	0.25	155.46	0.87	0.01	0.00	0.00	5282
14:00 to 15:00	12.58	0.14	0.00	0.27	154.76	0.18	0.00	0.00	0.00	5518
15:00 to 16:00	12.54	0.47	0.00	0.27	154.86	0.61	0.01	0.00	0.00	5498
16:00 to 17:00	12.60	1.03	0.00	0.28	155.23	1.35	0.02	0.00	0.00	5602
17:00 to 18:00	12.48	0.78	0.00	0.28	155.22	1.01	0.02	0.00	0.00	5645
18:00 to 19:00	12.65	0.79	0.00	0.25	154.90	1.05	0.02	0.00	0.00	5235
19:00 to 20:00	12.67	0.14	0.00	0.27	155.35	0.19	0.00	0.00	0.00	5477
20:00 to 21:00	12.75	0.30	0.00	0.30	155.06	0.40	0.01	0.00	0.00	5840
21:00 to 22:00	12.71	0.46	0.00	0.42	154.56	0.61	0.01	0.00	0.00	6806
22:00 to 23:00	12.57	0.89	0.00	0.45	155.62	1.16	0.02	0.00	0.00	6998
23:00 to 24:00	12.61	0.53	0.00	0.31	155.44	0.69	0.01	0.00	0.00	5824
0:00 to 1:00	12.52	0.91	0.00	0.34	155.41	1.18	0.02	0.00	0.00	6191
1:[illegible] to 2:00	12.58	0.55	0.00	0.33	156.03	0.72	0.01	0.00	0.00	6012
2[illegible] 3:00	12.65	0.27	0.00	0.27	155.16	0.36	0.01	0.00	0.00	5517
3:00 to 4:00	12.70	0.59	0.00	0.31	155.37	0.78	0.01	0.00	0.00	5834
4:00 to 5:00	12.80	0.29	0.00	0.30	155.76	0.38	0.01	0.00	0.00	5793
5:00 to 6:00	12.78	0.81	0.00	0.28	155.30	1.08	0.02	0.00	0.00	5591
Averages										
6:00 to 18:00	12.64	0.63	0.82	0.27	155.13	0.83	0.01	0.04	0.03	5502
18:00 to 6:00	12.67	0.54	0.00	0.32	155.33	0.72	0.01	0.00	0.00	5926
6:00 to 6:00	12.66	0.59	0.41	0.30	155.23	0.78	0.01	0.02	0.01	5714

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 23 , 2006
Report Printed on 11-24-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.86	1.34	8.58	0.29	157.19	1.81	0.03	0.34	0.09	5700
7:00 to 8:00	12.81	0.42	0.00	0.30	159.64	0.57	0.01	0.00	0.09	5772
8:00 to 9:00	12.76	1.11	0.00	0.32	159.72	1.49	0.03	0.00	0.09	5967
9:00 to 10:00	12.87	0.84	0.00	0.30	159.12	1.13	0.02	0.00	0.00	5778
10:00 to 11:00	12.88	0.68	0.00	0.34	159.58	0.92	0.02	0.00	0.00	6181
11:00 to 12:00	12.93	0.68	0.00	0.25	158.91	0.93	0.01	0.00	0.00	5207
12:00 to 13:00	12.95	0.22	0.00	0.18	159.38	0.30	0.00	0.00	0.00	4381
13:00 to 14:00	12.83	1.18	0.00	0.28	160.03	1.58	0.02	0.00	0.00	5590
14:00 to 15:00	12.90	0.87	0.00	0.29	159.43	1.19	0.02	0.00	0.00	5693
15:00 to 16:00	12.80	0.63	0.00	0.41	159.76	0.85	0.02	0.00	0.00	6700
16:00 to 17:00	12.78	0.40	0.00	0.43	159.91	0.54	0.01	0.00	0.00	6937
17:00 to 18:00	12.87	0.40	0.00	0.24	160.08	0.55	0.01	0.00	0.00	5237
18:00 to 19:00	12.94	0.20	0.00	0.13	160.04	0.27	0.00	0.00	0.00	3640
19:00 to 20:00	12.94	0.15	0.00	0.31	160.52	0.21	0.00	0.00	0.00	5943
20:00 to 21:00	12.83	0.98	0.00	0.25	160.03	1.32	0.02	0.00	0.00	5212
21:00 to 22:00	12.83	0.77	0.00	0.24	159.84	1.03	0.02	0.00	0.00	5187
22:00 to 23:00	12.84	0.59	0.00	0.29	160.38	0.79	0.01	0.00	0.00	5746
23:00 to 24:00	12.89	0.55	0.00	0.33	159.28	0.74	0.01	0.00	0.00	6079
0:00 to 1:00	12.99	0.29	0.00	0.16	159.00	0.40	0.00	0.00	0.00	4174
1:00 to 2:00	12.93	0.38	0.00	0.27	159.30	0.52	0.01	0.00	0.00	5436
2:00 to 3:00	12.99	0.52	0.00	0.29	158.99	0.71	0.01	0.00	0.00	5676
3:00 to 4:00	12.94	0.95	0.00	0.25	159.16	1.30	0.02	0.00	0.00	5283
4:00 to 5:00	12.94	0.52	0.00	0.33	159.39	0.72	0.01	0.00	0.00	6109
5:00 to 6:00	12.87	0.59	0.00	0.30	159.26	0.80	0.01	0.00	0.00	5816
Averages										
6:00 to 18:00	12.85	0.73	0.72	0.30	159.39	0.99	0.02	0.03	0.02	5762
18:00 to 6:00	12.91	0.54	0.00	0.26	159.60	0.73	0.01	0.00	0.00	5358
6:00 to 6:00	12.88	0.64	0.36	0.28	159.50	0.86	0.01	0.01	0.01	5560

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 24 , 2006
Report Printed on 11-25-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.66	1.32	8.73	0.25	159.48	1.73	0.02	0.28	0.08	5224
7:00 to 8:00	12.92	0.77	0.00	0.30	159.97	1.05	0.02	0.00	0.08	5801
8:00 to 9:00	12.80	0.70	0.00	0.28	159.64	0.94	0.01	0.00	0.08	5633
9:00 to 10:00	12.91	0.86	0.00	0.28	159.47	1.16	0.02	0.00	0.00	5529
10:00 to 11:00	12.76	1.04	0.00	0.29	160.36	1.39	0.02	0.00	0.00	5773
11:00 to 12:00	12.79	0.46	0.00	0.28	159.28	0.61	0.01	0.00	0.00	5612
12:00 to 13:00	12.79	0.50	0.00	0.31	159.73	0.67	0.01	0.00	0.00	5863
13:00 to 14:00	12.87	0.53	0.00	0.31	159.75	0.71	0.01	0.00	0.00	5849
14:00 to 15:00	12.89	0.56	0.00	0.33	159.50	0.76	0.01	0.00	0.00	6020
15:00 to 16:00	12.90	0.49	0.00	0.35	159.74	0.66	0.01	0.00	0.00	6179
16:00 to 17:00	12.84	1.10	0.00	0.33	159.93	1.48	0.02	0.00	0.00	6051
17:00 to 18:00	12.97	0.41	0.00	0.29	159.66	0.57	0.01	0.00	0.00	5673
18:00 to 19:00	12.84	0.77	0.00	0.24	159.69	1.04	0.02	0.00	0.00	5180
19:00 to 20:00	12.96	0.77	0.00	0.31	160.46	1.05	0.02	0.00	0.00	5954
20:00 to 21:00	12.90	0.60	0.00	0.25	159.58	0.82	0.01	0.00	0.00	5210
21:00 to 22:00	12.95	0.23	0.00	0.17	159.35	0.32	0.00	0.00	0.00	4348
22:00 to 23:00	12.98	0.35	0.00	0.18	159.75	0.48	0.00	0.00	0.00	4268
23:00 to 24:00	12.86	0.49	0.00	0.30	159.33	0.67	0.01	0.00	0.00	5793
0:00 to 1:00	12.92	0.46	0.00	0.29	159.35	0.62	0.01	0.00	0.00	5654
1:00 to 2:00	12.96	0.82	0.00	0.28	159.62	1.13	0.02	0.00	0.00	5565
2:00 to 3:00	12.92	0.54	0.00	0.25	159.40	0.74	0.01	0.00	0.00	5147
3:00 to 4:00	12.96	0.78	0.00	0.19	159.27	1.07	0.01	0.00	0.00	4544
4:00 to 5:00	12.83	0.45	0.00	0.23	159.89	0.61	0.01	0.00	0.00	5130
5:00 to 6:00	12.95	0.39	0.00	0.29	159.25	0.53	0.01	0.00	0.00	5654
Averages										
6:00 to 18:00	12.84	0.73	0.73	0.30	159.71	0.98	0.02	0.02	0.02	5767
18:00 to 6:00	12.92	0.56	0.00	0.25	159.58	0.76	0.01	0.00	0.00	5204
6:00 to 6:00	12.88	0.64	0.36	0.27	159.64	0.87	0.01	0.01	0.01	5486

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 25 , 2006
Report Printed on 11-26-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.09	0.03	7.51	0.22	159.03	0.03	0.00	0.25	0.07	4707
7:00 to 8:00	13.11	0.40	0.00	0.31	158.71	0.56	0.01	0.00	0.07	5851
8:00 to 9:00	13.20	0.83	0.00	0.30	158.36	1.17	0.02	0.00	0.07	5798
9:00 to 10:00	13.09	0.67	0.00	0.24	158.27	0.94	0.01	0.00	0.00	5140
10:00 to 11:00	13.11	0.34	0.00	0.26	158.91	0.47	0.01	0.00	0.00	5365
11:00 to 12:00	12.98	0.99	0.00	0.31	158.52	1.36	0.02	0.00	0.00	5855
12:00 to 13:00	13.04	0.52	0.00	0.30	158.43	0.72	0.01	0.00	0.00	5668
13:00 to 14:00	13.14	0.26	0.00	0.30	158.16	0.37	0.01	0.00	0.00	5773
14:00 to 15:00	13.21	0.67	0.00	0.33	157.82	0.94	0.02	0.00	0.00	6064
15:00 to 16:00	13.06	0.79	0.00	0.54	157.26	1.10	0.02	0.00	0.00	7776
16:00 to 17:00	13.05	1.01	0.00	0.57	158.12	1.40	0.03	0.00	0.00	7776
17:00 to 18:00	13.13	0.07	0.00	0.22	157.72	0.10	0.00	0.00	0.00	4962
18:00 to 19:00	12.95	0.95	0.00	0.36	157.95	1.30	0.02	0.00	0.00	6361
19:00 to 20:00	12.96	0.46	0.00	0.42	158.43	0.63	0.01	0.00	0.00	6729
20:00 to 21:00	13.06	0.71	0.00	0.28	158.04	0.98	0.02	0.00	0.00	5596
21:00 to 22:00	13.18	0.64	0.00	0.28	157.65	0.90	0.01	0.00	0.00	5559
22:00 to 23:00	13.18	0.20	0.00	0.24	158.06	0.28	0.00	0.00	0.00	5190
23:00 to 24:00	12.99	0.93	0.00	0.30	158.15	1.28	0.02	0.00	0.00	5823
0:00 to 1:00	13.11	0.06	0.00	0.28	157.70	0.08	0.00	0.00	0.00	5634
1:00 to 2:00	13.04	0.46	0.00	0.29	158.02	0.63	0.01	0.00	0.00	5660
2:00 to 3:00	13.07	0.09	0.00	0.26	157.60	0.12	0.00	0.00	0.00	5330
3:00 to 4:00	12.96	0.64	0.00	0.25	157.63	0.88	0.01	0.00	0.00	5166
4:00 to 5:00	12.88	0.85	0.00	0.20	158.14	1.15	0.01	0.00	0.00	4569
5:00 to 6:00	12.90	0.34	0.00	0.30	157.48	0.47	0.01	0.00	0.00	5803
Averages										
6:00 to 18:00	13.10	0.55	0.63	0.32	158.27	0.76	0.01	0.02	0.02	5895
18:00 to 6:00	13.02	0.53	0.00	0.29	157.90	0.73	0.01	0.00	0.00	5618
6:00 to 6:00	13.06	0.54	0.31	0.31	158.09	0.75	0.01	0.01	0.01	5756

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 26 , 2006
Report Printed on 11-27-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.94	0.11	8.45	0.21	157.95	0.15	0.00	0.19	0.05	4647
7:00 to 8:00	12.82	0.23	0.01	0.25	158.34	0.31	0.00	0.00	0.05	5178
8:00 to 9:00	12.73	0.44	0.00	0.29	157.84	0.58	0.01	0.00	0.05	5648
9:00 to 10:00	12.83	0.78	0.00	0.30	157.95	1.05	0.02	0.00	0.00	5781
10:00 to 11:00	12.85	0.36	0.00	0.29	158.08	0.49	0.01	0.00	0.00	5707
11:00 to 12:00	12.72	1.11	0.00	0.29	157.91	1.47	0.03	0.00	0.00	5730
12:00 to 13:00	12.79	0.50	0.00	0.28	157.75	0.67	0.01	0.00	0.00	5580
13:00 to 14:00	12.68	0.50	0.00	0.25	158.61	0.66	0.01	0.00	0.00	5243
14:00 to 15:00	12.89	0.52	0.00	0.28	157.56	0.70	0.01	0.00	0.00	5577
15:00 to 16:00	12.77	0.94	0.00	0.30	157.79	1.25	0.02	0.00	0.00	5743
16:00 to 17:00	12.87	0.39	0.00	0.27	157.94	0.53	0.01	0.00	0.00	5484
17:00 to 18:00	12.82	0.85	0.00	0.30	157.87	1.15	0.02	0.00	0.00	5809
18:00 to 19:00	12.82	0.56	0.00	0.21	157.63	0.75	0.01	0.00	0.00	4825
19:00 to 20:00	12.89	0.43	0.00	0.24	158.12	0.58	0.01	0.00	0.00	5131
20:00 to 21:00	12.81	0.76	0.00	0.30	158.02	1.02	0.02	0.00	0.00	5731
21:00 to 22:00	12.79	0.43	0.00	0.29	157.61	0.58	0.01	0.00	0.00	5645
22:00 to 23:00	12.81	0.55	0.00	0.28	158.21	0.74	0.01	0.00	0.00	5555
23:00 to 24:00	12.95	0.38	0.00	0.27	157.04	0.52	0.01	0.00	0.00	5534
0:00 to 1:00	12.93	0.76	0.00	0.29	156.90	1.04	0.02	0.00	0.00	5684
1:00 to 2:00	12.75	1.02	0.00	0.30	158.69	1.35	0.02	0.00	0.00	5804
2 3:00	12.83	0.77	0.00	0.30	158.04	1.03	0.02	0.00	0.00	5756
3:00 to 4:00	12.74	0.51	0.00	0.32	158.30	0.68	0.01	0.00	0.00	5971
4:00 to 5:00	12.83	0.42	0.00	0.29	158.47	0.56	0.01	0.00	0.00	5669
5:00 to 6:00	12.70	0.65	0.00	0.30	158.39	0.86	0.01	0.00	0.00	5760
Averages										
6:00 to 18:00	12.81	0.56	0.71	0.28	157.97	0.75	0.01	0.02	0.01	5511
18:00 to 6:00	12.82	0.60	0.00	0.28	157.95	0.81	0.01	0.00	0.00	5589
6:00 to 6:00	12.81	0.58	0.35	0.28	157.96	0.78	0.01	0.01	0.01	5550

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 27 , 2006
Report Printed on 11-28-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.76	0.03	8.20	0.32	158.45	0.04	0.00	0.36	0.10	6017
7:00 to 8:00	12.74	0.25	0.00	0.37	158.07	0.33	0.01	0.00	0.10	6354
8:00 to 9:00	12.70	0.50	0.00	0.29	157.63	0.67	0.01	0.00	0.10	5715
9:00 to 10:00	12.79	0.59	0.00	0.30	157.21	0.78	0.01	0.00	0.00	5785
10:00 to 11:00	12.80	0.96	0.00	0.30	157.45	1.29	0.02	0.00	0.00	5819
11:00 to 12:00	12.83	0.36	0.00	0.28	156.50	0.48	0.01	0.00	0.00	5631
12:00 to 13:00	12.81	0.23	0.00	0.31	156.37	0.31	0.01	0.00	0.00	5927
13:00 to 14:00	12.88	0.82	0.00	0.34	156.97	1.11	0.02	0.00	0.00	6159
14:00 to 15:00	12.79	0.64	0.00	0.29	156.89	0.85	0.01	0.00	0.00	5704
15:00 to 16:00	12.81	0.46	0.00	0.30	156.86	0.62	0.01	0.00	0.00	5780
16:00 to 17:00	12.80	0.43	0.00	0.28	157.45	0.57	0.01	0.00	0.00	5565
17:00 to 18:00	12.87	0.71	0.00	0.27	156.71	0.96	0.02	0.00	0.00	5536
18:00 to 19:00	12.85	0.08	0.00	0.28	156.45	0.11	0.00	0.00	0.00	5601
19:00 to 20:00	12.86	0.49	0.00	0.29	157.08	0.67	0.01	0.00	0.00	5701
20:00 to 21:00	12.83	0.41	0.00	0.29	156.60	0.56	0.01	0.00	0.00	5684
21:00 to 22:00	12.82	0.36	0.00	0.30	156.45	0.48	0.01	0.00	0.00	5830
22:00 to 23:00	12.92	0.74	0.00	0.30	157.28	1.01	0.02	0.00	0.00	5787
23:00 to 24:00	12.78	0.43	0.00	0.29	156.61	0.57	0.01	0.00	0.00	5666
0:00 to 1:00	12.82	0.82	0.00	0.27	156.28	1.11	0.02	0.00	0.00	5515
1:00 to 2:00	12.80	0.63	0.00	0.29	156.93	0.85	0.01	0.00	0.00	5683
2:00 to 3:00	12.87	0.47	0.00	0.29	156.71	0.64	0.01	0.00	0.00	5657
3:00 to 4:00	12.60	0.07	0.00	0.30	157.53	0.09	0.00	0.00	0.00	5782
4:00 to 5:00	12.56	0.01	0.00	0.33	158.51	0.01	0.00	0.00	0.00	6038
5:00 to 6:00	12.61	0.01	0.00	0.33	158.23	0.01	0.00	0.00	0.00	6114
Averages										
6:00 to 18:00	12.80	0.50	0.68	0.31	157.21	0.67	0.01	0.03	0.02	5833
18:00 to 6:00	12.78	0.38	0.00	0.30	157.05	0.50	0.01	0.00	0.00	5755
6:00 to 6:00	12.79	0.44	0.34	0.30	157.13	0.59	0.01	0.01	0.01	5794

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 28 , 2006
Report Printed on 11-29-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.47	0.02	8.66	0.31	158.74	0.02	0.00	0.38	0.10	5933
7:00 to 8:00	12.54	0.13	0.00	0.30	159.70	0.17	0.00	0.00	0.10	5844
8:00 to 9:00	12.91	0.02	0.00	0.30	158.27	0.02	0.00	0.00	0.10	5827
9:00 to 10:00	12.86	0.00	0.00	0.31	157.45	0.00	0.00	0.00	0.00	5872
10:00 to 11:00	12.88	0.27	0.00	0.30	158.23	0.37	0.01	0.00	0.00	5776
11:00 to 12:00	12.83	0.08	0.00	0.30	157.94	0.11	0.00	0.00	0.00	5834
12:00 to 13:00	12.88	0.19	0.00	0.33	158.02	0.26	0.00	0.00	0.00	6064
13:00 to 14:00	12.78	0.80	0.00	0.32	158.71	1.08	0.02	0.00	0.00	6017
14:00 to 15:00	12.72	0.38	0.00	0.31	158.51	0.51	0.01	0.00	0.00	5904
15:00 to 16:00	12.68	0.59	0.00	0.31	158.64	0.77	0.01	0.00	0.00	5848
16:00 to 17:00	12.73	0.26	0.00	0.30	158.72	0.35	0.01	0.00	0.00	5814
17:00 to 18:00	12.74	0.38	0.00	0.30	158.46	0.50	0.01	0.00	0.00	5793
18:00 to 19:00	12.77	0.47	0.00	0.30	158.16	0.63	0.01	0.00	0.00	5774
19:00 to 20:00	12.66	0.38	0.00	0.32	158.73	0.50	0.01	0.00	0.00	6006
20:00 to 21:00	12.69	0.48	0.00	0.29	158.16	0.63	0.01	0.00	0.00	5698
21:00 to 22:00	12.60	0.01	0.00	0.31	158.11	0.01	0.00	0.00	0.00	5920
22:00 to 23:00	12.71	0.51	0.00	0.30	158.47	0.68	0.01	0.00	0.00	5784
23:00 to 24:00	12.63	0.21	0.00	0.29	157.93	0.28	0.00	0.00	0.00	5718
0:00 to 1:00	12.68	0.00	0.00	0.30	157.88	0.00	0.00	0.00	0.00	5773
1:00 to 2:00	12.63	0.36	0.00	0.30	158.28	0.48	0.01	0.00	0.00	5792
[illegible] 3:00	12.68	0.42	0.00	0.31	157.99	0.56	0.01	0.00	0.00	5883
3:00 to 4:00	12.79	0.39	0.00	0.30	157.84	0.53	0.01	0.00	0.00	5788
4:00 to 5:00	12.72	0.11	0.00	0.29	158.07	0.14	0.00	0.00	0.00	5684
5:00 to 6:00	12.63	1.07	0.00	0.31	157.94	1.40	0.02	0.00	0.00	5869
Averages										
6:00 to 18:00	12.75	0.26	0.72	0.31	158.45	0.35	0.01	0.03	0.03	5877
18:00 to 6:00	12.68	0.37	0.00	0.30	158.13	0.49	0.01	0.00	0.00	5807
6:00 to 6:00	12.72	0.31	0.36	0.31	158.29	0.42	0.01	0.02	0.01	5842

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 29 , 2006
Report Printed on 11-30-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.63	0.64	8.26	0.30	157.18	0.84	0.01	0.36	0.10	5763
7:00 to 8:00	12.86	0.44	0.00	0.30	156.09	0.59	0.01	0.00	0.10	5786
8:00 to 9:00	12.84	0.08	0.00	0.29	155.16	0.11	0.00	0.00	0.10	5688
9:00 to 10:00	12.93	0.20	0.00	0.29	155.09	0.28	0.00	0.00	0.00	5677
10:00 to 11:00	12.87	0.16	0.00	0.30	156.05	0.21	0.00	0.00	0.00	5749
11:00 to 12:00	12.70	0.19	0.00	0.30	156.22	0.25	0.00	0.00	0.00	5815
12:00 to 13:00	12.78	0.12	0.00	0.30	156.14	0.17	0.00	0.00	0.00	5824
13:00 to 14:00	12.80	0.32	0.00	0.28	156.23	0.42	0.01	0.00	0.00	5637
14:00 to 15:00	12.76	0.49	0.00	0.29	156.18	0.65	0.01	0.00	0.00	5731
15:00 to 16:00	12.87	0.22	0.00	0.28	155.90	0.30	0.00	0.00	0.00	5573
16:00 to 17:00	12.90	0.11	0.00	0.28	156.34	0.15	0.00	0.00	0.00	5647
17:00 to 18:00	12.87	0.56	0.00	0.29	156.22	0.76	0.01	0.00	0.00	5723
18:00 to 19:00	12.87	0.06	0.00	0.28	155.82	0.08	0.00	0.00	0.00	5578
19:00 to 20:00	12.82	0.68	0.00	0.29	156.82	0.91	0.02	0.00	0.00	5721
20:00 to 21:00	12.88	0.53	0.00	0.29	156.02	0.72	0.01	0.00	0.00	5705
21:00 to 22:00	12.85	0.81	0.00	0.30	155.97	1.09	0.02	0.00	0.00	5768
22:00 to 23:00	12.96	1.00	0.00	0.30	156.44	1.37	0.02	0.00	0.00	5761
23:00 to 24:00	12.83	0.61	0.00	0.29	155.99	0.82	0.01	0.00	0.00	5678
0:00 to 1:00	12.85	0.73	0.00	0.31	155.99	0.99	0.02	0.00	0.00	5882
1:00 to 2:00	12.82	0.37	0.00	0.24	156.22	0.49	0.01	0.00	0.00	5154
2:00 to 3:00	12.89	0.71	0.00	0.29	155.96	0.97	0.02	0.00	0.00	5709
3:00 to 4:00	12.70	0.79	0.00	0.26	156.06	1.05	0.02	0.00	0.00	5411
4:00 to 5:00	12.85	0.48	0.00	0.27	156.16	0.65	0.01	0.00	0.00	5527
5:00 to 6:00	12.83	0.20	0.00	0.28	155.59	0.27	0.00	0.00	0.00	5604
Averages										
6:00 to 18:00	12.82	0.29	0.69	0.29	156.07	0.40	0.01	0.03	0.02	5718
18:00 to 6:00	12.85	0.58	0.00	0.28	156.09	0.78	0.01	0.00	0.00	5625
6:00 to 6:00	12.83	0.44	0.34	0.29	156.08	0.59	0.01	0.02	0.01	5671

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD November 30 , 2006
Report Printed on 12-01-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.64	0.33	8.11	0.28	155.45	0.43	0.01	0.33	0.09	5593
7:00 to 8:00	12.62	0.45	0.00	0.28	156.88	0.60	0.01	0.00	0.09	5611
8:00 to 9:00	12.85	0.55	0.00	0.32	156.50	0.74	0.01	0.00	0.09	6004
9:00 to 10:00	12.71	0.65	0.00	0.47	156.46	0.87	0.02	0.00	0.00	7249
10:00 to 11:00	12.90	0.44	0.00	0.45	156.83	0.59	0.01	0.00	0.00	6919
11:00 to 12:00	13.03	0.59	0.00	0.28	156.03	0.82	0.01	0.00	0.00	5640
12:00 to 13:00	13.02	0.10	0.00	0.29	156.20	0.13	0.00	0.00	0.00	5651
13:00 to 14:00	13.14	1.06	0.00	0.29	156.74	1.48	0.02	0.00	0.00	5656
14:00 to 15:00	12.99	0.50	0.00	0.29	156.53	0.69	0.01	0.00	0.00	5688
15:00 to 16:00	12.99	0.31	0.00	0.28	156.50	0.43	0.01	0.00	0.00	5578
16:00 to 17:00	13.15	0.85	0.00	0.29	157.08	1.20	0.02	0.00	0.00	5677
17:00 to 18:00	13.11	0.78	0.00	0.28	156.67	1.09	0.02	0.00	0.00	5592
18:00 to 19:00	13.08	0.15	0.00	0.29	156.24	0.21	0.00	0.00	0.00	5654
19:00 to 20:00	13.15	1.18	0.00	0.29	157.40	1.66	0.03	0.00	0.00	5668
20:00 to 21:00	13.15	0.35	0.00	0.29	157.02	0.49	0.01	0.00	0.00	5692
21:00 to 22:00	13.11	0.68	0.00	0.30	156.91	0.95	0.02	0.00	0.00	5769
22:00 to 23:00	13.04	0.62	0.00	0.26	157.17	0.86	0.01	0.00	0.00	5332
23:00 to 24:00	13.19	0.99	0.00	0.29	156.76	1.40	0.02	0.00	0.00	5728
0:00 to 1:00	13.14	0.19	0.00	0.29	156.67	0.26	0.00	0.00	0.00	5688
1:00 to 2:00	13.13	0.43	0.00	0.28	156.96	0.60	0.01	0.00	0.00	5641
2:00 to 3:00	12.99	0.64	0.00	0.28	156.83	0.87	0.01	0.00	0.00	5621
3:00 to 4:00	12.98	0.67	0.00	0.30	156.94	0.92	0.02	0.00	0.00	5759
4:00 to 5:00	12.99	0.47	0.00	0.30	157.82	0.64	0.01	0.00	0.00	5746
5:00 to 6:00	13.00	1.08	0.00	0.29	156.87	1.48	0.02	0.00	0.00	5662
Averages										
6:00 to 18:00	12.93	0.55	0.68	0.32	156.49	0.75	0.01	0.03	0.02	5905
18:00 to 6:00	13.08	0.62	0.00	0.29	156.97	0.86	0.01	0.00	0.00	5663
6:00 to 6:00	13.01	0.59	0.34	0.30	156.73	0.81	0.01	0.01	0.01	5784

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 1 , 2006
Report Printed on 12-02-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.89	0.57	7.79	0.29	157.01	0.77	0.01	0.32	0.09	5669
7:00 to 8:00	13.14	0.65	0.00	0.29	157.09	0.91	0.01	0.00	0.09	5661
8:00 to 9:00	13.18	0.41	0.00	0.29	156.57	0.57	0.01	0.00	0.09	5690
9:00 to 10:00	13.03	0.49	0.00	0.29	157.09	0.67	0.01	0.00	0.00	5721
10:00 to 11:00	13.08	0.98	0.00	0.30	157.41	1.36	0.02	0.00	0.00	5802
11:00 to 12:00	13.06	0.89	0.00	0.30	157.40	1.24	0.02	0.00	0.00	5788
12:00 to 13:00	13.03	0.88	0.00	0.31	157.71	1.21	0.02	0.00	0.00	5928
13:00 to 14:00	13.18	0.04	0.00	0.29	157.97	0.05	0.00	0.00	0.00	5673
14:00 to 15:00	13.05	1.02	0.00	0.30	157.78	1.42	0.02	0.00	0.00	5767
15:00 to 16:00	13.08	0.14	0.00	0.30	157.58	0.20	0.00	0.00	0.00	5779
16:00 to 17:00	13.10	0.97	0.00	0.23	158.26	1.36	0.02	0.00	0.00	5021
17:00 to 18:00	13.28	0.31	0.00	0.28	157.39	0.45	0.01	0.00	0.00	5632
18:00 to 19:00	13.12	0.38	0.00	0.28	157.33	0.53	0.01	0.00	0.00	5639
19:00 to 20:00	13.22	0.37	0.00	0.29	157.96	0.52	0.01	0.00	0.00	5676
20:00 to 21:00	13.22	0.01	0.00	0.27	157.33	0.01	0.00	0.00	0.00	5497
21:00 to 22:00	13.16	0.66	0.00	0.29	157.23	0.92	0.01	0.00	0.00	5657
22:00 to 23:00	13.22	0.20	0.00	0.29	157.73	0.29	0.00	0.00	0.00	5654
23:00 to 24:00	13.21	0.55	0.00	0.29	157.36	0.78	0.01	0.00	0.00	5722
0:00 to 1:00	13.24	0.32	0.00	0.28	157.11	0.45	0.01	0.00	0.00	5581
1:00 to 2:00	13.23	0.15	0.00	0.29	157.42	0.21	0.00	0.00	0.00	5671
[illegible] to 3:00	13.15	1.17	0.00	0.30	157.27	1.64	0.03	0.00	0.00	5777
3:00 to 4:00	13.22	0.59	0.00	0.31	157.13	0.83	0.01	0.00	0.00	5873
4:00 to 5:00	13.28	0.62	0.00	0.30	157.70	0.89	0.01	0.00	0.00	5775
5:00 to 6:00	13.22	0.93	0.00	0.30	157.33	1.32	0.02	0.00	0.00	5807
Averages										
6:00 to 18:00	13.09	0.61	0.65	0.29	157.44	0.85	0.01	0.03	0.02	5678
18:00 to 6:00	13.21	0.50	0.00	0.29	157.41	0.70	0.01	0.00	0.00	5694
6:00 to 6:00	13.15	0.55	0.32	0.29	157.42	0.78	0.01	0.01	0.01	5686

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 2 , 2006
Report Printed on 12-03-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.97	0.00	6.32	0.24	157.30	0.00	0.00	0.27	0.07	5023
7:00 to 8:00	13.11	0.76	0.00	0.22	157.98	1.06	0.02	0.00	0.07	4895
8:00 to 9:00	13.04	0.88	0.00	0.29	158.33	1.22	0.02	0.00	0.07	5642
9:00 to 10:00	12.95	1.21	0.00	0.27	158.26	1.66	0.03	0.00	0.00	5420
10:00 to 11:00	13.01	0.76	0.00	0.24	158.42	1.04	0.02	0.00	0.00	5156
11:00 to 12:00	12.94	0.70	0.00	0.29	158.14	0.96	0.02	0.00	0.00	5656
12:00 to 13:00	12.97	0.50	0.00	0.29	158.01	0.68	0.01	0.00	0.00	5692
13:00 to 14:00	13.04	0.24	0.00	0.27	158.62	0.33	0.01	0.00	0.00	5517
14:00 to 15:00	12.91	0.48	0.00	0.30	158.78	0.65	0.01	0.00	0.00	5756
15:00 to 16:00	12.78	0.62	0.00	0.28	158.72	0.83	0.01	0.00	0.00	5555
16:00 to 17:00	12.78	0.38	0.00	0.27	159.38	0.51	0.01	0.00	0.00	5560
17:00 to 18:00	12.90	0.81	0.00	0.29	158.95	1.10	0.02	0.00	0.00	5674
18:00 to 19:00	12.82	0.01	0.00	0.27	158.44	0.02	0.00	0.00	0.00	5471
19:00 to 20:00	12.84	0.41	0.00	0.28	159.25	0.56	0.01	0.00	0.00	5652
20:00 to 21:00	12.80	0.35	0.00	0.28	158.55	0.46	0.01	0.00	0.00	5568
21:00 to 22:00	12.83	0.13	0.00	0.27	158.26	0.17	0.00	0.00	0.00	5471
22:00 to 23:00	12.85	0.19	0.00	0.27	158.68	0.26	0.00	0.00	0.00	5446
23:00 to 24:00	12.82	0.21	0.00	0.28	158.81	0.29	0.00	0.00	0.00	5634
0:00 to 1:00	12.79	0.85	0.00	0.29	158.78	1.14	0.02	0.00	0.00	5731
1:00 to 2:00	12.80	0.07	0.00	0.27	158.96	0.09	0.00	0.00	0.00	5529
2:00 to 3:00	12.72	0.79	0.00	0.29	158.58	1.05	0.02	0.00	0.00	5683
3:00 to 4:00	12.79	0.89	0.00	0.30	158.28	1.19	0.02	0.00	0.00	5769
4:00 to 5:00	12.78	0.38	0.00	0.28	158.62	0.51	0.01	0.00	0.00	5635
5:00 to 6:00	13.00	0.17	0.00	0.28	157.68	0.23	0.00	0.00	0.00	5573
Averages										
6:00 to 18:00	12.95	0.61	0.53	0.27	158.41	0.84	0.01	0.02	0.02	5462
18:00 to 6:00	12.82	0.37	0.00	0.28	158.57	0.50	0.01	0.00	0.00	5597
6:00 to 6:00	12.89	0.49	0.26	0.28	158.49	0.67	0.01	0.01	0.01	5530

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 3 , 2006
Report Printed on 12-04-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.98	0.50	7.01	0.28	157.13	0.69	0.01	0.28	0.08	5621
7:00 to 8:00	12.88	0.95	0.00	0.29	154.67	1.28	0.02	0.00	0.08	5700
8:00 to 9:00	12.85	0.29	0.00	0.29	153.83	0.39	0.01	0.00	0.08	5690
9:00 to 10:00	12.91	0.99	0.00	0.31	153.47	1.35	0.02	0.00	0.00	5858
10:00 to 11:00	12.86	0.35	0.00	0.30	154.26	0.48	0.01	0.00	0.00	5774
11:00 to 12:00	12.81	0.57	0.00	0.29	153.66	0.77	0.01	0.00	0.00	5727
12:00 to 13:00	12.92	0.32	0.00	0.30	153.50	0.43	0.01	0.00	0.00	5800
13:00 to 14:00	12.85	0.34	0.00	0.29	154.19	0.46	0.01	0.00	0.00	5690
14:00 to 15:00	12.86	0.42	0.00	0.28	154.04	0.57	0.01	0.00	0.00	5624
15:00 to 16:00	12.83	0.04	0.00	0.28	154.29	0.05	0.00	0.00	0.00	5615
16:00 to 17:00	12.89	0.04	0.00	0.28	154.82	0.05	0.00	0.00	0.00	5655
17:00 to 18:00	12.82	0.32	0.00	0.28	154.27	0.42	0.01	0.00	0.00	5568
18:00 to 19:00	12.90	0.22	0.00	0.28	154.40	0.30	0.01	0.00	0.00	5615
19:00 to 20:00	12.92	0.64	0.00	0.29	155.01	0.88	0.02	0.00	0.00	5728
20:00 to 21:00	12.92	0.42	0.00	0.28	154.46	0.57	0.01	0.00	0.00	5629
21:00 to 22:00	12.93	0.56	0.00	0.28	154.45	0.77	0.01	0.00	0.00	5554
22:00 to 23:00	12.88	0.70	0.00	0.24	154.67	0.94	0.01	0.00	0.00	5134
23:00 to 24:00	12.92	0.58	0.00	0.27	154.11	0.79	0.01	0.00	0.00	5507
0:00 to 1:00	13.05	0.26	0.00	0.23	153.67	0.35	0.01	0.00	0.00	5021
1:00 to 2:00	12.94	0.21	0.00	0.24	154.50	0.29	0.00	0.00	0.00	5118
2:00 to 3:00	12.88	0.35	0.00	0.29	153.95	0.48	0.01	0.00	0.00	5681
3:00 to 4:00	12.99	0.08	0.00	0.33	153.89	0.11	0.00	0.00	0.00	6048
4:00 to 5:00	12.80	0.12	0.00	0.31	154.59	0.17	0.00	0.00	0.00	5903
5:00 to 6:00	12.74	0.03	0.00	0.28	154.08	0.05	0.00	0.00	0.00	5571
Averages										
6:00 to 18:00	12.87	0.43	0.58	0.29	154.35	0.58	0.01	0.02	0.02	5693
18:00 to 6:00	12.91	0.35	0.00	0.28	154.32	0.47	0.01	0.00	0.00	5542
6:00 to 6:00	12.89	0.39	0.29	0.28	154.33	0.53	0.01	0.01	0.01	5618

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 4 , 2006
Report Printed on 12-06-2006 at 09:50:06

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.87	0.82	6.81	0.28	145.77	1.10	0.02	0.29	0.08	5635
7:00 to 8:00	13.00	0.34	0.00	0.30	119.42	0.47	0.01	0.00	0.08	5747
8:00 to 9:00	12.95	0.00	0.00	0.35	158.44	0.00	0.00	0.00	0.08	6291
9:00 to 10:00	13.81	0.26	0.00	0.36	156.61	0.41	0.01	0.00	0.00	6358
10:00 to 11:00	13.68	0.00	0.00	0.34	156.98	0.00	0.00	0.00	0.00	6162
11:00 to 12:00	13.79	0.00	0.00	0.33	155.80	0.00	0.00	0.00	0.00	6071
12:00 to 13:00	13.93	0.00	0.00	0.32	155.08	0.00	0.00	0.00	0.00	5968
13:00 to 14:00	13.96	0.00	0.00	0.28	154.71	0.00	0.00	0.00	0.00	5649
14:00 to 15:00	13.55	0.00	0.00	0.28	155.47	0.00	0.00	0.00	0.00	5623
15:00 to 16:00	13.98	0.06	0.00	0.33	156.19	0.09	0.00	0.00	0.00	6050
16:00 to 17:00	12.50	0.30	0.00	0.37	157.07	0.39	0.01	0.00	0.00	6463
17:00 to 18:00	12.79	0.00	0.00	0.36	159.13	0.00	0.00	0.00	0.00	6318
18:00 to 19:00	12.77	0.00	0.00	0.34	160.28	0.00	0.00	0.00	0.00	6323
19:00 to 20:00	12.63	0.00	0.00	0.31	159.82	0.00	0.00	0.00	0.00	5981
20:00 to 21:00	12.79	0.00	0.00	0.32	158.89	0.01	0.00	0.00	0.00	5973
21:00 to 22:00	12.76	0.24	0.00	0.31	158.72	0.32	0.01	0.00	0.00	5866
22:00 to 23:00	13.00	0.03	0.00	0.29	157.95	0.05	0.00	0.00	0.00	5733
23:00 to 24:00	12.98	0.50	0.00	0.30	157.45	0.68	0.01	0.00	0.00	5789
0:00 to 1:00	13.04	0.03	0.00	0.29	157.04	0.04	0.00	0.00	0.00	5656
1:00 to 2:00	12.99	0.12	0.00	0.29	157.95	0.16	0.00	0.00	0.00	5652
2:00 to 3:00	13.03	0.22	0.00	0.28	157.56	0.31	0.01	0.00	0.00	5641
3:00 to 4:00	12.95	0.62	0.00	0.29	157.30	0.85	0.01	0.00	0.00	5737
4:00 to 5:00	13.09	0.64	0.00	0.29	157.83	0.89	0.01	0.00	0.00	5706
5:00 to 6:00	13.19	0.01	0.00	0.27	156.92	0.01	0.00	0.00	0.00	5526
Averages										
6:00 to 18:00	13.40	0.15	0.57	0.33	152.56	0.22	0.00	0.02	0.02	6028
18:00 to 6:00	12.94	0.20	0.00	0.30	158.14	0.28	0.00	0.00	0.00	5799
6:00 to 6:00	13.17	0.18	0.28	0.31	155.35	0.25	0.00	0.01	0.01	5913

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 5 , 2006
Report Printed on 12-06-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.89	1.29	6.11	0.30	157.99	1.75	0.03	0.27	0.07	5812
7:00 to 8:00	12.79	0.89	0.00	0.30	159.56	1.20	0.02	0.00	0.07	5784
8:00 to 9:00	12.85	0.45	0.00	0.30	159.16	0.61	0.01	0.00	0.07	5822
9:00 to 10:00	12.80	0.25	0.00	0.30	159.08	0.33	0.01	0.00	0.00	5735
10:00 to 11:00	12.81	0.25	0.00	0.29	159.67	0.33	0.00	0.00	0.00	5800
11:00 to 12:00	12.70	0.76	0.00	0.29	159.11	1.00	0.02	0.00	0.00	5728
12:00 to 13:00	12.80	0.70	0.00	0.30	159.24	0.94	0.02	0.00	0.00	5750
13:00 to 14:00	12.75	0.39	0.00	0.30	159.95	0.52	0.01	0.00	0.00	5839
14:00 to 15:00	12.73	0.03	0.00	0.29	159.59	0.04	0.00	0.00	0.00	5651
15:00 to 16:00	12.82	0.44	0.00	0.29	159.39	0.59	0.01	0.00	0.00	5708
16:00 to 17:00	12.84	0.96	0.00	0.29	160.08	1.29	0.02	0.00	0.00	5798
17:00 to 18:00	12.87	0.36	0.00	0.28	159.31	0.49	0.01	0.00	0.00	5623
18:00 to 19:00	12.92	0.23	0.00	0.29	159.11	0.32	0.01	0.00	0.00	5637
19:00 to 20:00	12.97	0.41	0.00	0.29	159.50	0.57	0.01	0.00	0.00	5730
20:00 to 21:00	12.91	0.42	0.00	0.29	159.26	0.57	0.01	0.00	0.00	5656
21:00 to 22:00	12.97	0.43	0.00	0.30	159.13	0.59	0.01	0.00	0.00	5746
22:00 to 23:00	12.83	0.24	0.00	0.29	159.61	0.32	0.00	0.00	0.00	5695
23:00 to 24:00	12.90	0.35	0.00	0.29	159.03	0.48	0.01	0.00	0.00	5677
0:00 to 1:00	12.97	0.14	0.00	0.29	159.04	0.20	0.00	0.00	0.00	5722
1:00 to 2:00	12.76	0.41	0.00	0.30	159.87	0.55	0.01	0.00	0.00	5816
2:00 to 3:00	12.81	0.53	0.00	0.29	159.31	0.71	0.01	0.00	0.00	5663
3:00 to 4:00	12.78	0.40	0.00	0.30	159.13	0.53	0.01	0.00	0.00	5739
4:00 to 5:00	12.83	0.35	0.00	0.29	159.61	0.47	0.01	0.00	0.00	5695
5:00 to 6:00	12.82	0.38	0.00	0.29	159.23	0.51	0.01	0.00	0.00	5717
Averages										
6:00 to 18:00	12.80	0.56	0.51	0.29	159.34	0.76	0.01	0.02	0.02	5754
18:00 to 6:00	12.87	0.36	0.00	0.29	159.32	0.48	0.01	0.00	0.00	5708
6:00 to 6:00	12.84	0.46	0.25	0.29	159.33	0.62	0.01	0.01	0.01	5731

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 6 , 2006
Report Printed on 12-07-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.68	0.10	6.35	0.29	159.44	0.13	0.00	0.27	0.07	5734
7:00 to 8:00	12.80	0.01	0.00	0.27	158.70	0.01	0.00	0.00	0.07	5482
8:00 to 9:00	12.70	0.04	0.00	0.29	158.36	0.05	0.00	0.00	0.07	5666
9:00 to 10:00	12.65	0.64	0.00	0.29	158.31	0.85	0.02	0.00	0.00	5708
10:00 to 11:00	5.24 M	8.40 M	0.14 M	0.29	159.03	5.86 M	0.18 M	0.01 M	0.00 I	5751
11:00 to 12:00	6.33 M	5.45 M	0.12 M	0.29	158.62	4.08 M	0.12 M	0.01 M	0.00 I	5731
12:00 to 13:00	12.51 M	0.00 M	0.15 M	0.31	158.58	0.00 M	0.00 M	0.01 M	0.01 I	5880
13:00 to 14:00	12.64	0.20	0.00	0.30	159.15	0.27	0.00	0.00	0.00 I	5808
14:00 to 15:00	12.62	0.27	0.00	0.28	158.68	0.36	0.01	0.00	0.00 I	5617
15:00 to 16:00	12.65	0.58	0.00	0.28	158.36	0.76	0.01	0.00	0.00	5563
16:00 to 17:00	12.76	0.74	0.00	0.28	158.93	0.99	0.02	0.00	0.00	5603
17:00 to 18:00	12.80	0.25	0.00	0.28	158.52	0.33	0.01	0.00	0.00	5588
18:00 to 19:00	12.73	0.91	0.00	0.28	158.87	1.21	0.02	0.00	0.00	5632
19:00 to 20:00	12.67	0.75	0.00	0.28	159.48	0.99	0.02	0.00	0.00	5596
20:00 to 21:00	12.78	0.59	0.00	0.28	159.06	0.78	0.01	0.00	0.00	5590
21:00 to 22:00	12.80	0.78	0.00	0.28	158.35	1.04	0.02	0.00	0.00	5628
22:00 to 23:00	12.91	0.37	0.00	0.28	158.71	0.50	0.01	0.00	0.00	5568
23:00 to 24:00	12.79	0.60	0.00	0.29	158.55	0.80	0.01	0.00	0.00	5672
0:00 to 1:00	12.75	0.74	0.00	0.28	158.05	0.99	0.02	0.00	0.00	5599
1:00 to 2:00	12.69	0.46	0.00	0.29	158.75	0.61	0.01	0.00	0.00	5696
2 3:00	12.82	0.08	0.00	0.29	158.32	0.11	0.00	0.00	0.00	5678
3:00 to 4:00	12.82	0.82	0.00	0.28	158.22	1.11	0.02	0.00	0.00	5561
4:00 to 5:00	12.92	0.38	0.00	0.28	158.24	0.52	0.01	0.00	0.00	5625
5:00 to 6:00	12.98	0.25	0.00	0.28	158.02	0.34	0.01	0.00	0.00	5624
Averages										
6:00 to 18:00	12.70	0.31	0.71	0.29	158.72	0.42	0.01	0.03	0.02	5678
18:00 to 6:00	12.80	0.56	0.00	0.28	158.55	0.75	0.01	0.00	0.00	5622
6:00 to 6:00	12.76	0.45	0.30	0.29	158.64	0.61	0.01	0.01	0.01	5650

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 7 , 2006
Report Printed on 12-08-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.09	0.05	6.47	0.29	158.66	0.07	0.00	0.27	0.07	5704
7:00 to 8:00	12.95	0.60	0.00	0.29	159.29	0.82	0.01	0.00	0.07	5773
8:00 to 9:00	12.69	0.65	5.79	0.30	159.08	0.86	0.01	0.26	0.16	5805
9:00 to 10:00	12.84 M	1.03 M	0.00 M	0.30	158.88	1.39 M	0.02 M	0.00 M	0.10 I	5789
10:00 to 11:00	3.86 M	0.13 M	93.73 M	0.29	159.63	0.09 M	0.00 M	3.88 M	0.19 I	5750
11:00 to 12:00	6.38 M	6.88 M	4.87 M	0.30	158.86	5.18 M	0.16 M	0.21 M	0.00 I	5772
12:00 to 13:00	12.51 M	0.36 M	0.00 M	0.30	158.49	0.47 M	0.01 M	0.00 M	0.00 I	5794
13:00 to 14:00	12.70	0.31	0.00	0.29	159.22	0.41	0.01	0.00	0.00 I	5700
14:00 to 15:00	12.66	0.51	0.00	0.29	158.88	0.67	0.01	0.00	0.00 I	5713
15:00 to 16:00	12.78	0.52	0.00	0.29	158.81	0.69	0.01	0.00	0.00	5696
16:00 to 17:00	12.79	0.63	0.00	0.29	159.49	0.84	0.01	0.00	0.00	5713
17:00 to 18:00	12.86	0.33	0.00	0.30	158.89	0.44	0.01	0.00	0.00	5764
18:00 to 19:00	12.93	0.65	0.00	0.30	159.09	0.88	0.01	0.00	0.00	5761
19:00 to 20:00	12.92	0.33	0.00	0.29	159.56	0.45	0.01	0.00	0.00	5701
20:00 to 21:00	12.83	0.49	0.00	0.29	159.26	0.66	0.01	0.00	0.00	5652
21:00 to 22:00	12.76	0.58	0.00	0.30	159.16	0.77	0.01	0.00	0.00	5755
22:00 to 23:00	12.86	0.50	0.00	0.31	159.64	0.68	0.01	0.00	0.00	5907
23:00 to 24:00	12.68	0.64	0.00	0.30	159.45	0.85	0.01	0.00	0.00	5823
0:00 to 1:00	12.80	0.68	0.00	0.29	158.96	0.91	0.02	0.00	0.00	5722
1:00 to 2:00	12.70	0.82	0.00	0.30	159.66	1.08	0.02	0.00	0.00	5885
[illegible] 3:00	12.92	0.42	0.00	0.30	158.98	0.58	0.01	0.00	0.00	5749
3:00 to 4:00	12.69	0.47	0.00	0.31	159.12	0.62	0.01	0.00	0.00	5847
4:00 to 5:00	12.78	0.94	0.00	0.30	159.68	1.25	0.02	0.00	0.00	5857
5:00 to 6:00	12.74	0.68	0.00	0.30	158.87	0.90	0.02	0.00	0.00	5743
Averages										
6:00 to 18:00	12.82 M	0.45 M	1.53 M	0.29	159.02	0.60	0.01 M	0.07 M	0.05	5748
18:00 to 6:00	12.80	0.60	0.00	0.30	159.28	0.80	0.01	0.00	0.00	5783
6:00 to 6:00	12.81	0.54	0.61	0.30	159.15	0.72	0.01	0.03	0.02	5766

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 8 , 2006
Report Printed on 12-09-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.77	0.40	6.52	0.30	159.75	0.53	0.01	0.28	0.08	5892
7:00 to 8:00	12.88	0.47	0.00	0.28	159.15	0.64	0.01	0.00	0.08	5559
8:00 to 9:00	12.80	0.82	0.01	0.30	158.35	1.10	0.02	0.00	0.08	5739
9:00 to 10:00	12.71	0.49	0.00	0.29	157.82	0.65	0.01	0.00	0.00	5657
10:00 to 11:00	12.59	0.42	0.01	0.28	158.30	0.55	0.01	0.00	0.00	5581
11:00 to 12:00	12.65	0.62	0.01	0.28	157.71	0.82	0.01	0.00	0.00	5583
12:00 to 13:00	12.65	0.47	0.01	0.28	157.71	0.62	0.01	0.00	0.00	5569
13:00 to 14:00	12.66	0.51	0.01	0.28	158.23	0.67	0.01	0.00	0.00	5558
14:00 to 15:00	12.78	0.33	0.00	0.28	157.81	0.45	0.01	0.00	0.00	5574
15:00 to 16:00	12.77	0.48	0.01	0.28	157.71	0.64	0.01	0.00	0.00	5614
16:00 to 17:00	12.87	0.52	0.00	0.27	158.07	0.70	0.01	0.00	0.00	5465
17:00 to 18:00	12.89	0.57	0.00	0.29	157.84	0.78	0.01	0.00	0.00	5669
18:00 to 19:00	12.81	0.96	0.00	0.28	157.74	1.28	0.02	0.00	0.00	5554
19:00 to 20:00	12.89	0.35	0.00	0.27	158.16	0.47	0.01	0.00	0.00	5475
20:00 to 21:00	12.91	0.64	0.00	0.28	157.91	0.87	0.01	0.00	0.00	5628
21:00 to 22:00	12.96	0.39	0.00	0.28	157.38	0.54	0.01	0.00	0.00	5596
22:00 to 23:00	12.89	0.71	0.00	0.29	158.19	0.96	0.02	0.00	0.00	5658
23:00 to 24:00	12.90	0.79	0.00	0.28	157.46	1.07	0.02	0.00	0.00	5558
0:00 to 1:00	12.82	0.49	0.00	0.28	157.31	0.66	0.01	0.00	0.00	5550
1:00 to 2:00	12.90	0.84	0.00	0.29	158.10	1.15	0.02	0.00	0.00	5693
[illegible] 3:00	12.92	0.80	0.00	0.28	157.59	1.09	0.02	0.00	0.00	5596
3:00 to 4:00	12.84	0.83	0.00	0.29	157.57	1.12	0.02	0.00	0.00	5695
4:00 to 5:00	12.95	0.90	0.00	0.27	157.79	1.23	0.02	0.00	0.00	5541
5:00 to 6:00	12.88	0.63	0.00	0.29	157.67	0.85	0.01	0.00	0.00	5652
Averages										
6:00 to 18:00	12.75	0.51	0.55	0.28	158.20	0.68	0.01	0.02	0.02	5622
18:00 to 6:00	12.89	0.69	0.00	0.28	157.74	0.94	0.02	0.00	0.00	5600
6:00 to 6:00	12.82	0.60	0.28	0.28	157.97	0.81	0.01	0.01	0.01	5611

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 9 , 2006
Report Printed on 12-10-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.76	0.75	5.82	0.29	158.52	1.00	0.02	0.24	0.07	5718
7:00 to 8:00	12.92	0.46	0.00	0.29	158.80	0.63	0.01	0.00	0.07	5658
8:00 to 9:00	12.94	0.81	0.00	0.30	158.55	1.10	0.02	0.00	0.07	5742
9:00 to 10:00	12.87	0.55	0.00	0.28	158.43	0.74	0.01	0.00	0.00	5629
10:00 to 11:00	12.89	0.62	0.00	0.29	159.32	0.84	0.01	0.00	0.00	5754
11:00 to 12:00	12.91	0.30	0.00	0.28	158.84	0.41	0.01	0.00	0.00	5576
12:00 to 13:00	12.88	0.86	0.00	0.29	159.00	1.16	0.02	0.00	0.00	5650
13:00 to 14:00	12.93	0.43	0.00	0.28	159.59	0.59	0.01	0.00	0.00	5640
14:00 to 15:00	12.84	0.70	0.00	0.28	159.47	0.95	0.02	0.00	0.00	5631
15:00 to 16:00	12.87	0.21	0.00	0.28	158.98	0.28	0.00	0.00	0.00	5549
16:00 to 17:00	13.01	0.14	0.00	0.29	159.64	0.20	0.00	0.00	0.00	5688
17:00 to 18:00	12.90	0.33	0.00	0.27	159.31	0.45	0.01	0.00	0.00	5514
18:00 to 19:00	12.91	0.32	0.00	0.28	159.00	0.43	0.01	0.00	0.00	5573
19:00 to 20:00	12.90	0.60	0.00	0.28	159.45	0.81	0.01	0.00	0.00	5603
20:00 to 21:00	12.99	0.86	0.00	0.29	159.10	1.18	0.02	0.00	0.00	5671
21:00 to 22:00	12.98	0.38	0.00	0.29	159.20	0.52	0.01	0.00	0.00	5666
22:00 to 23:00	12.96	0.42	0.00	0.29	159.97	0.57	0.01	0.00	0.00	5735
23:00 to 24:00	12.88	0.71	0.00	0.29	159.53	0.96	0.02	0.00	0.00	5636
0:00 to 1:00	13.02	0.27	0.00	0.29	159.27	0.37	0.01	0.00	0.00	5695
1:00 to 2:00	13.11	0.76	0.00	0.28	159.68	1.06	0.02	0.00	0.00	5666
2:00 to 3:00	12.96	0.40	0.00	0.29	159.13	0.55	0.01	0.00	0.00	5721
3:00 to 4:00	12.89	0.49	0.00	0.30	159.37	0.66	0.01	0.00	0.00	5794
4:00 to 5:00	12.89	0.40	0.00	0.29	159.58	0.54	0.01	0.00	0.00	5727
5:00 to 6:00	12.95	0.44	0.00	0.29	158.87	0.60	0.01	0.00	0.00	5655
Averages										
6:00 to 18:00	12.89	0.51	0.49	0.28	159.04	0.70	0.01	0.02	0.02	5646
18:00 to 6:00	12.95	0.50	0.00	0.29	159.35	0.69	0.01	0.00	0.00	5679
6:00 to 6:00	12.92	0.51	0.24	0.29	159.19	0.69	0.01	0.01	0.01	5662

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 10 , 2006
Report Printed on 12-11-2006 at 06:00:01

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.90	0.83	5.05	0.28	159.10	1.13	0.02	0.21	0.06	5629
7:00 to 8:00	12.82	0.32	0.00	0.27	159.19	0.43	0.01	0.00	0.06	5544
8:00 to 9:00	12.77	0.68	0.00	0.30	159.19	0.91	0.02	0.00	0.06	5784
9:00 to 10:00	12.84	0.50	4.71	0.30	158.90	0.68	0.01	0.20	0.06	5744
10:00 to 11:00	12.73	1.01	0.02	0.29	160.13	1.34	0.02	0.00	0.06	5762
11:00 to 12:00	12.86	0.76	0.00	0.29	159.03	1.02	0.02	0.00	0.06	5678
12:00 to 13:00	12.87	0.45	0.00	0.29	158.84	0.62	0.01	0.00	0.00	5680
13:00 to 14:00	12.90	0.68	0.00	0.30	159.59	0.93	0.02	0.00	0.00	5784
14:00 to 15:00	13.00	0.11	0.00	0.28	158.87	0.15	0.00	0.00	0.00	5577
15:00 to 16:00	12.95	1.17	0.00	0.30	159.16	1.60	0.03	0.00	0.00	5805
16:00 to 17:00	12.99	0.53	0.00	0.29	159.84	0.73	0.01	0.00	0.00	5777
17:00 to 18:00	12.95	0.57	0.00	0.30	159.53	0.78	0.01	0.00	0.00	5767
18:00 to 19:00	13.01	0.61	0.00	0.30	159.22	0.84	0.01	0.00	0.00	5741
19:00 to 20:00	12.98	0.37	0.00	0.29	159.82	0.51	0.01	0.00	0.00	5771
20:00 to 21:00	13.05	0.68	0.00	0.29	159.38	0.94	0.02	0.00	0.00	5714
21:00 to 22:00	12.98	0.08	0.00	0.29	159.54	0.11	0.00	0.00	0.00	5679
22:00 to 23:00	13.03	0.27	0.00	0.29	160.16	0.37	0.01	0.00	0.00	5766
23:00 to 24:00	12.96	0.41	0.00	0.30	159.90	0.56	0.01	0.00	0.00	5804
0:00 to 1:00	12.96	0.51	0.00	0.31	160.15	0.69	0.01	0.00	0.00	5983
1:00 to 2:00	12.93	0.38	0.00	0.30	160.66	0.52	0.01	0.00	0.00	5898
2:00 to 3:00	12.98	0.27	0.00	0.30	160.01	0.38	0.01	0.00	0.00	5871
3:00 to 4:00	13.02	0.23	0.00	0.29	159.93	0.32	0.00	0.00	0.00	5805
4:00 to 5:00	13.00	0.41	0.00	0.30	160.59	0.57	0.01	0.00	0.00	5892
5:00 to 6:00	12.98	0.52	0.00	0.30	160.13	0.71	0.01	0.00	0.00	5927
Averages										
6:00 to 18:00	12.88	0.64	0.82	0.29	159.28	0.86	0.01	0.03	0.03	5711
18:00 to 6:00	12.99	0.40	0.00	0.30	159.96	0.54	0.01	0.00	0.00	5821
6:00 to 6:00	12.94	0.52	0.41	0.29	159.62	0.70	0.01	0.02	0.01	5766

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 11 , 2006
Report Printed on 12-12-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.76	0.41	4.10	0.28	160.32	0.55	0.01	0.17	0.05	5695
7:00 to 8:00	12.81	0.53	0.00	0.29	160.61	0.71	0.01	0.00	0.05	5801
8:00 to 9:00	12.87	0.36	0.00	0.28	159.77	0.48	0.01	0.00	0.05	5606
9:00 to 10:00	12.82	0.27	0.00	0.30	159.70	0.36	0.01	0.00	0.00	5810
10:00 to 11:00	12.79	0.71	0.00	0.30	160.43	0.95	0.02	0.00	0.00	5945
11:00 to 12:00	12.75	0.30	0.00	0.29	159.72	0.40	0.01	0.00	0.00	5701
12:00 to 13:00	12.81	1.09	0.00	0.30	159.77	1.46	0.02	0.00	0.00	5819
13:00 to 14:00	12.76	0.15	0.00	0.28	159.99	0.20	0.00	0.00	0.00	5622
14:00 to 15:00	12.84	0.68	0.00	0.29	159.80	0.91	0.01	0.00	0.00	5720
15:00 to 16:00	12.89	0.20	0.00	0.27	159.36	0.27	0.00	0.00	0.00	5524
16:00 to 17:00	12.89	0.43	0.00	0.29	159.97	0.59	0.01	0.00	0.00	5754
17:00 to 18:00	12.91	0.17	0.00	0.29	159.69	0.23	0.00	0.00	0.00	5739
18:00 to 19:00	12.98	0.42	0.00	0.29	159.36	0.58	0.01	0.00	0.00	5662
19:00 to 20:00	12.89	1.04	0.00	0.31	160.49	1.41	0.02	0.00	0.00	5999
20:00 to 21:00	12.75	0.80	0.00	0.29	159.74	1.07	0.02	0.00	0.00	5698
21:00 to 22:00	12.92	0.61	0.00	0.29	159.80	0.83	0.01	0.00	0.00	5752
22:00 to 23:00	12.89	0.50	0.00	0.27	159.85	0.68	0.01	0.00	0.00	5564
23:00 to 24:00	12.87	1.05	0.00	0.29	159.65	1.42	0.02	0.00	0.00	5754
0:00 to 1:00	12.92	0.66	0.00	0.28	159.17	0.90	0.01	0.00	0.00	5573
1:00 to 2:00	12.96	0.16	0.00	0.27	159.65	0.22	0.00	0.00	0.00	5564
[illegible] 3:00	12.88	0.87	0.00	0.28	159.46	1.18	0.02	0.00	0.00	5598
3:00 to 4:00	12.81	0.39	0.00	0.28	159.16	0.52	0.01	0.00	0.00	5579
4:00 to 5:00	12.92	1.18	0.00	0.30	160.18	1.60	0.02	0.00	0.00	5817
5:00 to 6:00	13.02	0.47	0.00	0.27	159.43	0.65	0.01	0.00	0.00	5469
Averages										
6:00 to 18:00	12.83	0.44	0.34	0.29	159.93	0.59	0.01	0.01	0.01	5728
18:00 to 6:00	12.90	0.68	0.00	0.28	159.66	0.92	0.01	0.00	0.00	5669
6:00 to 6:00	12.86	0.56	0.17	0.29	159.80	0.76	0.01	0.01	0.01	5698

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 12 , 2006
Report Printed on 12-13-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.76	0.65	4.64	0.29	160.08	0.86	0.01	0.19	0.05	5746
7:00 to 8:00	12.74	1.25	0.00	0.28	160.49	1.67	0.03	0.00	0.05	5704
8:00 to 9:00	12.77	0.71	0.00	0.28	159.95	0.94	0.01	0.00	0.05	5658
9:00 to 10:00	12.77	0.84	0.00	0.28	160.02	1.12	0.02	0.00	0.00	5701
10:00 to 11:00	12.76	0.27	0.00	0.27	160.22	0.36	0.01	0.00	0.00	5509
11:00 to 12:00	12.75	0.93	0.00	0.29	160.32	1.24	0.02	0.00	0.00	5829
12:00 to 13:00	12.80	0.56	0.00	0.28	160.06	0.74	0.01	0.00	0.00	5668
13:00 to 14:00	12.77	0.30	0.00	0.27	160.43	0.40	0.01	0.00	0.00	5622
14:00 to 15:00	12.69	1.18	0.00	0.28	160.22	1.56	0.02	0.00	0.00	5730
15:00 to 16:00	12.88	0.55	0.00	0.28	160.08	0.75	0.01	0.00	0.00	5640
16:00 to 17:00	12.70	1.19	0.00	0.27	160.50	1.57	0.02	0.00	0.00	5583
17:00 to 18:00	12.82	0.19	0.00	0.27	160.07	0.25	0.00	0.00	0.00	5583
18:00 to 19:00	12.71	0.30	0.00	0.29	160.10	0.39	0.01	0.00	0.00	5754
19:00 to 20:00	12.90	0.25	0.00	0.27	160.04	0.33	0.01	0.00	0.00	5512
20:00 to 21:00	12.83	0.94	0.00	0.29	159.77	1.26	0.02	0.00	0.00	5692
21:00 to 22:00	12.87	0.51	0.00	0.28	159.52	0.69	0.01	0.00	0.00	5571
22:00 to 23:00	12.94	0.60	0.00	0.28	159.97	0.82	0.01	0.00	0.00	5710
23:00 to 24:00	12.74	0.85	0.00	0.27	159.64	1.13	0.02	0.00	0.00	5501
0:00 to 1:00	12.91	0.54	0.00	0.15	159.06	0.74	0.01	0.00	0.00	4037
1:00 to 2:00	12.79	0.60	0.00	0.27	159.86	0.81	0.01	0.00	0.00	5586
[illegible] to 3:00	12.95	0.46	0.00	0.27	159.06	0.63	0.01	0.00	0.00	5498
3:00 to 4:00	12.80	1.16	0.00	0.24	159.44	1.56	0.02	0.00	0.00	5076
4:00 to 5:00	12.88	0.86	0.00	0.25	160.19	1.16	0.02	0.00	0.00	5361
5:00 to 6:00	12.87	0.74	0.00	0.29	159.20	1.00	0.02	0.00	0.00	5702
Averages										
6:00 to 18:00	12.77	0.72	0.39	0.28	160.20	0.96	0.01	0.02	0.01	5665
18:00 to 6:00	12.85	0.65	0.00	0.26	159.66	0.88	0.01	0.00	0.00	5417
6:00 to 6:00	12.81	0.68	0.19	0.27	159.93	0.92	0.01	0.01	0.01	5541

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 13 , 2006
Report Printed on 12-14-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.96	0.36	4.92	0.19	159.47	0.49	0.00	0.20	0.05	4404
7:00 to 8:00	12.84	0.50	0.00	0.19	158.88	0.68	0.01	0.00	0.05	4414
8:00 to 9:00	12.80	0.20	0.00	0.27	158.62	0.27	0.00	0.00	0.05	5473
9:00 to 10:00	12.82	0.33	0.00	0.27	158.43	0.44	0.01	0.00	0.00	5499
10:00 to 11:00	12.87	0.35	0.00	0.28	158.96	0.47	0.01	0.00	0.00	5624
11:00 to 12:00	12.90	0.31	0.00	0.30	158.72	0.42	0.01	0.00	0.00	5757
12:00 to 13:00	12.91	0.41	0.00	0.27	157.99	0.55	0.01	0.00	0.00	5443
13:00 to 14:00	12.98	0.80	0.00	0.20	158.44	1.09	0.02	0.00	0.00	4368
14:00 to 15:00	12.99	0.70	0.00	0.30	157.73	0.96	0.02	0.00	0.00	5756
15:00 to 16:00	12.88	0.84	0.00	0.33	158.32	1.14	0.02	0.00	0.00	6041
16:00 to 17:00	12.97	0.47	0.00	0.34	158.60	0.65	0.01	0.00	0.00	6140
17:00 to 18:00	12.89	0.12	0.00	0.29	158.54	0.16	0.00	0.00	0.00	5682
18:00 to 19:00	13.06	0.68	0.00	0.34	158.36	0.94	0.02	0.00	0.00	6135
19:00 to 20:00	13.05	0.40	0.00	0.28	159.16	0.55	0.01	0.00	0.00	5579
20:00 to 21:00	12.92	0.19	0.00	0.28	158.70	0.27	0.00	0.00	0.00	5550
21:00 to 22:00	13.01	0.18	0.00	0.14	158.44	0.24	0.00	0.00	0.00	3779
22:00 to 23:00	12.90	0.56	0.00	0.35	159.26	0.76	0.01	0.00	0.00	6273
23:00 to 24:00	12.85	0.21	0.00	0.33	159.28	0.29	0.00	0.00	0.00	6057
0:00 to 1:00	12.82	0.33	0.00	0.28	158.90	0.45	0.01	0.00	0.00	5569
1:00 to 2:00	12.91	0.79	0.00	0.23	159.52	1.08	0.01	0.00	0.00	5137
2:00 to 3:00	12.89	0.14	0.00	0.28	158.89	0.18	0.00	0.00	0.00	5590
3:00 to 4:00	12.89	0.14	0.00	0.29	158.89	0.20	0.00	0.00	0.00	5647
4:00 to 5:00	12.89	0.60	0.00	0.28	159.08	0.81	0.01	0.00	0.00	5583
5:00 to 6:00	12.90	0.72	0.00	0.29	159.02	0.98	0.02	0.00	0.00	5664
Averages										
6:00 to 18:00	12.90	0.45	0.41	0.27	158.56	0.61	0.01	0.02	0.01	5383
18:00 to 6:00	12.92	0.41	0.00	0.28	158.96	0.56	0.01	0.00	0.00	5547
6:00 to 6:00	12.91	0.43	0.20	0.27	158.76	0.59	0.01	0.01	0.01	5465

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 14 , 2006
Report Printed on 12-15-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.94	0.67	3.87	0.27	159.56	0.92	0.01	0.18	0.05	5344
7:00 to 8:00	12.93	0.29	0.00	0.16	159.75	0.40	0.00	0.00	0.05	3803
8:00 to 9:00	12.98	0.24	0.00	0.29	159.34	0.33	0.01	0.00	0.05	5670
9:00 to 10:00	12.94	0.29	0.00	0.29	159.81	0.39	0.01	0.00	0.00	5718
10:00 to 11:00	12.96	1.00	0.00	0.29	160.18	1.37	0.02	0.00	0.00	5826
11:00 to 12:00	12.97	0.09	0.00	0.29	159.50	0.13	0.00	0.00	0.00	5693
12:00 to 13:00	13.05	0.01	0.00	0.30	159.54	0.01	0.00	0.00	0.00	5798
13:00 to 14:00	12.97	0.02	0.00	0.28	160.03	0.03	0.00	0.00	0.00	5694
14:00 to 15:00	12.89	0.03	0.00	0.30	160.07	0.04	0.00	0.00	0.00	5872
15:00 to 16:00	12.85	0.12	0.00	0.31	160.29	0.16	0.00	0.00	0.00	6012
16:00 to 17:00	12.85	0.01	0.00	0.29	160.35	0.02	0.00	0.00	0.00	5772
17:00 to 18:00	12.87	0.02	0.00	0.30	159.77	0.03	0.00	0.00	0.00	5780
18:00 to 19:00	12.90	0.02	0.00	0.30	159.75	0.02	0.00	0.00	0.00	5813
19:00 to 20:00	12.62	0.02	0.00	0.31	160.97	0.03	0.00	0.00	0.00	6034
20:00 to 21:00	12.84	0.02	0.00	0.34	160.42	0.03	0.00	0.00	0.00	6281
21:00 to 22:00	12.60	0.01	0.00	0.33	160.70	0.01	0.00	0.00	0.00	6268
22:00 to 23:00	12.59	0.02	0.00	0.34	161.01	0.03	0.00	0.00	0.00	6303
23:00 to 24:00	12.68	0.09	0.00	0.35	160.50	0.11	0.00	0.00	0.00	6403
0:00 to 1:00	12.60	0.18	0.00	0.28	158.66	0.24	0.00	0.00	0.00	5553
1:00 to 2:00	12.85	0.06	0.00	0.29	159.42	0.08	0.00	0.00	0.00	5673
2:00 to 3:00	12.94	0.33	0.00	0.29	158.47	0.45	0.01	0.00	0.00	5702
3:00 to 4:00	12.92	0.23	0.00	0.28	158.23	0.31	0.01	0.00	0.00	5605
4:00 to 5:00	12.78	0.73	0.00	0.29	158.79	0.98	0.02	0.00	0.00	5647
5:00 to 6:00	12.93	0.19	0.00	0.29	158.55	0.25	0.00	0.00	0.00	5660
Averages										
6:00 to 18:00	12.93	0.23	0.32	0.28	159.85	0.32	0.00	0.02	0.01	5582
18:00 to 6:00	12.77	0.16	0.00	0.31	159.62	0.21	0.00	0.00	0.00	5912
6:00 to 6:00	12.85	0.20	0.16	0.29	159.73	0.26	0.00	0.01	0.01	5747

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 15 , 2006
Report Printed on 12-16-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	13.05	0.49	3.89	0.28	159.18	0.68	0.01	0.16	0.04	5616
7:00 to 8:00	12.87	0.49	0.00	0.29	159.81	0.66	0.01	0.00	0.04	5777
8:00 to 9:00	12.89	0.24	0.00	0.29	159.45	0.32	0.01	0.00	0.04	5730
9:00 to 10:00	12.98	0.27	0.00	0.35	159.50	0.37	0.01	0.00	0.00	6186
10:00 to 11:00	12.92	0.61	0.00	0.26	159.71	0.83	0.01	0.00	0.00	5372
11:00 to 12:00	12.95	0.57	0.00	0.29	159.07	0.79	0.01	0.00	0.00	5687
12:00 to 13:00	12.93	0.29	0.00	0.31	159.17	0.39	0.01	0.00	0.00	5894
13:00 to 14:00	13.01	0.36	0.00	0.30	159.53	0.50	0.01	0.00	0.00	5867
14:00 to 15:00	12.90	0.36	0.00	0.31	159.16	0.49	0.01	0.00	0.00	5887
15:00 to 16:00	12.87	1.03	0.00	0.36	159.46	1.39	0.03	0.00	0.00	6339
16:00 to 17:00	12.92	0.22	0.00	0.41	159.58	0.30	0.00	0.00	0.00	6674
17:00 to 18:00	13.10	0.26	0.00	0.31	159.36	0.37	0.01	0.00	0.00	5836
18:00 to 19:00	12.90	0.37	0.00	0.33	159.41	0.51	0.01	0.00	0.00	6073
19:00 to 20:00	12.85	0.37	0.00	0.31	160.17	0.50	0.01	0.00	0.00	5941
20:00 to 21:00	12.82	0.91	0.00	0.34	159.78	1.22	0.02	0.00	0.00	6207
21:00 to 22:00	12.83	0.32	0.00	0.36	159.63	0.43	0.01	0.00	0.00	6305
22:00 to 23:00	12.79	0.48	0.00	0.38	160.27	0.64	0.01	0.00	0.00	6515
23:00 to 24:00	13.05	0.11	0.00	0.30	160.18	0.15	0.00	0.00	0.00	5971
0:00 to 1:00	13.02	0.13	0.00	0.31	160.42	0.18	0.00	0.00	0.00	5994
1:00 to 2:00	13.02	0.09	0.00	0.31	161.16	0.13	0.00	0.00	0.00	6082
2:00 to 3:00	13.05	0.18	0.00	0.32	160.91	0.25	0.00	0.00	0.00	6124
3:00 to 4:00	12.83	0.66	0.00	0.36	160.88	0.89	0.01	0.00	0.00	6512
4:00 to 5:00	12.70	0.53	0.00	0.34	161.26	0.70	0.01	0.00	0.00	6293
5:00 to 6:00	12.72	0.62	0.00	0.29	160.51	0.82	0.01	0.00	0.00	5885
Averages										
6:00 to 18:00	12.95	0.43	0.32	0.31	159.41	0.59	0.01	0.01	0.01	5905
18:00 to 6:00	12.88	0.40	0.00	0.33	160.38	0.54	0.01	0.00	0.00	6159
6:00 to 6:00	12.92	0.42	0.16	0.32	159.90	0.56	0.01	0.01	0.01	6032

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 16 , 2006
Report Printed on 12-17-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.85	0.27	4.55	0.28	160.56	0.36	0.00	0.16	0.04	5757
7:00 to 8:00	12.77	0.85	0.00	0.29	160.72	1.13	0.02	0.00	0.04	5858
8:00 to 9:00	12.77	0.57	0.00	0.30	160.24	0.76	0.01	0.00	0.04	5896
9:00 to 10:00	12.73	0.56	0.00	0.30	160.25	0.74	0.01	0.00	0.00	5898
10:00 to 11:00	12.65	0.75	0.00	0.32	161.19	0.99	0.02	0.00	0.00	6136
11:00 to 12:00	12.61	0.40	0.00	0.30	160.62	0.53	0.01	0.00	0.00	5901
12:00 to 13:00	12.58	0.86	0.00	0.27	160.93	1.13	0.02	0.00	0.00	5630
13:00 to 14:00	12.73	0.29	0.00	0.31	161.00	0.39	0.01	0.00	0.00	6029
14:00 to 15:00	12.74	0.27	0.00	0.35	160.60	0.37	0.01	0.00	0.00	6375
15:00 to 16:00	12.86	0.56	0.00	0.34	160.49	0.76	0.01	0.00	0.00	6311
16:00 to 17:00	13.05	0.21	0.00	0.29	160.63	0.30	0.00	0.00	0.00	5861
17:00 to 18:00	13.06	0.63	0.00	0.29	160.32	0.87	0.01	0.00	0.00	5791
18:00 to 19:00	12.85	0.35	0.00	0.30	160.61	0.47	0.01	0.00	0.00	5953
19:00 to 20:00	12.86	0.65	0.00	0.30	160.92	0.88	0.01	0.00	0.00	5981
20:00 to 21:00	12.81	0.23	0.00	0.30	160.52	0.30	0.00	0.00	0.00	5914
21:00 to 22:00	12.85	0.68	0.00	0.33	160.45	0.92	0.01	0.00	0.00	6171
22:00 to 23:00	12.87	0.70	0.00	0.31	160.81	0.95	0.01	0.00	0.00	6071
23:00 to 24:00	12.81	0.31	0.00	0.29	160.20	0.42	0.01	0.00	0.00	5790
0:00 to 1:00	12.82	0.74	0.00	0.31	160.55	1.00	0.01	0.00	0.00	6003
1:00 to 2:00	12.79	0.45	0.00	0.29	160.82	0.61	0.01	0.00	0.00	5832
2:00 to 3:00	12.80	1.17	0.00	0.31	160.54	1.57	0.02	0.00	0.00	5972
3:00 to 4:00	12.87	0.21	0.00	0.29	160.14	0.28	0.00	0.00	0.00	5885
4:00 to 5:00	12.84	0.81	0.00	0.30	160.84	1.09	0.02	0.00	0.00	5980
5:00 to 6:00	12.94	0.31	0.00	0.31	160.13	0.43	0.01	0.00	0.00	5993
Averages										
6:00 to 18:00	12.78	0.52	0.38	0.30	160.63	0.70	0.01	0.01	0.01	5954
18:00 to 6:00	12.84	0.55	0.00	0.30	160.54	0.74	0.01	0.00	0.00	5962
6:00 to 6:00	12.81	0.54	0.19	0.30	160.59	0.72	0.01	0.01	0.01	5958

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 17 , 2006
Report Printed on 12-18-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.95	0.15	5.05	0.30	159.99	0.21	0.00	0.22	0.06	5866
7:00 to 8:00	12.92	0.43	0.00	0.30	159.50	0.59	0.01	0.00	0.06	5792
8:00 to 9:00	12.89	0.22	0.00	0.30	159.00	0.30	0.01	0.00	0.06	5825
9:00 to 10:00	12.77	0.97	0.00	0.32	159.53	1.29	0.02	0.00	0.00	6049
10:00 to 11:00	13.12	0.11	0.00	0.32	159.62	0.15	0.00	0.00	0.00	6005
11:00 to 12:00	13.12	0.15	0.00	0.31	159.27	0.20	0.00	0.00	0.00	5855
12:00 to 13:00	13.21	0.23	0.00	0.32	158.63	0.33	0.01	0.00	0.00	5971
13:00 to 14:00	13.01	0.55	0.00	0.32	158.75	0.76	0.01	0.00	0.00	6013
14:00 to 15:00	12.85	0.53	0.00	0.31	159.36	0.71	0.01	0.00	0.00	5907
15:00 to 16:00	12.89	0.49	0.00	0.30	159.21	0.67	0.01	0.00	0.00	5790
16:00 to 17:00	12.94	0.29	0.00	0.29	159.76	0.40	0.01	0.00	0.00	5785
17:00 to 18:00	12.94	0.69	0.00	0.31	159.60	0.94	0.02	0.00	0.00	5847
18:00 to 19:00	13.00	0.32	0.00	0.30	159.30	0.44	0.01	0.00	0.00	5816
19:00 to 20:00	13.02	0.41	0.00	0.30	159.78	0.57	0.01	0.00	0.00	5801
20:00 to 21:00	13.01	0.31	0.00	0.31	159.42	0.42	0.01	0.00	0.00	5915
21:00 to 22:00	13.09	0.14	0.00	0.30	159.28	0.20	0.00	0.00	0.00	5824
22:00 to 23:00	12.99	0.37	0.00	0.30	159.76	0.51	0.01	0.00	0.00	5823
23:00 to 24:00	12.99	0.57	0.00	0.31	159.26	0.78	0.01	0.00	0.00	5879
0:00 to 1:00	12.85	0.74	0.00	0.31	159.34	1.00	0.02	0.00	0.00	5866
1:00 to 2:00	12.92	0.30	0.00	0.30	159.76	0.41	0.01	0.00	0.00	5824
[illegible] 3:00	12.92	0.45	0.00	0.31	159.51	0.61	0.01	0.00	0.00	5912
3:00 to 4:00	13.01	0.15	0.00	0.30	159.12	0.20	0.00	0.00	0.00	5829
4:00 to 5:00	12.91	0.22	0.00	0.31	159.98	0.30	0.00	0.00	0.00	5936
5:00 to 6:00	12.90	0.32	0.00	0.31	159.45	0.43	0.01	0.00	0.00	5877
Averages										
6:00 to 18:00	12.97	0.40	0.42	0.31	159.35	0.55	0.01	0.02	0.01	5892
18:00 to 6:00	12.97	0.36	0.00	0.31	159.50	0.49	0.01	0.00	0.00	5858
6:00 to 6:00	12.97	0.38	0.21	0.31	159.42	0.52	0.01	0.01	0.01	5875

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 18 , 2006
Report Printed on 12-19-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.96	0.09	5.10	0.31	128.38	0.13	0.00	0.22	0.06	5917
7:00 to 8:00	12.92	0.24	0.00	0.32	83.81	0.33	0.01	0.00	0.06	6123
8:00 to 9:00	12.88	0.27	0.00	0.31	160.53	0.36	0.01	0.00	0.06	5979
9:00 to 10:00	12.98	0.38	0.00	0.31	159.97	0.52	0.01	0.00	0.00	6042
10:00 to 11:00	12.83	0.64	0.00	0.31	160.52	0.87	0.01	0.00	0.00	5994
11:00 to 12:00	12.82	0.07	0.00	0.30	159.78	0.10	0.00	0.00	0.00	5858
12:00 to 13:00	12.85	0.27	0.00	0.32	159.98	0.37	0.01	0.00	0.00	6042
13:00 to 14:00	12.84	0.45	0.00	0.32	160.60	0.61	0.01	0.00	0.00	6120
14:00 to 15:00	12.93	0.63	0.00	0.30	159.57	0.86	0.01	0.00	0.00	5854
15:00 to 16:00	12.90	0.35	0.00	0.30	159.84	0.48	0.01	0.00	0.00	5857
16:00 to 17:00	12.93	0.58	0.00	0.28	160.02	0.79	0.01	0.00	0.00	5696
17:00 to 18:00	12.97	0.37	0.00	0.30	159.87	0.51	0.01	0.00	0.00	5820
18:00 to 19:00	13.00	0.41	0.00	0.30	159.51	0.57	0.01	0.00	0.00	5753
19:00 to 20:00	12.96	0.71	0.00	0.30	159.98	0.97	0.01	0.00	0.00	5887
20:00 to 21:00	12.97	0.17	0.00	0.30	159.69	0.23	0.00	0.00	0.00	5784
21:00 to 22:00	13.06	0.06	0.00	0.30	159.45	0.09	0.00	0.00	0.00	5801
22:00 to 23:00	12.98	0.15	0.00	0.29	159.92	0.21	0.00	0.00	0.00	5791
23:00 to 24:00	12.87	0.80	0.00	0.30	159.53	1.09	0.02	0.00	0.00	5774
0:00 to 1:00	12.91	0.39	0.00	0.29	159.13	0.53	0.01	0.00	0.00	5665
1:00 to 2:00	12.96	0.07	0.00	0.28	159.44	0.10	0.00	0.00	0.00	5664
2:00 to 3:00	13.02	0.26	0.00	0.29	159.09	0.36	0.01	0.00	0.00	5685
3:00 to 4:00	12.94	0.06	0.00	0.28	158.85	0.09	0.00	0.00	0.00	5599
4:00 to 5:00	12.93	0.45	0.00	0.30	159.40	0.61	0.01	0.00	0.00	5820
5:00 to 6:00	13.00	0.42	0.00	0.29	158.82	0.57	0.01	0.00	0.00	5681
Averages										
6:00 to 18:00	12.90	0.36	0.42	0.31	151.07	0.49	0.01	0.02	0.02	5942
18:00 to 6:00	12.97	0.33	0.00	0.29	159.40	0.45	0.01	0.00	0.00	5742
6:00 to 6:00	12.93	0.35	0.21	0.30	155.24	0.47	0.01	0.01	0.01	5842

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 27 , 2006
Report Printed on 12-28-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.91	1.11	4.21	0.29	135.63	1.51	0.03	0.18	0.05	5709
7:00 to 8:00	12.73	0.45	0.00	0.30	111.97	0.59	0.01	0.00	0.05	5812
8:00 to 9:00	12.85	0.29	0.00	0.29	159.26	0.39	0.01	0.00	0.05	5725
9:00 to 10:00	12.83	0.08	0.00	0.29	158.50	0.10	0.00	0.00	0.00	5645
10:00 to 11:00	13.02 C	0.00 C	7.34 C	0.30	159.61	0.01 C	0.00 C	0.31 C	0.04 I	5858
11:00 to 12:00	12.84	0.12	0.04	0.29	158.05	0.17	0.00	0.00	0.04 I	5708
12:00 to 13:00	12.82	0.59	0.00	0.29	158.29	0.79	0.01	0.00	0.03 I	5713
13:00 to 14:00	12.87	0.46	0.00	0.31	158.61	0.62	0.01	0.00	0.00	5840
14:00 to 15:00	12.78	0.16	0.00	0.29	158.54	0.21	0.00	0.00	0.00	5668
15:00 to 16:00	12.83	0.40	0.00	0.30	158.55	0.54	0.01	0.00	0.00	5830
16:00 to 17:00	12.77	0.34	0.00	0.31	159.22	0.46	0.01	0.00	0.00	5939
17:00 to 18:00	12.82	0.34	0.00	0.28	159.04	0.46	0.01	0.00	0.00	5606
18:00 to 19:00	12.84	0.30	0.00	0.29	158.48	0.40	0.01	0.00	0.00	5685
19:00 to 20:00	12.78	0.18	0.00	0.28	159.55	0.24	0.00	0.00	0.00	5644
20:00 to 21:00	12.98	0.12	0.00	0.29	158.83	0.16	0.00	0.00	0.00	5708
21:00 to 22:00	12.96	0.33	0.00	0.29	158.75	0.45	0.01	0.00	0.00	5716
22:00 to 23:00	12.89	0.55	0.00	0.29	159.24	0.75	0.01	0.00	0.00	5713
23:00 to 24:00	12.91	0.37	0.00	0.29	159.08	0.50	0.01	0.00	0.00	5730
0:00 to 1:00	12.98	0.27	0.00	0.29	158.65	0.38	0.01	0.00	0.00	5698
1:00 to 2:00	13.03	0.46	0.00	0.28	158.93	0.63	0.01	0.00	0.00	5611
2:00 to 3:00	12.97	0.19	0.00	0.30	159.17	0.25	0.00	0.00	0.00	5757
3:00 to 4:00	12.88	0.32	0.00	0.30	158.98	0.44	0.01	0.00	0.00	5809
4:00 to 5:00	12.90	0.82	0.00	0.31	159.78	1.12	0.02	0.00	0.00	5915
5:00 to 6:00	12.87	0.11	0.00	0.29	159.23	0.16	0.00	0.00	0.00	5710
Averages										
6:00 to 18:00	12.82	0.39	0.39	0.30	152.94	0.53	0.01	0.02	0.02	5754
18:00 to 6:00	12.92	0.34	0.00	0.29	159.06	0.46	0.01	0.00	0.00	5725
6:00 to 6:00	12.87	0.36	0.18	0.29	156.00	0.49	0.01	0.01	0.01	5739

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 28 , 2006
Report Printed on 12-29-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.76	0.15	2.76	0.30	159.98	0.20	0.00	0.12	0.03	5909
7:00 to 8:00	12.97	0.37	0.00	0.31	160.21	0.50	0.01	0.00	0.03	5957
8:00 to 9:00	12.93	0.55	0.00	0.30	159.81	0.74	0.01	0.00	0.03	5813
9:00 to 10:00	12.88	0.19	0.00	0.31	159.85	0.25	0.00	0.00	0.00	5901
10:00 to 11:00	12.89	0.28	0.00	0.31	160.27	0.38	0.01	0.00	0.00	6025
11:00 to 12:00	12.78	0.42	0.00	0.30	159.69	0.56	0.01	0.00	0.00	5803
12:00 to 13:00	12.84	0.40	0.00	0.33	160.16	0.54	0.01	0.00	0.00	6173
13:00 to 14:00	12.79	0.22	0.00	0.31	160.47	0.30	0.00	0.00	0.00	5997
14:00 to 15:00	12.74	0.78	0.00	0.30	159.93	1.04	0.02	0.00	0.00	5853
15:00 to 16:00	12.76	0.13	0.00	0.29	159.84	0.17	0.00	0.00	0.00	5761
16:00 to 17:00	12.92	0.10	0.00	0.28	160.09	0.13	0.00	0.00	0.00	5651
17:00 to 18:00	12.83	0.73	0.00	0.30	160.00	0.98	0.01	0.00	0.00	5864
18:00 to 19:00	12.96	0.41	0.00	0.30	159.71	0.57	0.01	0.00	0.00	5814
19:00 to 20:00	12.93	0.11	0.00	0.30	160.93	0.15	0.00	0.00	0.00	5921
20:00 to 21:00	12.87	0.59	0.00	0.30	160.34	0.80	0.01	0.00	0.00	5862
21:00 to 22:00	12.83	0.45	0.00	0.31	159.79	0.61	0.01	0.00	0.00	5924
22:00 to 23:00	12.83	0.30	0.00	0.30	160.52	0.40	0.01	0.00	0.00	5871
23:00 to 24:00	12.75	0.07	0.00	0.30	160.47	0.09	0.00	0.00	0.00	5937
0:00 to 1:00	12.94	0.62	0.00	0.30	159.26	0.85	0.01	0.00	0.00	5805
1:00 to 2:00	12.82	0.20	0.00	0.30	160.38	0.27	0.00	0.00	0.00	5837
2:00 to 3:00	12.88	0.29	0.00	0.31	159.66	0.40	0.01	0.00	0.00	5891
3:00 to 4:00	12.82	0.45	0.00	0.30	159.35	0.60	0.01	0.00	0.00	5819
4:00 to 5:00	12.79	0.51	0.00	0.31	159.81	0.69	0.01	0.00	0.00	5927
5:00 to 6:00	12.80	0.40	0.00	0.30	159.44	0.54	0.01	0.00	0.00	5794
Averages										
6:00 to 18:00	12.84	0.36	0.23	0.30	160.03	0.48	0.01	0.01	0.01	5892
18:00 to 6:00	12.85	0.37	0.00	0.30	159.97	0.50	0.01	0.00	0.00	5867
6:00 to 6:00	12.85	0.36	0.12	0.30	160.00	0.49	0.01	0.00	0.00	5880

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 29, 2006
Report Printed on 12-30-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb/Hr	FLOW scfm
6:00 to 7:00	12.92	0.36	2.64	0.30	159.39	0.49	0.01	0.11	0.03	5813
7:00 to 8:00	12.99	0.09	0.00	0.29	159.51	0.12	0.00	0.00	0.03	5772
8:00 to 9:00	12.87	0.07	0.00	0.30	159.49	0.10	0.00	0.00	0.03	5860
9:00 to 10:00	12.91	0.28	0.00	0.31	159.00	0.38	0.01	0.00	0.00	5836
10:00 to 11:00	12.81	0.38	0.00	0.30	159.60	0.52	0.01	0.00	0.00	5840
11:00 to 12:00	12.88	0.47	0.00	0.30	158.78	0.64	0.01	0.00	0.00	5822
12:00 to 13:00	12.92	0.28	0.00	0.31	159.11	0.38	0.01	0.00	0.00	5891
13:00 to 14:00	12.79	0.07	0.00	0.31	160.17	0.10	0.00	0.00	0.00	5924
14:00 to 15:00	12.88	0.46	0.00	0.30	158.96	0.62	0.01	0.00	0.00	5814
15:00 to 16:00	12.94	0.23	0.00	0.31	158.90	0.32	0.01	0.00	0.00	5833
16:00 to 17:00	12.95	0.31	0.00	0.30	159.63	0.42	0.01	0.00	0.00	5848
17:00 to 18:00	13.01	0.18	0.00	0.30	159.05	0.25	0.00	0.00	0.00	5757
18:00 to 19:00	13.11	0.32	0.00	0.30	159.19	0.44	0.01	0.00	0.00	5778
19:00 to 20:00	12.92	0.51	0.00	0.30	159.89	0.69	0.01	0.00	0.00	5908
20:00 to 21:00	13.07	0.30	0.00	0.30	159.31	0.42	0.01	0.00	0.00	5746
21:00 to 22:00	13.04	0.14	0.00	0.30	159.09	0.19	0.00	0.00	0.00	5745
22:00 to 23:00	13.00	0.15	0.00	0.29	159.77	0.21	0.00	0.00	0.00	5799
23:00 to 24:00	12.97	0.79	0.00	0.31	159.33	1.08	0.02	0.00	0.00	5857
0:00 to 1:00	12.97	0.08	0.00	0.29	159.21	0.11	0.00	0.00	0.00	5729
1:00 to 2:00	12.89	0.10	0.00	0.30	159.67	0.13	0.00	0.00	0.00	5804
2 3:00	12.99	0.19	0.00	0.30	159.01	0.27	0.00	0.00	0.00	5790
3:00 to 4:00	13.01	0.07	0.00	0.30	159.10	0.10	0.00	0.00	0.00	5816
4:00 to 5:00	12.95	0.51	0.00	0.30	159.56	0.70	0.01	0.00	0.00	5847
5:00 to 6:00	12.99	0.43	0.00	0.30	159.19	0.59	0.01	0.00	0.00	5774
Averages										
6:00 to 18:00	12.91	0.27	0.22	0.30	159.30	0.36	0.01	0.01	0.01	5834
18:00 to 6:00	12.99	0.30	0.00	0.30	159.36	0.41	0.01	0.00	0.00	5799
6:00 to 6:00	12.95	0.28	0.11	0.30	159.33	0.39	0.01	0.00	0.00	5817

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 30 , 2006
Report Printed on 12-31-2006 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.95	0.89	2.41	0.31	159.83	1.22	0.02	0.10	0.03	5947
7:00 to 8:00	12.88	0.10	0.00	0.29	160.04	0.14	0.00	0.00	0.03	5750
8:00 to 9:00	12.95	0.40	0.00	0.31	154.40	0.54	0.01	0.00	0.03	5914
9:00 to 10:00	13.05	0.80	0.00	0.31	158.19	1.10	0.02	0.00	0.00	5925
10:00 to 11:00	13.00	0.07	0.00	0.30	158.04	0.09	0.00	0.00	0.00	5796
11:00 to 12:00	12.96	0.83	0.00	0.31	157.88	1.14	0.02	0.00	0.00	5874
12:00 to 13:00	12.97	0.54	0.00	0.31	158.01	0.75	0.01	0.00	0.00	5859
13:00 to 14:00	13.05	0.32	0.00	0.31	158.10	0.45	0.01	0.00	0.00	5913
14:00 to 15:00	13.06	0.31	0.00	0.30	157.59	0.43	0.01	0.00	0.00	5802
15:00 to 16:00	13.01	0.08	0.00	0.29	157.25	0.11	0.00	0.00	0.00	5699
16:00 to 17:00	13.23	0.50	0.00	0.29	157.62	0.70	0.01	0.00	0.00	5710
17:00 to 18:00	13.02	0.24	0.00	0.29	157.84	0.34	0.01	0.00	0.00	5735
18:00 to 19:00	13.18	0.39	0.00	0.30	157.37	0.55	0.01	0.00	0.00	5755
19:00 to 20:00	13.04	0.58	0.00	0.30	158.22	0.80	0.01	0.00	0.00	5749
20:00 to 21:00	12.91	0.40	0.00	0.30	157.76	0.55	0.01	0.00	0.00	5748
21:00 to 22:00	13.14	1.07	0.00	0.31	157.62	1.50	0.02	0.00	0.00	5853
22:00 to 23:00	12.94	0.24	0.00	0.29	158.24	0.33	0.01	0.00	0.00	5708
23:00 to 24:00	12.94	0.06	0.00	0.31	158.29	0.08	0.00	0.00	0.00	5866
0:00 to 1:00	12.96	0.33	0.00	0.30	157.96	0.46	0.01	0.00	0.00	5792
1:00 to 2:00	12.95	0.07	0.00	0.30	158.29	0.10	0.00	0.00	0.00	5753
2:00 to 3:00	13.11	0.45	0.00	0.30	157.75	0.62	0.01	0.00	0.00	5803
3:00 to 4:00	12.83	0.41	0.00	0.31	157.93	0.56	0.01	0.00	0.00	5902
4:00 to 5:00	12.87	0.39	0.00	0.30	158.60	0.53	0.01	0.00	0.00	5767
5:00 to 6:00	12.78	0.13	0.00	0.30	158.20	0.18	0.00	0.00	0.00	5781
Averages										
6:00 to 18:00	13.01	0.42	0.20	0.30	157.90	0.58	0.01	0.01	0.01	5827
18:00 to 6:00	12.97	0.38	0.00	0.30	158.02	0.52	0.01	0.00	0.00	5790
6:00 to 6:00	12.99	0.40	0.10	0.30	157.96	0.55	0.01	0.00	0.00	5808

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

DAILY SUMMARY REPORT
NCG Incin HOURLY AVERAGES
POTLATCH CORP
LEWISTON, ID

REPORTING PERIOD December 31 , 2006
Report Printed on 01-01-2007 at 06:00:02

Period	O2 pct	TRS ppm	SO2 ppm	dP inWG	TEMP degF	TRS /O2	TRS Lb/Hr	SO2 Lb/Hr	SO2 Lb3Hr	FLOW scfm
6:00 to 7:00	12.87	0.11	2.16	0.30	159.28	0.15	0.00	0.09	0.03	5837
7:00 to 8:00	12.84	0.08	0.00	0.30	160.98	0.11	0.00	0.00	0.03	5959
8:00 to 9:00	13.05	0.36	0.00	0.30	160.15	0.50	0.01	0.00	0.03	5890
9:00 to 10:00	12.93	0.52	0.00	0.31	160.28	0.71	0.01	0.00	0.00	6009
10:00 to 11:00	12.83	0.10	0.00	0.30	161.51	0.13	0.00	0.00	0.00	5889
11:00 to 12:00	12.97	0.50	0.00	0.31	160.46	0.68	0.01	0.00	0.00	5999
12:00 to 13:00	12.86	0.57	0.00	0.30	160.60	0.77	0.01	0.00	0.00	5966
13:00 to 14:00	12.98	0.16	0.00	0.30	161.17	0.21	0.00	0.00	0.00	5971
14:00 to 15:00	12.91	0.09	0.00	0.29	160.62	0.12	0.00	0.00	0.00	5863
15:00 to 16:00	12.87	0.22	0.00	0.31	160.80	0.30	0.00	0.00	0.00	6023
16:00 to 17:00	12.97	0.41	0.00	0.30	161.24	0.56	0.01	0.00	0.00	5968
17:00 to 18:00	12.94	0.42	0.00	0.31	160.97	0.57	0.01	0.00	0.00	6042
18:00 to 19:00	12.95	0.57	0.00	0.31	160.99	0.77	0.01	0.00	0.00	6027
19:00 to 20:00	13.04	0.09	0.00	0.30	161.38	0.12	0.00	0.00	0.00	5891
20:00 to 21:00	12.90	0.07	0.00	0.30	160.91	0.10	0.00	0.00	0.00	5961
21:00 to 22:00	13.07	0.48	0.00	0.30	160.47	0.67	0.01	0.00	0.00	5977
22:00 to 23:00	13.04	0.38	0.00	0.29	160.62	0.52	0.01	0.00	0.00	5858
23:00 to 24:00	13.13	0.08	0.00	0.29	160.14	0.12	0.00	0.00	0.00	5819
0:00 to 1:00	13.08	0.42	0.00	0.30	160.19	0.58	0.01	0.00	0.00	5927
1:00 to 2:00	13.13	0.20	0.00	0.29	160.69	0.28	0.00	0.00	0.00	5848
2:00 to 3:00	12.97	0.32	0.00	0.30	160.54	0.44	0.01	0.00	0.00	5949
3:00 to 4:00	13.07	0.07	0.00	0.29	160.44	0.10	0.00	0.00	0.00	5865
4:00 to 5:00	13.03	0.62	0.00	0.30	161.14	0.85	0.01	0.00	0.00	5903
5:00 to 6:00	13.03	0.22	0.00	0.30	160.49	0.30	0.00	0.00	0.00	5906
Averages										
6:00 to 18:00	12.92	0.29	0.18	0.30	160.67	0.40	0.01	0.01	0.01	5951
18:00 to 6:00	13.04	0.29	0.00	0.30	160.67	0.40	0.01	0.00	0.00	5911
6:00 to 6:00	12.98	0.29	0.09	0.30	160.67	0.40	0.01	0.00	0.00	5931

NOTE: D=Source Down C=Calibration O=Out of Control
A=Alarm Probe|Opc L=Logged Off R=Anl. Recovery
N=No Data|Record I=Insufficient ^=Over Range

2006 incinerator SO2 lb / 24 hours

month total pounds =	0.29	0.32	0.36	0.34	0.31	0.33	0.31	0.44	0.48	0.52	0.42	0.3
day	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
1	0.01	0.01	0.03	0.01	0.01	0.01	0.01	0.01	0.02	0.02	0.02	0.01
2	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.02	0.02	0.01
3	0.01	0.01	0.02	0.03	0.01	0.01	0.01	0.01	0.02	0.02	0.02	0.01
4	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.02	0.01	0.01
5	0.01	0.01	0.01	0.01	0.04	0.01	0.01	0.02	0.02	0.02	0.02	0.01
6	0.01	0.01	0.02	0.01	0.02	0.01	0.01	0.01	0.02	0.03	0.01	0.01
7	0.01	0.02	0.01	0.01	0	0.01	0.01	0.01	0.02	0.02	0.01	0.03
8	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.01	0.01
9	0.01	0.03	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.02	0.01	0.01
10	0	0.01	0.03	0.01	0.01	0.01	0.02	0.02	0.02	0.02	0.01	0.02
11	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.02	0.02	0.01	0.01
12	0.01	0.01	0.01	0.01	0.01	0.02	0.01	0.02	0.02	0.02	0.01	0.01
13	0.01	0.01	0.01	0	0.01	0.02	0.01	0.02	0.02	0.02	0.01	0.01
14	0.01	0.02	0.01	0	0.01	0.01	0.01	0.02	0	0.02	0.01	0.01
15	0.01	0.02	0.01	0	0.01	0.01	0.01	0.02	0.01	0.02	0.01	0.01
16	0.01	0.02	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.03	0.01
17	0.01	0	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.01
18	0.02	0	0.01	0.01	0	0.01	0.01	0.01	0.01	0.01	0.02	0.01
19	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.01
20	0.01	0.01	0.01	0.03	0.01	0.01	0.02	0.01	0.01	0.01	0.02	0.01
21	0.01	0.01	0.01	0	0.01	0.01	0	0.02	0.02	0.01	0.01	0.01
22	0.01	0.01	0.01	0.01	0.01	0.03	0.01	0.01	0.02	0.01	0.02	0.01
23	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.02	0.01	0.01	0.01
24	0.01	0.01	0.02	0.01	0.01	0.01	0.01	0.02	0.02	0.02	0.01	0.01
25	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.02	0.01	0.02	0.01	0.01
26	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.02	0.02	0.01	0.01
27	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.02	0.02	0.02	0.01	0.01
28	0.01	0.01	0.01	0.03	0.01	0.01	0.01	0.02	0.02	0.02	0.02	0
29	0.01		0.01	0.04	0.01	0.01	0.01	0.02	0.02	0.02	0.02	0
30	0.01		0.02	0	0.01	0.01	0.02	0.02	0.02	0.02	0.01	0
31	0.01		0.01		0.01	0.01	0.01	0.03		0.02		0

CHEMETICS INTERNATIONAL COMPANY LTD.
MoDo-Chemetics Division

1818 Cornwall Avenue
Vancouver, British Columbia
Canada V6J 1C7

Telefax: (604) 737-4458
Telephone: (604) 734-1200
Telex: 04-507612

To:	Paul A. Horton	**Date:**	February 17, 1993
Company:	Potlatch Corporation	**From:**	Clayton Cunningham
Location:	Lewiston, ID	**No. of Pages:**	5
Project No:	92M06600	**cc:**	M. Regan, ~~L. Tench~~ Lori Law
Telefax No:	(208) 799-1788		
Reference:	Incinerator Permit Information		

Below are our answers to the questions asked by the State of Idaho that were listed in your Feb. 11/93 fax. Please note that our process calculations are based on mill operating data while our guarantees are more conservatively based on over 20 years of empirical data. Therefore, it is not possible for us to directly relate mill operating data (flows, pressure drops, temperature) to our guarantees.

1. The performance guarantee of a maximum 5 ppm TRS concentration in the outgoing flue gas (dry basis corrected to 10% oxygen content) is a number determined strictly from empirical data that MoDo-Chemetics has collected over the years from working JETTHERM's. 5 ppm is a value which has been easily obtained in existing systems and one which MoDo-Chemetics feels confident in guaranteeing. During normal operation, MoDo-Chemetics believes that all of our incinerators operate at residual TRS concentrations in the outgoing flue gas that are much less than 5 ppm.

   The minimum NCG flow rate to the incinerator is zero, although a nominal operating minimum (based on flow between blows) has been calculated to be 400 acfm @ 140°F at Potlatch.

   The maximum NCG flowrate at which the incinerator can destroy TRS to 5 ppm is unknown. This guarantee value of 5 ppm is a MoDo-Chemetics standard that is based on empirical data from existing systems. All of the JETTHERMs to date operate at residual TRS levels significantly below 5 ppm.

   MoDo-Chemetics quoted Potlatch a recommended maximum of 830 acfm at 140°F to the incinerator which is greater than the operating maximum that is determined by summing the single peak blows of the existing NCG sources and the future TRS stripping system source (see Section 3.2 of proposal 92M066BP). The recommended maximum flow of 830 acfm is deemed easily sufficient to collect all gas sources and incinerate them while minimizing piping and equipment costs. This quoted maximum flow does not represent a maximum flow that the incinerator can destroy to 5 ppm TRS which would be much higher than 830 acfm.

Calculations of Gas Retention Time

Total volume of incinerator (including ducting)	=	150 ft^3		
@ peak flow conditions ——————> total flow	=	17511	acfm	@ 1500°F
∴ retention time = $\frac{150}{(27511/60)}$	=	0.33 sec		
@ nominal (between blows) ——————> total flow	=	16,861	acfm	@ 1500°F
∴ retention time = $\frac{150}{(16861/60)}$	=	0.53 sec		

Note 1500°F is the temperature maintained in the upper incinerator and ducting.

The incinerator design is based upon destruction of TRS at high turbulence and higher temperature (2500-3000°F) in the flame zone. Incineration is similar to all reaction kinetics where the time/temperature relationship is the controlling variable and mixing is the uncontrolled variable. In the JETTHERM the turbulence and high temperature allow much shorter residence times. MoDo-Chemetics have two U.S. installations where the retention time upstream of the quencher is less than 0.15 seconds and TRS levels have consistently met the 5 ppm TRS compliance levels.

2. Temperature is the only main process variable that needs to be controlled and monitored in order to ensure that the emission limits in the performance guarantee are met. Other parameters do not necessarily need to be constantly monitored because they are all dependent on the incinerator temperature.

3. We do not have a detailed breakdown of the percent destruction efficiency of the individual compounds (H_2S, MS, DMS and DMDS) in our incinerators, but we have empirical data for total TRS in the outgoing flue gas and this total TRS is consistently below 5 ppm.

4. The following restates the approximate composition of NCG sources as per the memo to Jim Stutzman on Jan. 5, 1993:

Component	Turpentine Vent lb/hr	Evaporator Vent lb/hr	M & D Digesters lb/hr	Stripper Gas lb/hr	Batch Digesters Peak lb/hr	Batch Digesters Avg lb/hr
H_2S	Trace	19	2	33	34	15
CH_3SH	Trace	15	10	93	146	65
$(CH_3)_2S$	Trace	18	11	75	126	55
$CH_3)_2S_2$	Trace	19	4	35	32	14
N_2	143	569	379	Trace	723	363
O_2	16	63	42	Trace	80	40
$H_2O_{(v)}$	25	97	65	20	123	62

5. The SO_2 scrubber at Potlatch is guaranteed to remove SO_2 from the incinerator flue gas to a maximum residual flow of 20 tons/yr based on 357 operating days per year. For the purpose of the guarantee test run measurements, this is equivalent to an hourly average of 4.7 lb/hr.

Note that the SO_2 scrubber is NOT designed to scrub out **TRS**. It is assumed that TRS gases have already been destroyed, though it is possible that small portions of any residual TRS may be removed.

The maximum gas flow rate used in the calculations was not based on the guarantee, but rather was based on mill operating peak flow data. Operating at this calculated maximum gives residual SO_2 flow well below the guarantee maximum.

The maximum gas flow to the scrubber (design basis) is 475,000 scfh. The maximum gas flow to meet the guarantee is not known, but would be greater than 475,000 scfh since MoDo-Chemetics uses normal conservative engineering practices.

6. The following are required ranges for the scrubber:

pH - 9 to 10.5 sufficient though >10.0 is recommended. (Peak SO_2 load is the determining factor during a batch digester blow).

Recirculating flow rate - 450 gpm is recommended to ensure sufficient contacting and chemical reaction.

Continuous caustic makeup flow rate - 50 gpm 5% caustic or 25 gpm 10% caustic is recommended based on empirical SO_2 production.

Pressure drop - 1" to 10" pressure drop is expected based on gas flow loading variations.

7. Performance Guarantee - see attached.

<u>Additional Question</u>

8. Will moisture in the NCG gases have an effect on incinerator performance?

The moisture in the NCG gases has no impact on incinerator performance when the incinerator is installed, operated and maintained according to MoDo-Chemetics' recommendations.

CC:jw

6.1 Performance Guarantee

MoDo-Chemetics guarantees that the incinerator system will efficiently thermally oxidize the TRS compounds to SO_2 to a residual TRS concentration in the outgoing flue gas of 5 ppm maximum on a dry basis corrected to 10% oxygen content.

MoDo-Chemetics guarantees that the SO_2 scrubbing system will remove SO_2 from the incinerator flue gas to maximum residual flow of 20 tons/yr based on 357 operating days per year. For the purpose of the guarantee test run measurements, this is equivalent to an hourly average of 4.7 lb/hr.

Both guarantees require that the incineration and SO_2 scrubbing systems are installed, operated and maintained according to MoDo-Chemetics' recommendations, and source flows do not exceed those listed in Section 3.2.

Should the system not reach satisfactory performance through fault in MoDo-Chemetics' design or supply, MoDo-Chemetics shall, at its own cost, modify the system to achieve acceptable performance. The guarantee does not cover costs for labor to remove defective parts or re-install replacement parts, or costs for shipping defective or replacement parts to and from the mill.

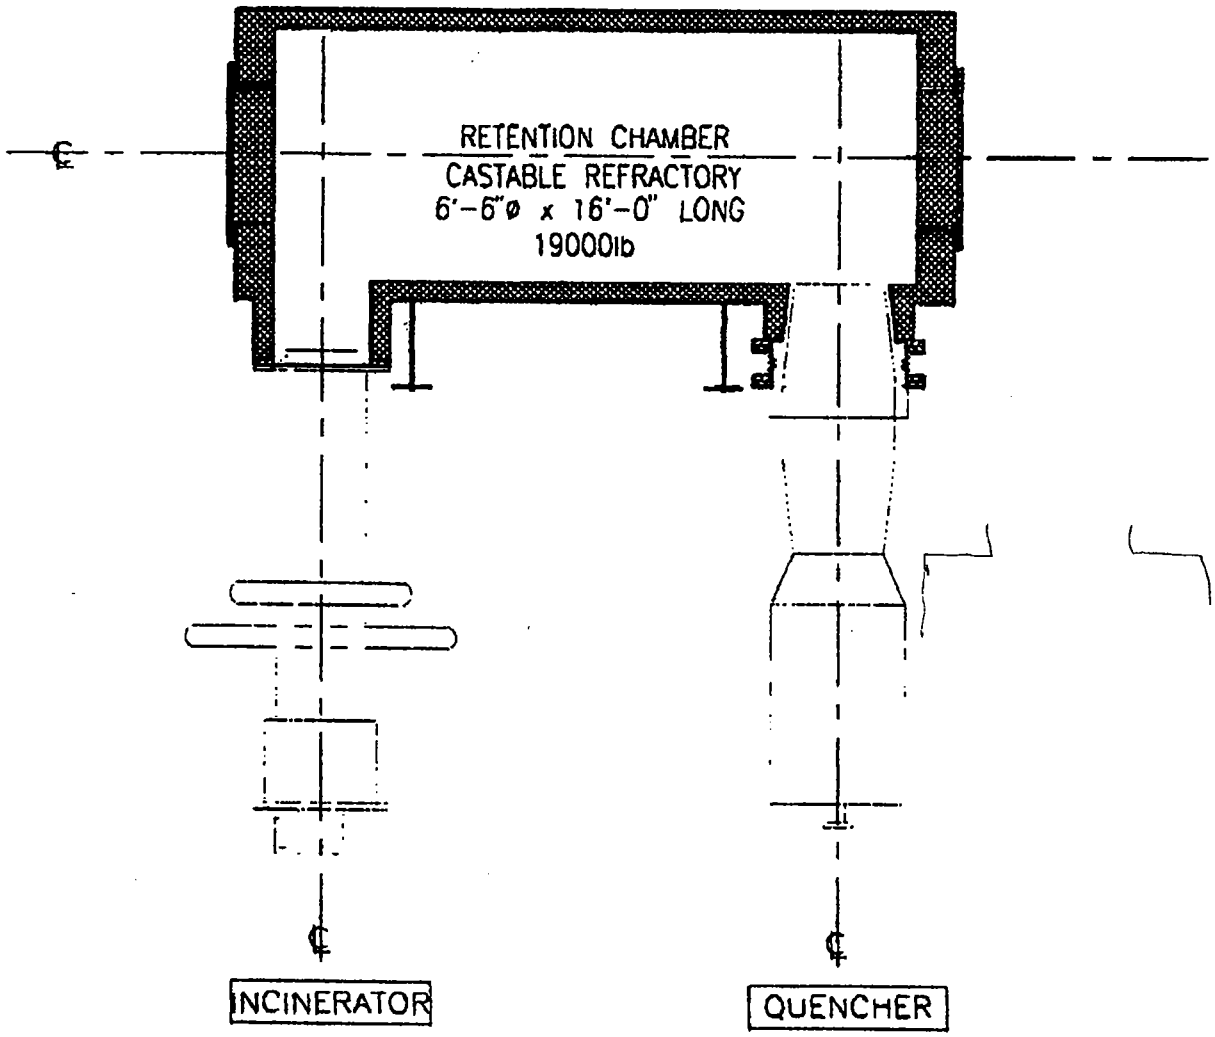

$\frac{6.5}{2} \times 3.14 \times 16$

530 cubic feet

POTLATCH LEWISTON IDAHO	Kvaerner Chemetics				
INCINERATOR FLUE GAS	APPD:		APPD		SCALE: NTS
DUCT REPLACAMENT	CHKD		DRAWING NUMBER		REV
	DRWN. BMA	98/06/22	A 97M135BP SK4		A

ALL INFORMATION CONTAINED IN THIS DOCUMENT IS CONFIDENTIAL, IS THE PROPERTY OF KVAERNER CHEMETICS AND MUST NOT BE REPRODUCED OR USED IN ANY WAY EXCEPT AS EXPRESSLY PERMITTED BY KVAERNER CHEMETICS. © KVAERNER CHEMETICS, A DIVISION OF KVAERNER CANADA INC. UNPUBLISHED

DATE LAST REVISED: JUNE 22, 1998 - 14:51
CAD REFERENCE: [BANDERSO] P:\BPVLAY\SK4.DWG