


A. Permit Certificate

**MUNICIPAL
WASTEWATER REUSE PERMIT
LA-000147-03**

The City of Murtaugh, LOCATED AT P. O. Box 157, Murtaugh, ID 83344 AND IN Township 11 South, Range 20 East, Section 6 IS
HEREBY AUTHORIZED TO CONSTRUCT, INSTALL, AND OPERATE A WASTEWATER REUSE SYSTEM IN ACCORDANCE WITH THE RECYCLED WATER RULES (IDAPA 58.01.17) AND THE WASTEWATER RULES (IDAPA 58.01.16), THE GROUND WATER QUALITY RULE (IDAPA 58.01.11), AND ACCOMPANYING PERMIT, APPENDICES, AND REFERENCE DOCUMENTS. THIS PERMIT IS EFFECTIVE FROM THE DATE OF SIGNATURE AND EXPIRES ON **MARCH 2, 2017.**

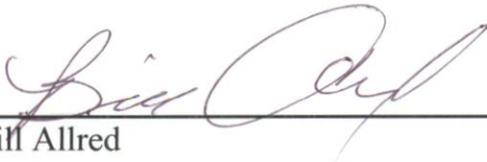

Bill Allred
Regional Administrator

Date: 03-02-2012

**DEPARTMENT OF ENVIRONMENTAL QUALITY
1363 Fillmore Street
Twin Falls, ID 83301
(208) 736-2190**

B. Permit Contents, Appendices, and Reference Documents

	Page
A. Permit Certificate	1
B. Permit Contents, Appendices and Attachments	2
C. Abbreviations, Definitions	3
D. Facility Information	5
E. Compliance Schedule for Required Activities	6
F. Permit Limits and Conditions	7
G. Monitoring Requirements	9
H. Standard Reporting Requirements	11
I. Standard Permit Conditions: Procedures and Reporting	12
J. Standard Permit Conditions: Modifications, Violation, and Revocation	14

Appendices

1. Environmental Monitoring Serial Numbers
2. Site Maps

References

1. Plan of Operation (Operation and Maintenance Manual)

The Sections, Appendices, and Reference Documents listed on this page are all elements of Wastewater Reuse Permit LA-000147-03 and are enforceable as such. This permit does not relieve the City of Murtaugh, hereafter referred to as the permittee, from responsibility for compliance with other applicable federal, state, or local laws, rules, standards or ordinances.

C. Abbreviations, Definitions

Ac-in	Acre-inch. The volume of water or wastewater to cover 1 acre of land to a depth of 1 inch. Equal to 27,154 gallons.
BMP or BMPs	Best Management Practices
COD	Chemical Oxygen Demand
DEQ or the Department	Idaho Department of Environmental Quality
Director	Director of Idaho Department of Environmental Quality, or the Directors Designee, i.e. Regional Administrator
ET	Evapotranspiration – Loss of water from the soil and vegetation by evaporation and by plant uptake (transpiration)
GS	Growing Season – Typically April 01 through October 31 (214 days)
GW	Groundwater
GWQR	IDAPA 58.01.11 “Groundwater Quality Rule”
Guidance	Guidance for Reclamation and Reuse of Municipal and Industrial Wastewater, DEQ.
HLRgs	Growing Season Hydraulic Loading Rate. Includes any combination of wastewater and supplemental irrigation water applied to reuse hydraulic management units during the growing season. The HLRgs limit is specified in Section F. Permit Limits and Conditions.
HLRngs	Non-Growing Season Hydraulic Loading Rate. Includes any combination of wastewater and supplemental irrigation water applied to each hydraulic management unit during the non-growing season. The HLRngs limit is specified in Section F. Permit Limits and Conditions.
HMU	Hydraulic Management Unit (Serial Number Designation is MU)
IWR	<p>Irrigation Water Requirement – Any combination of wastewater and supplemental irrigation water applied at rates commensurate to the moisture requirements of the crop, and calculated monthly during the growing season (GS). The equation used to calculate the IWR is:</p> $IWR = P_{def} / E_i$ <p>P_{def} is the precipitation deficit and is synonymous with the net irrigation water requirement of the crop. The P_{def} can be found at the following website: http://www.kimberly.uidaho.edu/ETIdaho/.</p> <p>E_i is the irrigation system efficiency.</p>
IDAPA	Idaho Administrative Procedures Act.
LG	Lagoon
lb/ac-day	Pounds (of constituent) per acre per day
MG	Million Gallons (1 MG = 36.827 acre-inches)
MGA	Million Gallons Annually (per WLAP Reporting Year)
NGS	Non-Growing Season – Typically November 01 through March 31 (151 days)
NVDS	Non-Volatile Dissolved Solids (= Total Dissolved Solids less Volatile Dissolved Solids)
O&M Manual	Operation and Maintenance Manual, also referred to as the Plan of Operation

C. Abbreviations, Definitions

Reuse	The use of recycled water for, irrigation, ground water recharge, landscape impoundments, toilet flushing in commercial buildings, dust control, and other uses.
Reuse Reporting Year	The reporting year begins with the Non-growing Season and extends through the growing season of the following year, typically November 01 – October 31. For example, the 2000 Reporting Year was November 01, 1999 through October 31, 2000.
RIB	Rapid Infiltration Basin
SAR	Sodium Absorption Ratio
SI	Supplemental Irrigation water applied to the reuse treatment site
Soil AWC	Soil Available Water Holding Capacity - the water storage capability of a soil to a depth at which plant roots will utilize (typically 60 inches or root limiting layer)
SMU	Soil Monitoring Unit (Serial Number designation is SU)
SW	Surface Water
TDS	Total Dissolved Solids or Total Filterable Residue
TDIS	Total Dissolved Inorganic Solids – The summation of chemical concentration results in mg/L for the following common ions: calcium, magnesium, potassium, sodium, chloride, sulfate, and 0.6 times alkalinity (alkalinity expressed as calcium carbonate). Nitrate, silica, and fluoride shall be included if present in significant quantities (i.e. > 5 mg/L each).
TMDL	Total Maximum Daily Load – The sum of the individual Waste-load Allocations (WLA's) for point sources, Load Allocations (LA's) for non-point sources, and natural background. Such load shall be established at a level necessary to implement the applicable water quality standards with seasonal variations and a margin of safety that takes into account any lack of knowledge concerning the relationship between effluent limitations and water quality. IDAPA 58.01.02 <i>Water Quality Standards and Wastewater Treatment Requirements</i>
Typical Crop Uptake	Typical Crop Uptake is defined as the median constituent crop uptake from the three (3) most recent years the crop has been grown. Typical Crop Uptake is determined for each hydraulic management unit. For new crops having less than three years of on-site crop uptake data, regional crop yield data and typical nutrient content values, or other values approved by DEQ may be used.
USGS	United States Geological Survey
WW	Wastewater applied to the reuse treatment site

D. Facility Information

Legal Name of Permittee	City of Murtaugh
Type of Wastewater	Municipal Wastewater Class E
Method of Treatment	One (1) partially aerated lagoon and 1 facultative lagoon, land application through rapid infiltration basins (RIB).
Type of Facility	Publically Owned Treatment Work
Facility Location	Two lagoons and three RIBs, located approximately one quarter mile NW of the City of Murtaugh.
Legal Location	Township 11 South, Range 20 East, Section 6
County	Twin Falls
USGS Quad	Murtaugh
Soils on Site	Primarily Portneuf silt loam
Depth to Groundwater	20 to 110 feet
Beneficial Uses of Ground water	Agriculture, Domestic
Nearest Surface Water	Dry Creek, located approximately 300 feet South of land application site.
Beneficial Uses of Surface Water	Agriculture, Recreation, Aquatic Life
Responsible Official Mailing Address	Dee Hunsaker, Mayor P. O. Box 157 Murtaugh, Idaho 83344
Phone / Fax	(208) 432-5543 / (208) 432-6682
Facility Contact Mailing Address	Kevin McClain, Public Works Director P. O. Box 157 Murtaugh, Idaho 83344
Phone / Fax	(208) 432-5543 / (208) 432-6682

E. Compliance Schedule for Required Activities

The Activities in the following table shall be completed on or before the Completion Date unless modified by the Department in writing.

Compliance Activity Number Completion Date	Compliance Activity Description
CA-147-01 One (1) year after permit issuance	<p>The permittee shall submit to DEQ for review and approval an addendum to the updated Plan of Operation (otherwise known as Operation and Maintenance Manual or O&M Manual) to address the requirements of this permit. This addendum shall include an update to the Sampling and Testing section of the Operation and Maintenance Manual, incorporating the changes made in the Monitoring Requirements section of this permit; a Quality Control and Quality Assurance Plan; and a description of operation or design modifications needed to ensure that effluent is evenly distributed along the RIBs, as required by IDAPA 58.01.17.613.01.c.</p> <p>Upon approval, the manual and addendum shall be incorporated by reference into this permit and shall be enforceable as a part of this permit.</p>
CA-147-02 One hundred eighty (180) days prior to permit expiration	Submit an application package to DEQ for permit renewal.

F. Permit Limits and Conditions

- 1) The Permittee is allowed to apply wastewater and treat it on a reuse site as prescribed in the tables below and in accordance with all other applicable permit conditions and schedules.

Category	Permitted Limits and Conditions
Type of Wastewater	Municipal Wastewater Class E
Application Site Area	Three (3) rapid infiltration basins (RIBs), 2 with an area of 0.99 acres each and 1 with an area of 0.95 acres, see site map in Appendix 2.
Application Season	Growing and Non-growing: January 1 through December 31
Growing Season (GS)	See definitions, abbreviations
Non-Growing Season (NGS)	See definitions, abbreviations
System Operator Licensure Requirement	See the Section Public Wastewater System Operator Licensure Requirements in Wastewater Rules IDAPA 58.01.16.203 to determine the requirements for this system and provide DEQ proof of compliance with the operator licensure requirements.
Maximum Hydraulic Loading Rate, Growing and Non-growing Season (MG/year)	Total effluent to both RI basins of 16 million gallons per year, with a design application rate of 1.1 inches/hour.
Runoff	No runoff of wastewater allowed.
Groundwater Quality	Groundwater Quality shall be in compliance with <i>Idaho Groundwater Quality Rule</i> IDAPA 58.01.11.
Total Suspended Solids (TSS)	150 mg/L, monthly average
Maximum Nitrogen Loading Rate, Total Nitrogen (Total Kjeldahl Nitrogen+Nitrate and Nitrite Nitrogen)	30 mg/L, monthly average
Construction Plans	Prior to construction or modification of all wastewater facilities associated with the reuse system or expansion, detailed plans and specifications shall be reviewed and approved by DEQ. Within 30 (thirty) days of completion of construction, the permittee shall submit as-built plans to DEQ or submit a certification letter stating that all construction was done in substantial compliance with DEQ-approved plans and specifications.
Fencing and Posting	Public access to the application site shall be prevented by using a physical barrier or other measure approved by the department. Signs shall be posted around the perimeter of the application site stating that recycled water is used and is not safe for drinking or human contact. Signs shall be posted and must state "Warning: Recycled Water – Do Not Enter", or equivalent signage in both English and Spanish, translated as "Aviso: Agua Reciclada - No Entre".

F. Permit Limits and Conditions

Category	Permitted Limits and Conditions
Odor Management	The wastewater treatment plant, reuse facilities, and other operations associated with the facility shall not create a public health hazard or nuisance conditions, including odors.
Buffer Zone Distances	<ul style="list-style-type: none">• 50 feet from Public Access• 300 feet from Inhabited Dwellings• 100 feet from Surface Water• 50 feet from Irrigation Ditches and Canals• 500 feet from Private Water Sources• 1,000 feet from Public Water Sources

G. Monitoring Requirements

- 1) Appropriate analytical methods, as given in the *Guidance for Reclamation and Reuse of Municipal and Industrial Wastewater* or as approved by Department of Environmental Quality (hereinafter referred to as DEQ), shall be employed. A description of approved sample collection methods, appropriate analytical methods and companion QA/QC protocol shall be included in the Operation and Maintenance Manual.
- 2) The permittee shall monitor and measure parameters and submit information as stated in the Facility Monitoring Table in this section.
- 3) Samples shall be collected at times and locations that represent typical environmental and process parameters being monitored.
- 4) Monitoring locations are described in Appendix 1. Environmental Monitoring Serial Numbers.
- 5) Monitoring is required at the frequency shown in the table below if wastewater is applied anytime during the time period shown. Unless otherwise agreed in writing by DEQ, data collected and submitted shall include, but not be limited to, the parameters and frequencies in the Facility Monitoring Table as follows.
- 6) Groundwater Monitoring Procedure: Groundwater Monitoring Wells shall be purged a minimum of three casing volumes and/or until field measurements for pH, specific conductance and temperature meet the following conditions: two successive temperature values measured at least five minutes apart are within one degree Celsius of each other, pH values for two successive measurements measured at least five minutes apart are within 0.2 units of each other, and two successive specific conductance values measured at least five minutes apart are within 10% of each other. This procedure will determine when the wells are suitable for sampling for constituents required by the permit. Other procedures, such as low flow sampling, may be considered by DEQ for approval. The static water level shall be measured prior to pumping or sampling for groundwater.
- 7) Annual reporting of monitoring requirements is described in Section H, Standard Reporting Requirements.

Facility Monitoring Table

Frequency	Monitoring Point	Description and Type of Monitoring	Parameters
Daily	Parshall Flume and Ultrasonic Level Sensor/Transmitter	Influent Flow to Lagoons #1 and #2	Volume to lagoons (MG), record daily (weekdays) and compile monthly.
Monthly	Headworks Structure	Influent Quality Grab Sample ¹	TKN (mg/L) Nitrate+Nitrite-Nitrogen (mg/L) Total Suspended Solids (mg/L) pH COD (mg/L) Total Phosphorus (mg/L)
Daily (During RIB Dosing)	Weir Elevation	Effluent Flow Volume of Effluent to Each RIB Visually Observe and Record	Volume to each RIB (MG and acre-inches), record daily and report annually.

G. Monitoring Requirements

Frequency	Monitoring Point	Description and Type of Monitoring	Parameters
Monthly (During RIB Dosing)	Wastewater Prior to RIBs	Effluent Quality Grab Sample ¹	TKN (mg/L) Nitrate+Nitrite-Nitrogen (mg/L) Total Dissolved Solids (mg/L) Total Suspended Solids (mg/L) pH COD (mg/L) Total Phosphorus (mg/L) Fecal Coliform (CFU/100 mL)
Semi-Annually (April and October)	Groundwater Monitoring Wells GW-014701, GW-014702, GW-014703, GW-014704	Groundwater Quality See Notes 1) through 6) above.	Total Dissolved Solids (mg/L) Nitrate+Nitrite Nitrogen (mg/L) Total Phosphorus (mg/L)
Quarterly (January, April, July, and October) for first two years of permit; Semi-Annually (April and October) subsequently.	Groundwater Monitoring Wells GW-014701, GW-014702, GW-014703, GW-014704	Static Water Level	Static Water Level (ft.) used to create a groundwater potentiometric map
Annually	All flow measurement locations.	Flow measurement calibration of all flows to reuse.	Document the flow measurement calibration of all flow meters and pumps used directly or indirectly, measure all wastewater applied to each HMU.
April and October of first and last permit years only, for both groundwater and wastewater effluent samples.	Groundwater Monitoring Wells GW-014701, GW-014702, GW-014703, GW-014704, and Wastewater Prior to RIBs	Grab Sample of Groundwater (See Note 6) Grab Sample ¹ of Wastewater Effluent	Calcium (mg/L) Magnesium (mg/L) Potassium (mg/L) Sodium (mg/L) Bicarbonate (mg/L) Carbonate (mg/L) Chloride (mg/L) Sulfate (mg/L) (Duplicate measurements of constituents from other tests are not necessary.)

1. Grab samples shall be obtained at a location that yields a representative sample.

H. Standard Reporting Requirements

1. The permittee shall submit an Annual Wastewater Reuse Site Performance Report ("Annual Report") prepared by a competent environmental professional no later than January 31 of each year which shall cover the previous year (see section F for reuse reporting period). The Annual Report shall include results for monitoring required in Section G, status of compliance activities, and an interpretive discussion of monitoring data (groundwater, vadose zone, hydraulic loading, wastewater etc.) with particular respect to environmental impacts by the facility.
2. The annual report shall contain the results of the required monitoring as described in Section G. Monitoring Requirements. If the permittee monitors any parameter more frequently than required by this permit, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the annual report.
3. The annual report shall be submitted to the Engineering Manager in the applicable Regional DEQ Office.

Twin Falls Regional Office
1363 Fillmore St.
Twin Falls, ID 83301
208-736-2190
4. Notice of completion of any work described in Section E. Compliance Schedule for Required Activities shall be submitted to the Department within 30 (thirty) days of activity completion. The status of all other work described in Section E shall be submitted with the Annual Report.
5. All laboratory reports containing the sample results for monitoring required by Section G. Monitoring Requirements of this permit shall be submitted with the Annual Report.

I. Standard Permit Conditions: Procedures and Reporting

1. The permittee shall at all times properly maintain and operate all structures, systems, and equipment for treatment, operational controls and monitoring, which are installed or used by the permittee to comply with all conditions of the permit or the Wastewater Reuse Permit Regulations, in conformance with a DEQ approved, current Plan of Operations (Operations and Maintenance Manual) which describes in detail the operation, maintenance, and management of the wastewater treatment system. This Plan of Operations shall be updated as necessary to reflect current operations.
2. Wastewater(s) or recharge waters applied to the land surface must be restricted to the premises of the application site. Wastewater discharges to surface water that require a permit under the Clean Water Act must be authorized by the U.S. Environmental Protection Agency.
3. Wastewater must not create a public health hazard or nuisance condition as stated in IDAPA 58.01.16.600.03. In order to prevent public health hazards and nuisance conditions the permittee shall:
 - a. Apply wastewater as evenly as practicable to the treatment area;
 - b. Prevent organic solids (contained in the wastewater) from accumulating on the ground surface to the point where the solids putrefy or support vectors or insects; and
 - c. Prevent wastewater from ponding in the fields to the point where the ponded wastewater putrefies or supports vectors or insects.
4. The permittee shall:
 - a. Manage the wastewater reuse treatment site as an agronomic operation where vegetative cover is grown and harvested or grazed to utilize the nutrients and minerals in the wastewater, and,
 - b. Not hydraulically overload any particular areas of the wastewater reuse treatment site.
5. All waste solids, including dredgings and sludges, shall be utilized or disposed in a manner which will prevent their entry, or the entry of contaminated drainage or leachate therefrom, into the waters of the state such that health hazards and nuisance conditions are not created; and to prevent impacts on designated beneficial uses of the groundwater and surface water. The permittee's management of waste solids shall be governed by the terms of DEQ approved Waste Solids Management Plan, which upon approval shall be an enforceable portion of this permit.
6. If the permittee intends to continue operation of the permitted facility after the expiration of an existing permit, the permittee shall apply for a new permit at least six months prior to the expiration date of the existing permit in accordance with the Wastewater Reuse Permit Regulations and include seepage tests on all lagoons per latest DEQ procedures.
7. The permittee shall allow the Director of Department of Environmental Quality or the Director's designee (hereinafter referred to as Director), consistent with Title 39, Chapter 1, Idaho Code, to:
 - a. Enter the permitted facility,
 - b. Inspect any records that must be kept under the conditions of the permit.
 - c. Inspect any facility, equipment, practice, or operation permitted or required by the permit.
 - d. Sample or monitor for the purpose of assuring permit compliance, any substance or any parameter at the facility.
8. The permittee shall report to the Director under the circumstances and in the manner specified in this section:
 - a. In writing thirty (30) days before any planned physical alteration or addition to the permitted facility or activity if that alteration or addition would result in any significant change in information that was submitted during the permit application process.
 - b. In writing thirty (30) days before any anticipated change which would result in non-compliance with any permit condition or these regulations.
 - c. Orally within twenty-four (24) hours from the time the permittee became aware of any non-compliance which may endanger the public health or the environment at telephone numbers provided in the permit by the Director (see below)

DEQ Regional Office: see Permit Certification Page
Emergency 24 Hour Number 1-800-632-8000

LA-000147-03	City of Murtaugh	March 2, 2012	Page 12
--------------	------------------	---------------	---------

I. Standard Permit Conditions: Procedures and Reporting

- d. In writing as soon as possible but within five (5) days of the date the permittee knows or should know of any non-compliance unless extended by DEQ. This report shall contain:
 - i. A description of the non-compliance and its cause;
 - ii. The period of non-compliance including to the extent possible, times and dates and, if the non-compliance has not been corrected, the anticipated time it is expected to continue; and
 - iii. Steps taken or planned to reduce or eliminate reoccurrence of the non-compliance.
- e. In writing as soon as possible after the permittee becomes aware of relevant facts not submitted or incorrect information submitted, in a permit application or any report to the Director. Those facts or the correct information shall be included as a part of this report.
9. The permittee shall take all necessary actions to prevent or eliminate any adverse impact on the public health or the environment resulting from permit noncompliance.
10. The permittee shall determine (on an on-going basis) if any noxious weed problems relate to the permitted sites. If problems are present, coordinate with the Idaho Department of Agriculture or the local County authority regarding their requirements for noxious weed control. Also address these control operations in an update to the Operations and Maintenance Manual.

J. Standard Permit Conditions: Modifications, Violations, and Revocations

1. The permittee shall furnish to the Director within reasonable time, any information including copies of records, which may be requested by the Director to determine whether cause exists for modifying, revoking, re-issuing, or terminating the permit, or to determine compliance with the permit or these regulations.
2. Both minor and major modifications may be made to this permit as stated in IDAPA 58.01.17.700.01 and 02 with respect to any conditions stated in this permit upon review and approval of the DEQ.
3. Whenever a facility expansion, production increase or process modification is anticipated which will result in a change in the character of pollutants to be discharged or which will result in a new or increased discharge that will exceed the conditions of this permit, or if it is determined by DEQ that the terms or conditions of the permit must be modified in order to adequately protect the public health or environment, a request for either major or minor modifications must be submitted together with the reports as described in I. *Standard Reporting Requirements*, and plans and specifications for the proposed changes. No such facility expansion, production increase or process modification shall be made until plans have been reviewed and approved by DEQ and a new permit or permit modification has been issued.
4. Permits shall be transferable to a new owner or operator provided that the permittee notifies the Director by requesting a minor modification of the permit before the date of transfer.
5. Any person violating any provision of the Wastewater Reuse Permit Regulations, or any permit or order issued thereunder shall be liable for a civil penalty not to exceed ten thousand dollars (\$10,000) or one thousand dollars (\$1,000) for each day of a continuing violation, whichever is greater. In addition, pursuant to Title 39, Chapter 1, Idaho Code, any willful or negligent violation may constitute a misdemeanor.
6. The Director may revoke a permit if the permittee violates any permit condition or the Wastewater Reuse Permit Regulations.
7. Except in cases of emergency, the Director shall issue a written notice of intent to revoke to the permittee prior to final revocation. Revocation shall become final within thirty-five (35) days of receipt of the notice by the permittee, unless within that time the permittee request an administrative hearing in writing to the Board of Department of Environmental Quality pursuant to the Rules of Administrative Procedures contained in IDAPA 58.01.23.
8. If, pursuant to Idaho Code § 67-5247, the Director finds the public health, safety or welfare requires emergency action, the Director shall incorporate findings in support of such action in a written notice of emergency revocation issued to the permittee. Emergency revocation shall be effective upon receipt by the permittee. Thereafter, if requested by the permittee in writing, a revocation hearing before the Board of Department of Environmental Quality shall be provided. Such hearings shall be conducted in accordance with the Rules of Administrative Procedures contained in IDAPA 58.01.23.
9. The provisions of this permit are severable and if a provision or its application is declared invalid or unenforceable for any reason, that declaration will not affect the validity or enforceability of the remaining provisions.
10. The permittee shall notify DEQ at least six (6) months prior to permanently removing any permitted reuse facility from service, including any treatment, storage, or other facilities or equipment associated with the reuse site. Prior to commencing closure activities, the permittee shall: a) participate in a pre-site closure meeting with DEQ; b) develop a Site Closure Plan that identifies specific closure, site characterization, or cleanup tasks with scheduled task completion dates in accordance with agreements made at the pre-site closure meeting; and c) submit the completed Site Closure Plan to DEQ for review and approval within forty-five (45) days of the pre-site closure meeting. The permittee must complete DEQ approved Site Closure Plan.

Appendix 1
Environmental Monitoring Serial Numbers

HYDRAULIC MANAGEMENT UNITS

SERIAL NUMBER	DESCRIPTION	ACRES
MU-014701	Rapid Infiltration Basin #1	0.99
MU-014702	Rapid Infiltration Basin #2	0.99
MU-014703	Rapid Infiltration Basin #3	0.95

WASTEWATER SAMPLING POINTS

SERIAL NUMBER	DESCRIPTION
WW-014701	Grab Sample of Influent to Lagoon #1 and #2
WW-014702	Grab Sample of Effluent to Each Rapid Infiltration Basin


GROUND WATER MONITORING

SERIAL NUMBER	DESCRIPTION	LOCATION
GW-014701	Monitoring Well #1 or A	Upgradient
GW-014702	Monitoring Well #2 or B	Downgradient
GW-014703	Monitoring Well #3 or C	Downgradient
GW-014704	Monitoring Well #4 or D	Downgradient

LAGOONS

SERIAL NUMBER	DESCRIPTION	VOLUME (MG)
LG-014701	Lagoon # 1 (aerated)	1.7
LG-014702	Lagoon # 2 (facultative)	1.5

Appendix 2
Site Maps

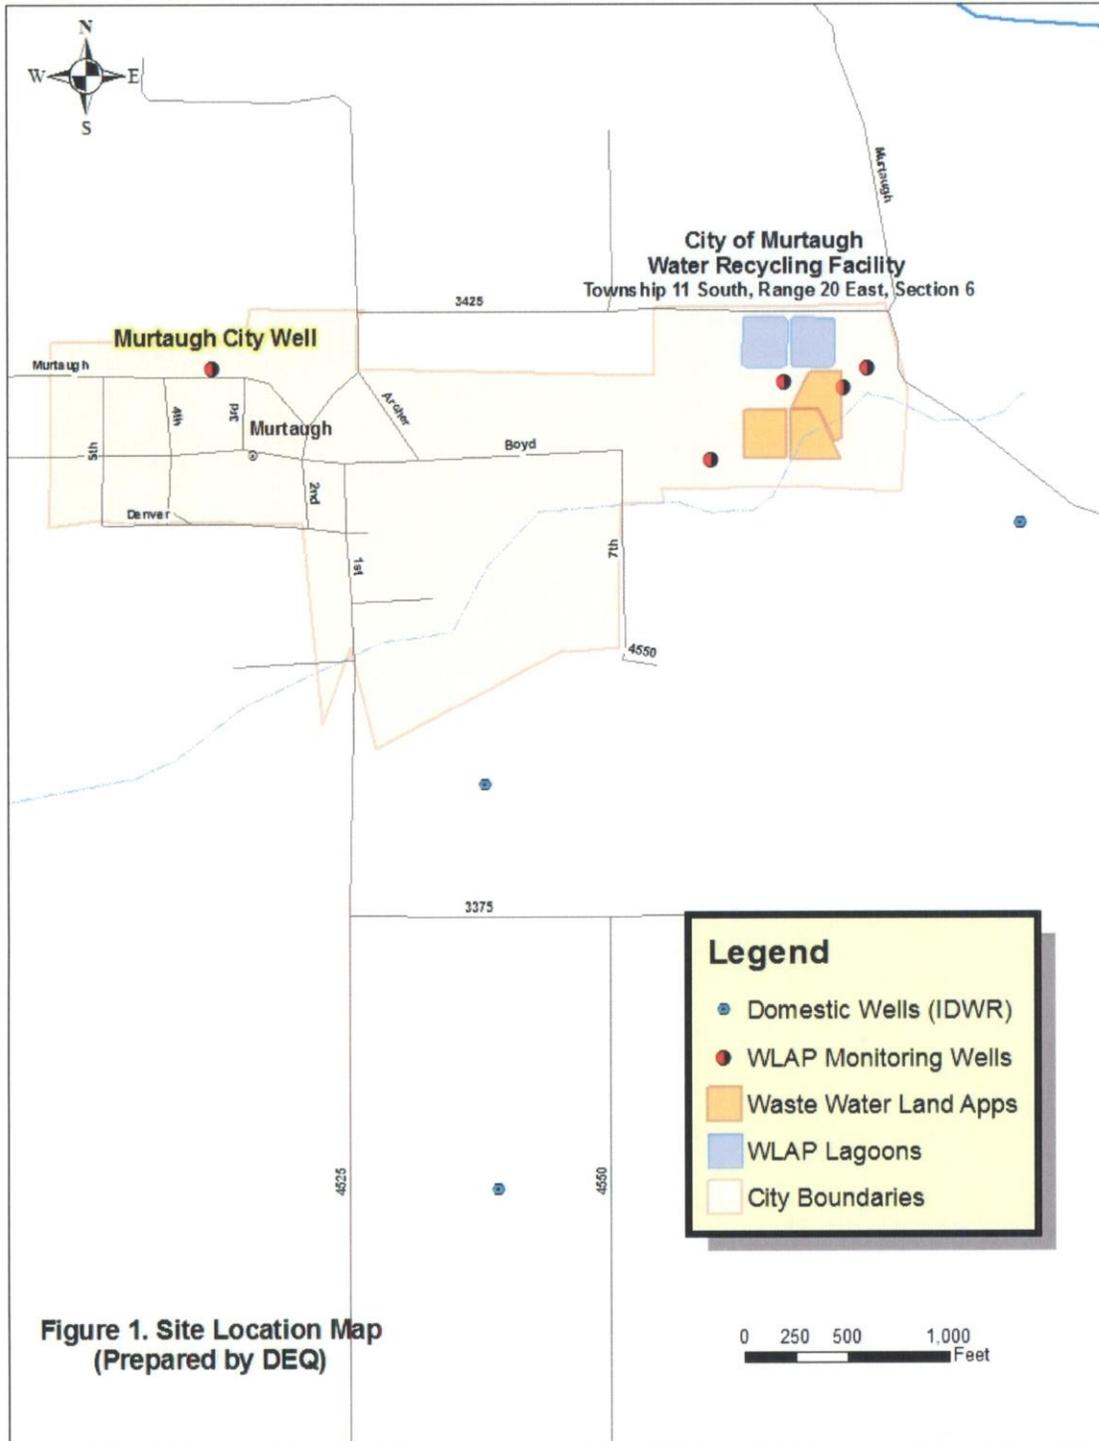

Appendix 2
Site Maps

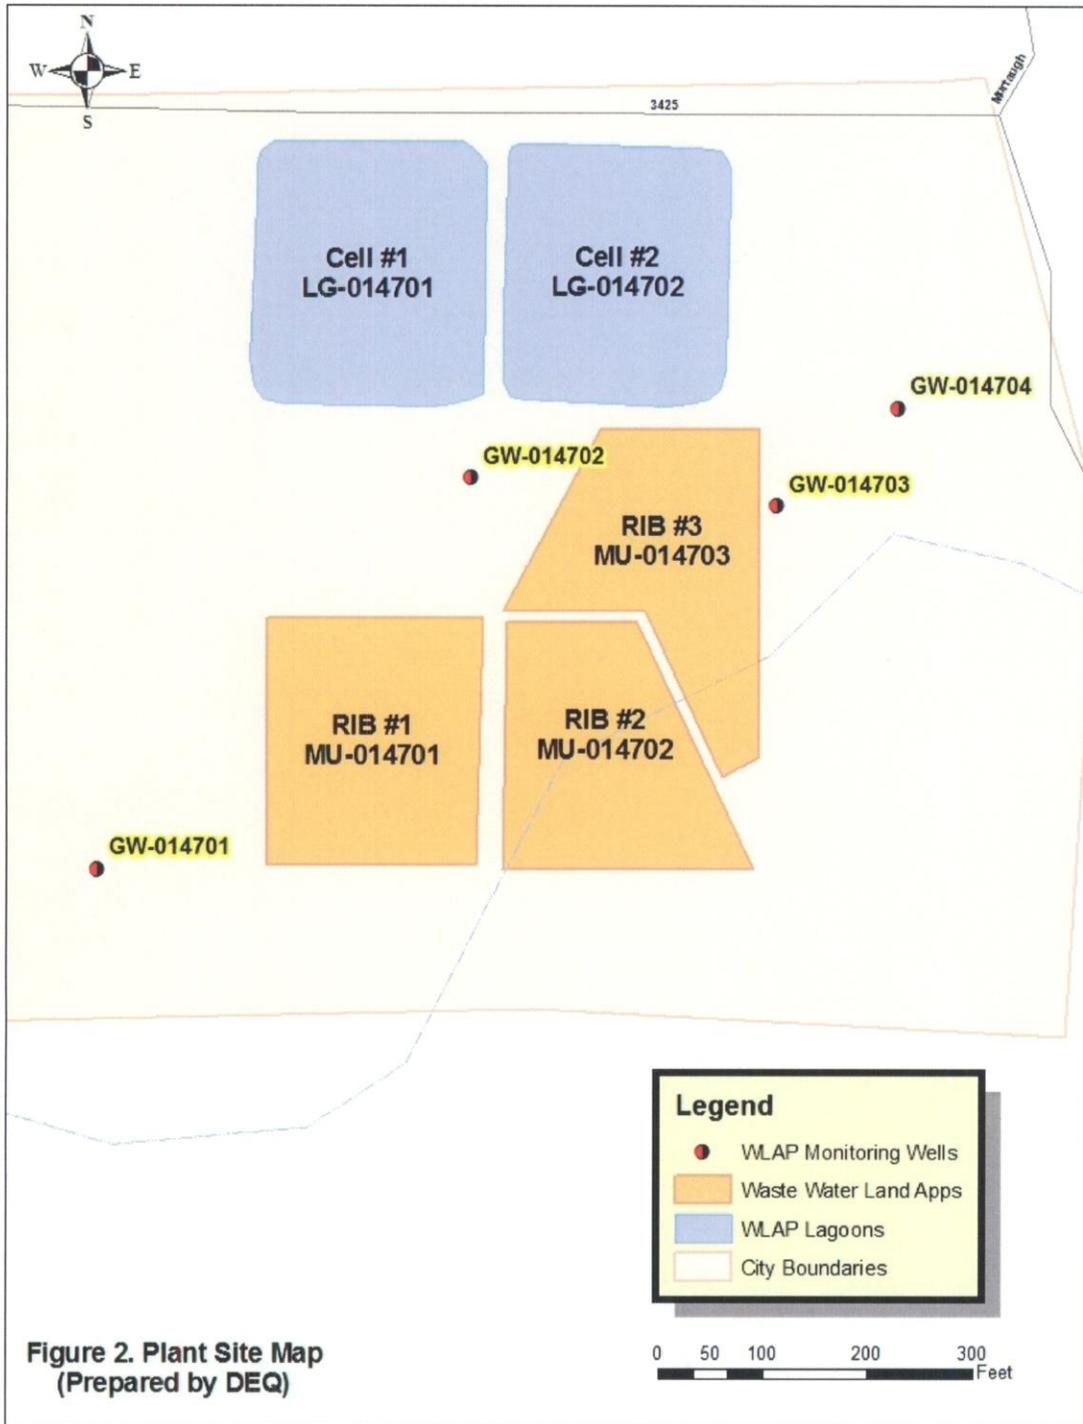


Figure 2. Plant Site Map
(Prepared by DEQ)

Appendix 2
Site Maps



Figure 3. Aerial Map
(Prepared by DEQ)

